

Date:	05/11/2018	Weather:		Coding:	RZMACP
MH#:	M-904-009	Owner:	NA	Len. Surveyed:	14.5
P.O.#:		Surveyor:	Jen Costello	Rim to Invert:	15.0
Customer:		Cert. #:	U-907-5518	Wall Material:	Concrete (reinforced)
Street:	680' East of Rush C	t. North of Fraser	Project:	Hobart, IN	
City:	Hobart, IN		GPS Northing:	2911238.948	
Location:			GPS Easting:	2911238.948	
Drain Area:	Northeast		GPS Accuracy:	Sub-Meter	
Cover Shape:	Circular		Evidence of Surcharge:	No	
Cover Size: Comments:	22.5		Potential for Runoff:	None	
O&M Index:	0.00	O&M Quick:	0000	O&M Rating:	0.00
Structural Index:	3.00	Structural Qui	ick: 3A00	Structural Rating:	42.00
Overall Index:	3.00	Overall Quick	: <b>3A00</b>	Overall Rating:	42.00



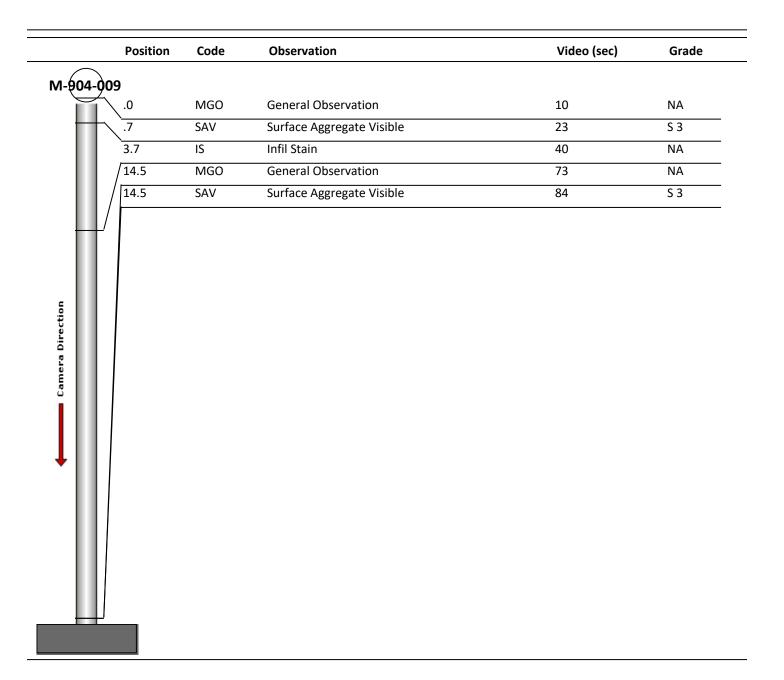

Code: Description:	MGO General Observation
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Step:	NO
Remarks:	access mh

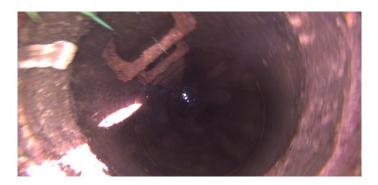

Code:SAVDescription:Surface Aggregate Visible

Distance (ft):	.7
Structural Grade:	3
O&M Grade:	0
Clock Start/From:	12
Clock To:	12
1st Value:	
2nd Value:	
Value Percent:	
Step:	NO
Remarks:	



Code: Description:	IS Infil Stain
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value:	3.7 0 0 12 12
Value Percent: Step: Remarks:	NO



Code:	MGO
Description:	<b>General Observation</b>
///	
Distance (ft):	14.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Step:	NO
Remarks:	end survey



Code:SAVDescription:Surface Aggregate Visible

Distance (ft):	14.5
Structural Grade:	3
O&M Grade:	0
Clock Start/From:	12
Clock To:	12
1st Value:	
2nd Value:	
Value Percent:	
Step:	NO
Remarks:	