

Profile/Photo Observation Report




Date:	01/31/2023	Weather:		Coding:	PACP 7.0
Pipe Length (ft):	115.0	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	M-805-037.2-M-805-037.
Customer:	City of Hobart	Clean Date:	11/12/2022	Shape:	C

Street:	South Liberty Place	Flow Control:	Not Controlled
City:	Hobart, IN	Year Renewed:	
Location:	Local rural streets with light traffic, t	Tape/Media #:	
Purpose:	Routine Assessment	Dia/Height:	8"
Use:	Sanitary Sewage Pipe	Material:	PVC
Drain Area:		Lining:	None
Category:	NA		

Comment:

Location Details:		Direction of Survey:	Upstream
US MH:	M-805-037.2	DS MH:	M-805-037.1
		Total Length Surveyed (ft):	115.8

O&M Index:	0.00	O&M Quick:	0000	O&M Rating:	0.00
Structural Index:	2.00	Structural Quick:	2B00	Structural Rating:	30.00
Overall Index:	2.00	Overall Quick:	2B00	Overall Rating:	30.00

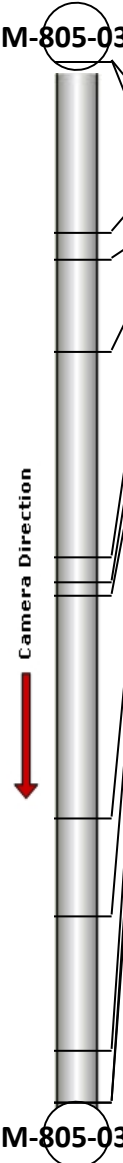	Position	Code	Observation	Video (sec)	Grade
	M-805-037.1				
	.0	AMH	Manhole	1	NA
	.0	MWL	Miscellaneous Water Level	63	NA
	19.1	MGO	Miscellaneous General Observation	180	NA
	22.0	MWLS(S01)	Miscellaneous Water Level Sag	204	S 2
	32.2	MGO	Miscellaneous General Observation	278	NA
	55.2	MWLS(F01)	Miscellaneous Water Level Sag	353	S 2
	58.0	MGO	Miscellaneous General Observation	409	NA
	59.3	MWLS(S02)	Miscellaneous Water Level Sag	431	S 2
	84.1	MWLS(F02)	Miscellaneous Water Level Sag	510	S 2
	95.1	MWLS(S03)	Miscellaneous Water Level Sag	550	S 2
	110.1	MWLS(F03)	Miscellaneous Water Level Sag	612	S 2
	115.8	MGO	Miscellaneous General Observation	735	NA
	115.8	AMH	Manhole	745	NA
M-805-037.2					




Code: **AMH**
Description: **Manhole**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **M-805-037.1**



Code: **MWL**
Description: **Miscellaneous Water Level**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:

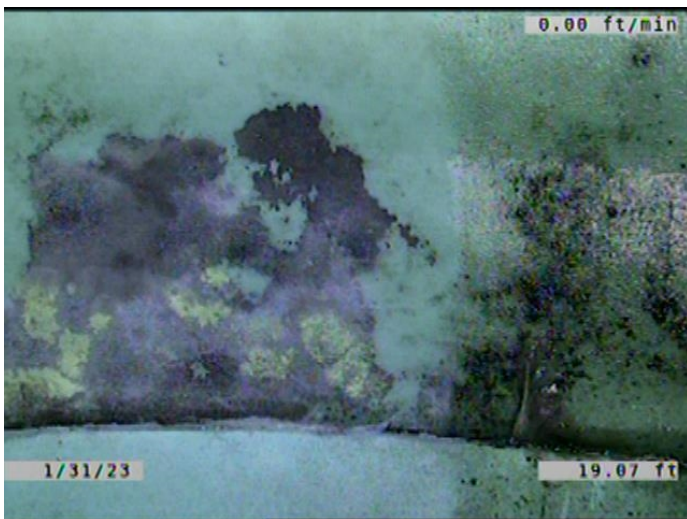


Code: **MGO**
Description: **Miscellaneous General Observation**

Distance (ft): **19.1**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED**



Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **22.0**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **S01**
Within 8" of Joint: **NO**
Remarks:

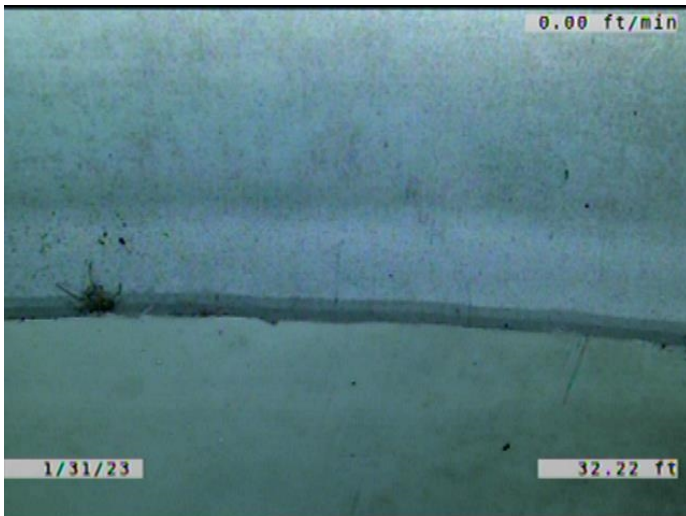


Code: **MGO**
Description: **Miscellaneous General Observation**

Distance (ft): **32.2**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED**



Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **55.2**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **F01**
Within 8" of Joint: **NO**
Remarks:

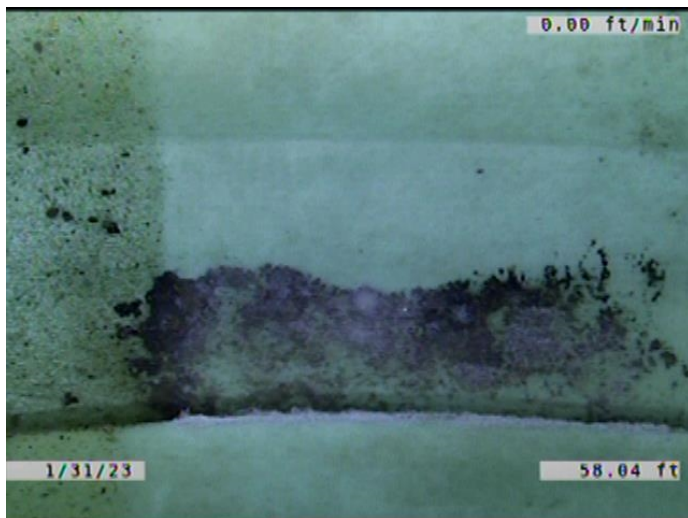


Code: **MGO**
Description: **Miscellaneous General Observation**

Distance (ft): **58.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED**




Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **59.3**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **S02**
 Within 8" of Joint: **NO**
 Remarks:

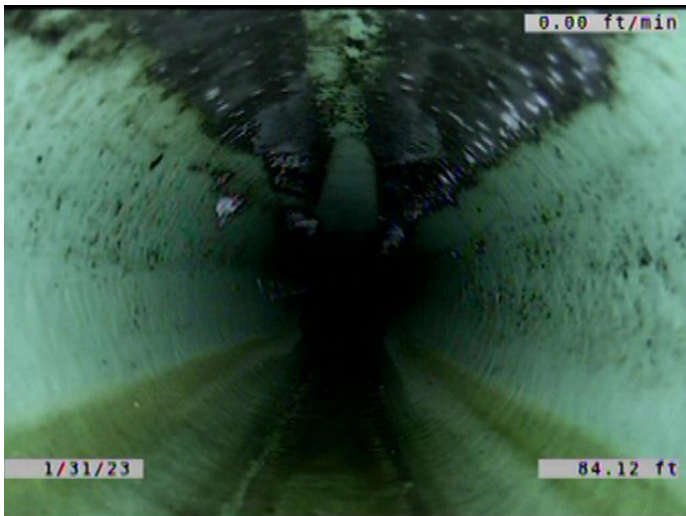


Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **84.1**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **F02**
 Within 8" of Joint: **NO**
 Remarks:

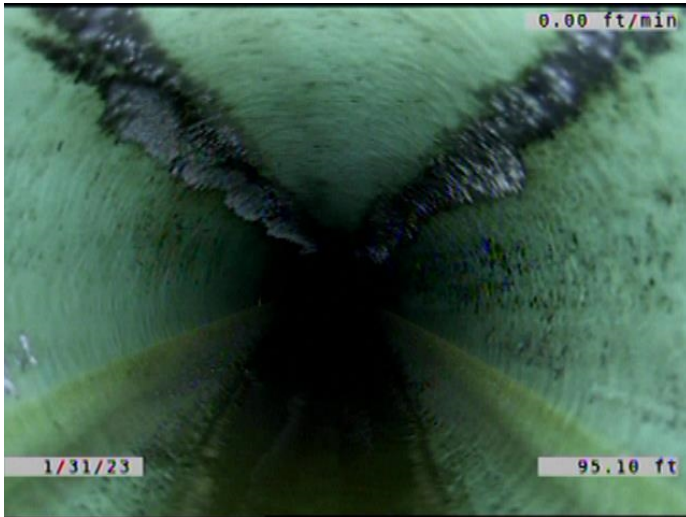

Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **95.1**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **S03**
Within 8" of Joint: **NO**
Remarks:

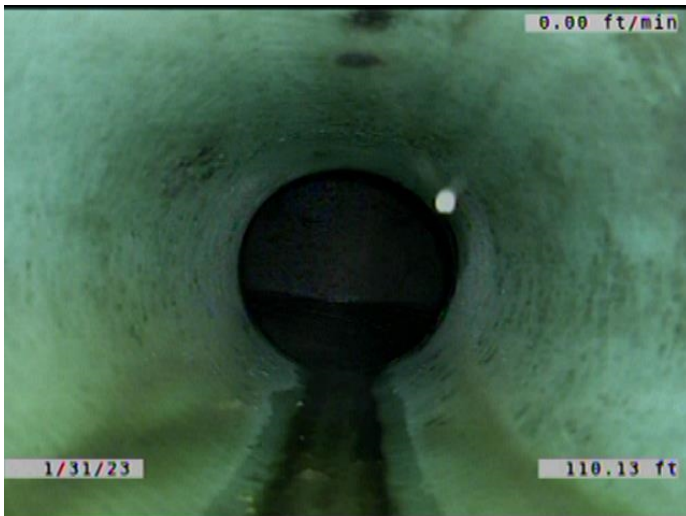

Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **110.1**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **F03**
Within 8" of Joint: **NO**
Remarks:



Code:	MGO
Description:	Miscellaneous General Observation
Distance (ft):	115.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	LOOKS TO BE FIBER OPTIC CROSS BORED THROUGH THE MANHOLE.



Code:	AMH
Description:	Manhole
Distance (ft):	115.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-805-037.2