
Profile/Ph	oto Observation	Report			RedZon
Date:	09/28/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft	): <b>134.2</b>	Owner:	NA	Pre Clean:	Not Known
P.O.#:		Surveyor:	Selasie Honu	PSR:	P-103-017-018
Customer:		Clean Date:	01/01/1900	Shape:	С
Street:	WILLOW ST		Flow Control:	Not Controlled	l
City:	Hobart, IN		Year Renewed:		
Location:	Light Highway		Tape/Media #:		
Purpose:	Routine Assessmen	nt	Dia/Height:	8"	
Use:	Sanitary		Material:	VCP	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:					
Location Detail	ls:		Direction of Surv	ey: Downstream	
US MH:	M-103-018	DS MH:	M-103-017	Total Length Surveyed (ft)	): <b>19.6</b>
0&M Index:	1.00	O&M Quick:	110	0 O&M Rating:	1.00
tructural Index:	0.00	Structural Qu	ick: 000	0 Structural Rating:	0.00
Overall Index:	1.00	Overall Quick	: 110	0 Overall Rating:	1.00





Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-103-018

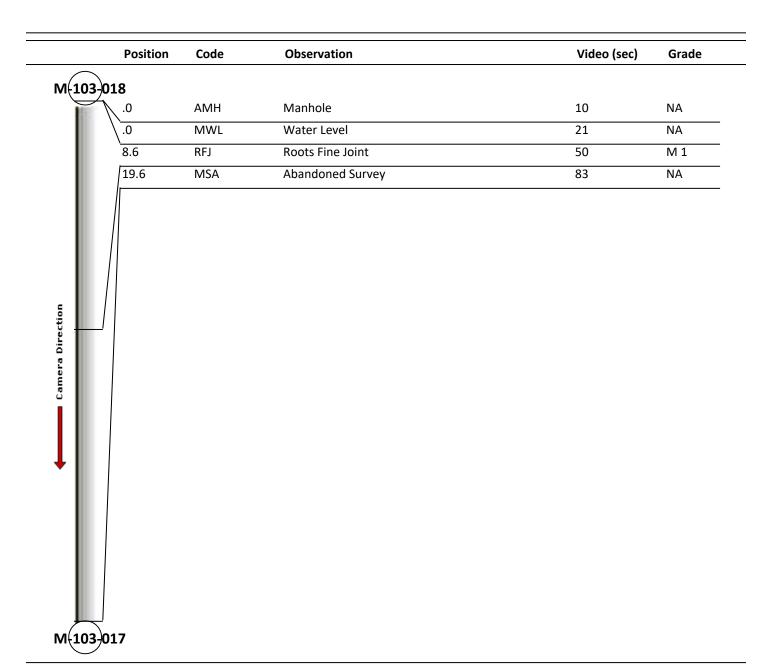


Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code:	RFJ
Description:	<b>Roots Fine Joint</b>

Distance (ft):	8.6
Structural Grade:	0
O&M Grade:	1
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

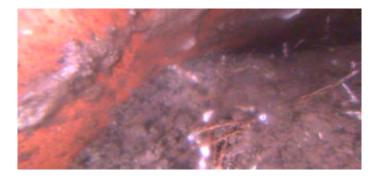

Code: Description: MSA Abandoned Survey

Distance (ft):	19.6
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	ROOT

NO ROOT INFILTRATION