Date:	03/23/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft):	193.8	Owner:	NA	Pre Clean:	Not Known
P.O.#:		Surveyor:	Justin Gonzales	PSR:	P-103-120-119
Customer:		Clean Date:	01/01/1900	Shape:	С
Street:	MISSOURI ST		Flow Control:	Not Controlled	
City:	Hobart, IN		Year Renewed:		
Location:	Other		Tape/Media #:		
Purpose:	Not Known		Dia/Height:	8"	
Use:	Sanitary		Material:	PVC	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:					
Location Details:			Direction of Surve	y: Upstream	
US MH: N	И-103-119	DS MH:	M-103-120	Total Length Surveyed (ft)	: <b>180.7</b>
D&M Index:	2.00	O&M Quick:	2F00	O&M Rating:	74.00
Structural Index:	0.00	Structural Qu	uick: 0000		0.00
Overall Index:	2.00	Overall Quicl			74.00

103-120 .0 .0 1.6 9.0 12.7 31.9 112.6 137.5	AMH MWL DAZ(S01) DSC TF TF	Manhole Water Level Deposits Attached Other Deposits Settled Compacted Tap Factory	10 21 32 47	NA NA M 2 M 2
.0 .0 1.6 9.0 12.7 31.9 112.6	MWL DAZ(S01) DSC TF TF	Water Level Deposits Attached Other Deposits Settled Compacted Tap Factory	21 32 47	NA M 2
.0 1.6 9.0 12.7 31.9 112.6	DAZ(S01) DSC TF TF	Deposits Attached Other Deposits Settled Compacted Tap Factory	32 47	M 2
1.6 9.0 12.7 31.9 112.6	DSC TF TF	Deposits Settled Compacted Tap Factory	47	
9.0 12.7 31.9 112.6	TF TF	Tap Factory		M 2
12.7 31.9 112.6	TF			
31.9 112.6			73	NA
112.6		Tap Factory	93	NA
	TF	Tap Factory	144	NA
137.5	TF	Tap Factory	318	NA
	TF	Tap Factory	379	NA
180.7	AMH	Manhole	477	NA
180.7	DAZ(F01)	Deposits Attached Other	488	M 2




Code:	АМН
Description:	Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-103-120



Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

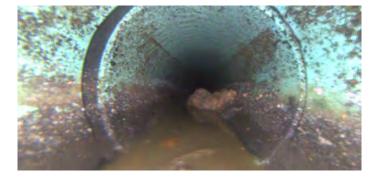


Code:	DAZ
Description:	Deposits Attached Other

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	5
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S01
Within 8" of Joint:	YES
Remarks:	WANDER




Code:DSCDescription:Deposits Settled Compacted

Distance (ft):	1.6
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	5
Clock To:	6
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

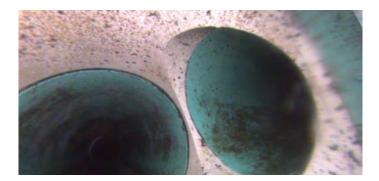


Code: Description:	TF Tap Factory
Distance (ft):	9.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

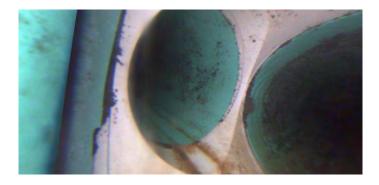

Code:	TF
Description:	Tap Factory
Distance (ft):	12.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10

Clock Start/From: 10 Clock To: 1st Value: 4.000 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:

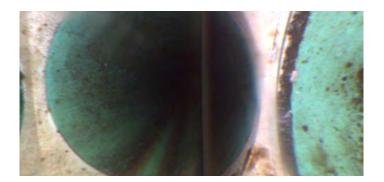


Code: Description:	TF Tap Factory
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value:	31.9 0 0 10 4.000
2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	4.000



Code:	TF
Description:	Tap Factory
Distance (ft):	112.6
Distance (It).	112.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	

Remarks:

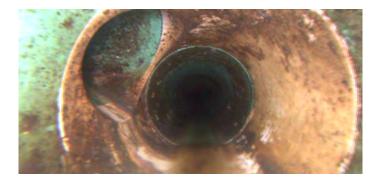

Code:	TF
Description:	Tap Factory
Distance (ft):	137.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To: 1st Value:	4.000
2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	



Code: AMH Description: Manhole

Distance (ft):	180.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-103-119

Code: Description: DAZ Deposits Attached Other



Distance (ft):	180.7
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	5
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	F01
Within 8" of Joint:	YES
Remarks:	WANDER