

Profile/Ph	oto Observatio	n Report			RedZon
Date:	03/22/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft	:): <b>249.1</b>	Owner:	NA	Pre Clean:	Not Known
P.O.#:		Surveyor:	Selasie Honu	PSR:	P-103-126-122
Customer:		Clean Date	: 01/01/1900	Shape:	С
Street:	ALLEY BEWTWEE	N MAPLE ST & AI	A Flow Control:	Not Controlle	d
City:	Hobart, IN		Year Renewed:		
Location:	Other		Tape/Media #:		
Purpose:	Not Known		Dia/Height:	8"	
Use:	Sanitary		Material:	PVC	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:					
Location Detai	ls:		Direction of Su	rvey: Downstream	
US MH:	M-103-122	DS MH:	M-103-126	Total Length Surveyed (ft	t): <b>240.3</b>
0&M Index:	5.00	O&M Quick	51	00 O&M Rating:	5.00
tructural Index	0.00	Structural C	uick: 00	00 Structural Rating	. 0.00
Overall Index:	5.00	Overall Quid			5.00

	Position	Code	Observation	Video (sec)	Grade
M-10	03-122				
	.0	AMH	Manhole	10	NA
	.0	MWL	Water Level	21	NA
	56.4	TF	Tap Factory	147	NA
	57.9	TF	Tap Factory	164	NA
	// 75.7	TF	Tap Factory	211	NA
	/ 115.2	TF	Tap Factory	302	NA
	/ 119.8	TF	Tap Factory	325	NA
- H	/ 198.5	TF	Tap Factory	496	NA
	236.9	TFA	Tap Factory Active	585	NA
5 B	240.3	MSA	Abandoned Survey	603	NA
ecti	240.3	DSGV	Deposits Settled Gravel	614	M 5
Camera Direction					
M(10	03)126				

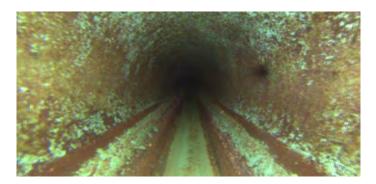


Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-103-122

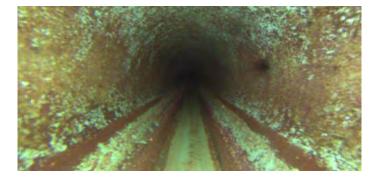

Code: MWL Description: Water Level

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: 5.000 Continuous Index: Within 8" of Joint: NO Remarks:

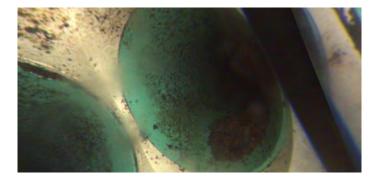


Code: Description:	TF Tap Factory
Distance (ft):	56.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code:	TF	
Description:	Tap Factory	
Distance (ft):	57.9	
Structural Grade:	0	
O&M Grade:	0	
Clock Start/From:	1	
Clock To:		
1st Value:	4.000	
2nd Value:		
Value Percent:		
Continuous Index:		
Within 8" of Joint:		
Remarks:		




Code: Description:	TF Tap Factory
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	75.7 0 0 1 4.000

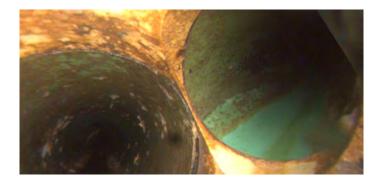


Code:	TF
Description:	Tap Factory

Distance (ft):	115.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

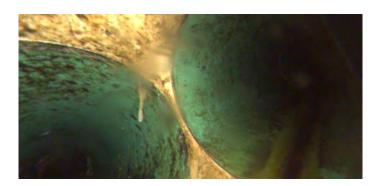


Code: Description:	TF Tap Factory
Distance (ft):	119.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

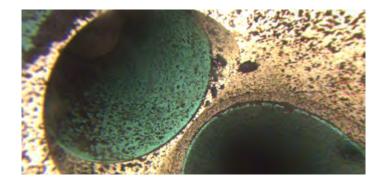


Code:	TF
Description:	Tap Factory

Distance (ft):	198.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

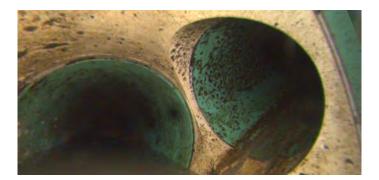

Code: Description:	TFA Tap Factory Active
Distance (ft):	236.9
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

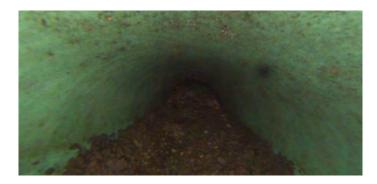

Code:MSADescription:Abandoned Survey

Distance (ft):	240.3
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	DSGV



Code:	
Description:	

DSGV Deposits Settled Gravel

Distance (ft):	240.3
Structural Grade:	0
O&M Grade:	5
Clock Start/From:	12
Clock To:	12
1st Value:	
2nd Value:	
Value Percent:	45.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	