
Date: Pipe Length (ft	10/18/2021	Weather: Owner:	Hobart, IN	Coding: Pre Clean:	PACP 6.0 Not Known
P.O.#:	872_1	Surveyor:	M. Pielacha	PSR:	P-203-030-027
Customer:	– Hobart, IN	Clean Date:		Shape:	С
Street:	38th Avenue		Flow Control:		
City:	Hobart, IN		Year Renewed:		
Location:	Alley		Tape/Media #:	872	
Purpose:	Routine Assessmen	t	Dia/Height:	10"	
Use:	Sanitary		Material:	VCP	
Drain Area:			Lining:		
Category:	NA				
Comment:					
Location Detai	ls:		Direction of Surv	vey: Upstream	
US MH:	M-203-30	DS MH:	M-203-27	Total Length Surveyed (ft)	: 155.5
0&M Index:	2.33	O&M Quick:	312	2 O&M Rating:	7.00
itructural Index	0.00	Structural Qu	ick: 000		0.00
Overall Index:	2.33	Overall Quick			7.00

	Position	Code	Observation	Video (sec)	Grade
M-203	3-27				
	.0	AMH	Manhole	0	NA
- 11	.0	MWL	Water Level	39	NA
- 11	6.1	OBM	Obstacle Pipe Material	75	M 2
- 11	33.3	TF	Tap Factory	304	NA
- 11	68.3	TFC	Tap Factory Capped	385	NA
	85.8	TF	Tap Factory	449	NA
- 11	116.1	TFC	Tap Factory Capped	579	NA
- 11	123.9	TFD	Tap Factory Defective	616	M 2
- 11	123.9	RML	Roots Medium Lateral	627	M 3
Camera Direction	155.5	AMH	Manhole	791	NA



Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-203-27

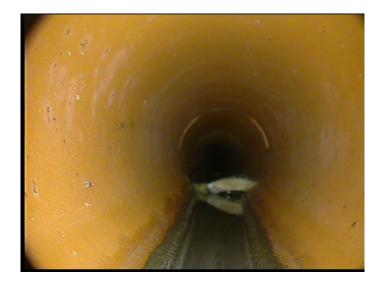

Code:	MWL
Description:	Water Level
Distance (ft):	.0
(<i>)</i>	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	OBM Obstacle Pipe Material
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value:	6.1 0 2 5 7
2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	10.000 NO



Code: Description:	TF Tap Factory
	rupractory
Distance (ft):	33.3
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	TFC Tap Factory Capped
Distance (ft):	68.3
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code:	TF
Description:	Tap Factory
Distance (ft):	05 0
Distance (ft):	85.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Code: Description:	TFC Tap Factory Capped
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	116.1 0 0 2 4.000



Code: Description:	TFD Tap Factory Defective
Distance (ft):	123.9
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	11
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	roots



Code: Description:	RML Roots Medium Lateral
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	123.9 0 3 7 11 15.000 NO

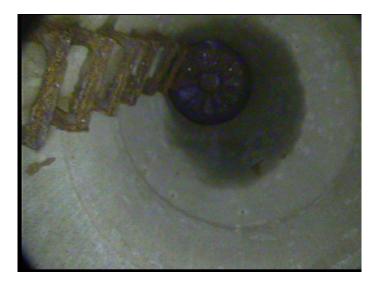

Code: Description:	AMH Manhole
Distance (ft):	155.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-203-30