Profile/Photo Observation Report



Date: 03/23/2018 Weather: Coding: PACP 6.0

Pipe Length (ft): 207.6 Owner: NA Pre Clean: No Pre-Cleaning P.O.#: Surveyor: Justin Gonzales PSR: P-208-010-011

Customer: Clean Date: 01/01/1900 Shape: C

Street: FOXCROFT STREET Flow Control: Not Controlled

City: Hobart, IN Year Renewed: Location: Light Highway Tape/Media #:

Purpose: Routine Assessment Dia/Height: 8"
Use: Sanitary Material: VCP

Drain Area: NA Lining:

Category: NA

Comment: Flow direction wrong
Location Details: Direction of Survey: Upstream

US MH: M-208-011 DS MH: M-208-010 Total Length Surveyed (ft): 200.9

2.08 382N 179.00 O&M Index: O&M Quick: O&M Rating: 4.00 4.00 Structural Quick: Structural Rating: Structural Index: 2.10 183.00 Overall Quick: Overall Rating: Overall Index:

	Position	Code	Observation	Video (sec)	Grade
v(208	010				
	0.	AMH	Manhole	10	NA
н		MWL	Water Level	21	NA
н	3.2	DAE	Deposits Attached Encrustation	39	M 2
ш	5.7	DAE(S02)	Deposits Attached Encrustation	55	M 2
	8.9	ID	Infil Dripper	73	M 3
	11.7	ID	Infil Dripper	90	M 3
ш	14.6	RFJ	Roots Fine Joint	107	M 1
ш	17.7	IW(S03)	Infil Weeper	125	M 2
ш	36.3	TF	Tap Factory	174	NA
	√√39.5	TF	Tap Factory	193	NA
ш	68.2	ID	Infil Dripper	263	M 3
	88.6	ID	Infil Dripper	315	M 3
	91.9	ID	Infil Dripper	333	M 3
	94.8	MMC	Material Change	350	NA
ш	95.6	TF	Tap Factory	363	NA
ш	98.1	MGO	General Observation	379	NA
-	98.7	TF	Tap Factory	394	NA
ш	100.0	MMC	Material Change	409	NA
ш	145.2	FM	Fracture Multiple	513	S 4
	145.2	ID	Infil Dripper	524	M 3
	146.4	TF	Tap Factory	541	NA
	149.6	TF	Tap Factory	559	NA
ш	162.9	ID	Infil Dripper	600	M 3
ш	189.5	ID	Infil Dripper	669	M 3
ш	200.9	AMH	Manhole	707	NA
	_/ / 200.9	IW(F03)	Infil Weeper	718	M 2
	200.9	DAE(F02)	Deposits Attached Encrustation	729	M 2
/1 208	011				



Code: AMH
Description: Manhole

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-208-010



Code: MWL

Description: Water Level

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: NO



Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 3.2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 5
1st Value:

2nd Value:

Value Percent: 10.000

Continuous Index:

Within 8" of Joint:

Remarks:

YES




Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 5.7
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 5
1st Value:
2nd Value:

Value Percent: 5.000
Continuous Index: S02
Within 8" of Joint: YES

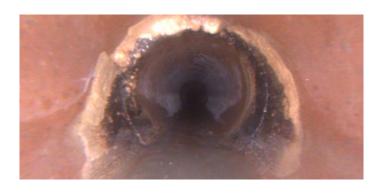

Description: Infil Dripper


Distance (ft): 8.9
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 12

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

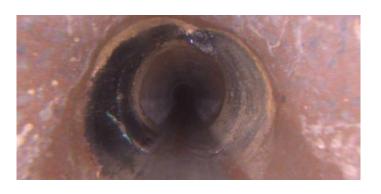


Code: ID

Description: Infil Dripper

Distance (ft): 11.7
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 12
Clock To: 1st Value: 2nd Value: Value Percent:

Continuous Index: Within 8" of Joint:

ithin 8" of Joint: YES

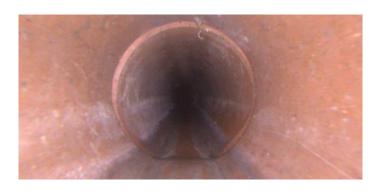

Code: RFJ

Description: Roots Fine Joint


Distance (ft): 14.6
Structural Grade: 0
O&M Grade: 1
Clock Start/From: 12

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint:

Remarks:

YES

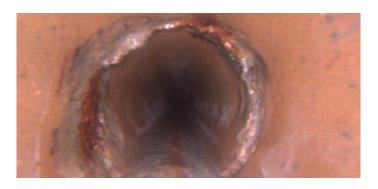

Code: IW

Description: Infil Weeper

Distance (ft): 17.7
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 7

Clock To: 5

1st Value: 2

2nd Value: Value Percent:

Continuous Index: **S03** Within 8" of Joint: **YES**



Description: Tap Factory


Distance (ft): 36.3
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

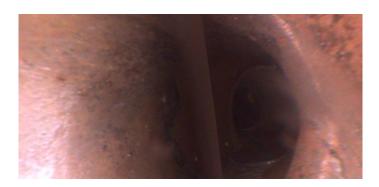

Code: **TF**

Description: Tap Factory

Distance (ft): 39.5
Structural Grade: 0

O&M Grade: 0

Clock Start/From: 2

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Description: Infil Dripper

Distance (ft): 68.2
Structural Grade: 0

O&M Grade: 3

Clock Start/From: 12

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: **ID**


Description: Infil Dripper

Distance (ft): 88.6
Structural Grade: 0

O&M Grade: 3

Clock Start/From: 12

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

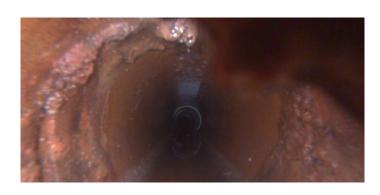

Description: Infil Dripper

Distance (ft): 91.9
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 12

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: MMC

Description: Material Change

Distance (ft): 94.8
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO Remarks: PVC



Description: Tap Factory

Distance (ft): 95.6
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value:

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

Code: MGO

Description: General Observation

4.000



Distance (ft): 98.1
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: DAE ATTACHED TO LENS; SWITCHING

TO REAR CAMERA



Description: Tap Factory


Distance (ft): 98.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

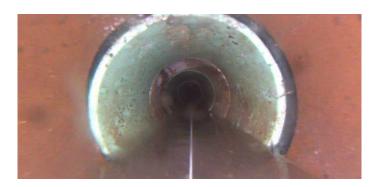

Code: MMC


Description: Material Change

Distance (ft): 100.0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO Remarks: vcp

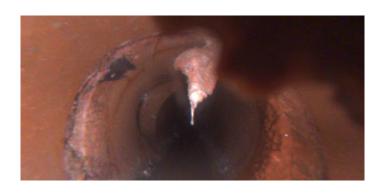

Code: FM

Description: Fracture Multiple

Distance (ft): 145.2
Structural Grade: 4

O&M Grade: 0

Clock Start/From: 8


Clock To: 12

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

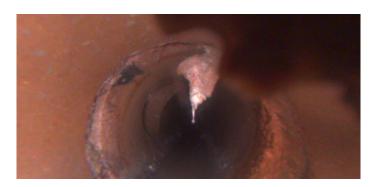

Code: ID

Description: Infil Dripper

Distance (ft): 145.2
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 12

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES



Description: Tap Factory


Distance (ft): 146.4
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

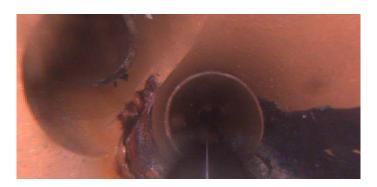

Code: **TF**


Description: Tap Factory

Distance (ft): 149.6
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

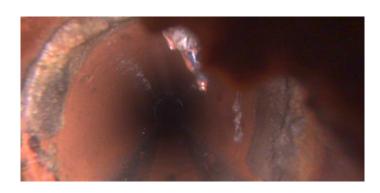

Description: Infil Dripper

Distance (ft): 162.9
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 1

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

YES



Code: ID

Description: Infil Dripper

Distance (ft): 189.5
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 11
Clock To: 12
1st Value:
2nd Value:
Value Percent:

Within 8" of Joint:

Continuous Index:



Code: AMH
Description: Manhole

Distance (ft): 200.9
Structural Grade: 0
O&M Grade: 0

Clock Start/From: Clock To:

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: Manhole reached




Code: IW

Description: Infil Weeper

Distance (ft): 200.9
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 5
1st Value:

2nd Value:
Value Percent:

Continuous Index: F03
Within 8" of Joint: YES

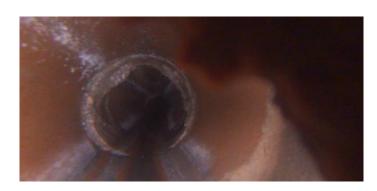

Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 200.9
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 5

1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: F02
Within 8" of Joint: YES