Profile/Photo Observation Report



Date: 03/19/2018 Weather: Coding: PACP 6.0

Pipe Length (ft): 117.8 Owner: NA Pre Clean: No Pre-Cleaning
P.O.#: Surveyor: John Kuglmaier PSR: P-209-016-017

Customer: Clean Date: 01/01/1900 Shape: C

Street: FOXCROFT STREET Flow Control: Not Controlled

City: Hobart, IN Year Renewed: Location: Light Highway Tape/Media #:

Purpose: Routine Assessment Dia/Height: 8"
Use: Sanitary Material: VCP

Drain Area: NA Lining:

Category: NA

Comment: P_C at 63 ft debris . flow direction wrong

Location Details: Direction of Survey: **Downstream**

US MH: M-209-017 DS MH: M-209-016 Total Length Surveyed (ft): 64.2

2.86 20.00 O&M Index: O&M Quick: O&M Rating: 0.00 0000 0.00 Structural Quick: Structural Rating: Structural Index: 2.86 20.00 Overall Quick: Overall Rating: Overall Index:

	Position	Code	Observation	Video (sec)	Grade
209-0	17				
	0.	AMH	Manhole	10	NA
	0.	MWL	Water Level	21	NA
	0.	ID	Infil Dripper	33	M 3
'	\\.3	DAE(S01)	Deposits Attached Encrustation	44	M 4
ш	5.3	IW	Infil Weeper	66	M 2
	13.4	DAE(F01)	Deposits Attached Encrustation	93	M 4
	17.2	MWL	Water Level	112	NA
ш	29.5	DAGS	Deposits Attached Grease	148	M 2
ш	58.1	RFJ	Roots Fine Joint	217	M 1
ш	64.2	MSA	Abandoned Survey	240	NA
Ш					

Code:



Description:	Manhole		
Distance (ft):	.0		
Structural Grade:	0		
O&M Grade:	0		
Clock Start/From:			
Clock To:			
1st Value:			
2nd Value:			
Value Percent:			
Continuous Index:			
Within 8" of Joint:	NO		
Remarks:	M-209-017		

AMH



Code: MWL
Description: Water Level

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0
Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000

Continuous Index:

Within 8" of Joint:

Remarks:

Code:

ID

NO

Description: Infil Dripper



Distance (ft): .0
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 12
Clock To:
1st Value:

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES



Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): .3
Structural Grade: 0
O&M Grade: 4
Clock Start/From: 8
Clock To: 4
1st Value:


2nd Value:

Value Percent: 25.000
Continuous Index: S01
Within 8" of Joint: YES

Remarks:




Description: Infil Weeper

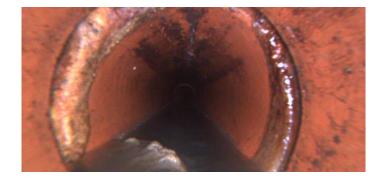

Distance (ft): 5.3
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 12
Clock To: 4
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: YES

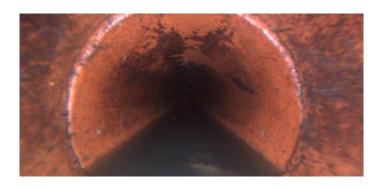

Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 13.4
Structural Grade: 0

O&M Grade: 4

Clock Start/From: 8

Clock To: 4

1st Value:

2nd Value:

Value Percent: 25.000
Continuous Index: F01
Within 8" of Joint: YES

Remarks: Clock positions vary



Code: MWL

Description: Water Level

Distance (ft): 17.2
Structural Grade: 0

O&M Grade: 0


Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 30.000

Continuous Index:

Within 8" of Joint: NO

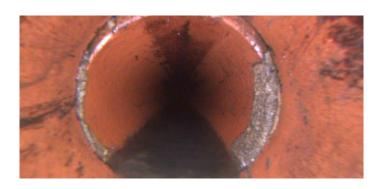

Code: DAGS

Description: Deposits Attached Grease

Distance (ft): 29.5
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 2

Clock To: 4

1st Value:

2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

YES

Remarks:



Code: RFJ


Description: Roots Fine Joint

Distance (ft): 58.1
Structural Grade: 0
O&M Grade: 1
Clock Start/From: 9
Clock To:
1st Value:
2nd Value:

Continuous Index: Within 8" of Joint:

Value Percent:

thin 8" of Joint: YES

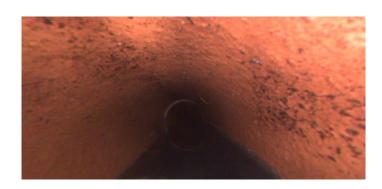

Code: MSA

Description: Abandoned Survey

Distance (ft): 64.2
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: Unknown