## **Profile/Photo Observation Report**



Date: 03/28/2018 Weather: Coding: **PACP 6.0** Pipe Length (ft): 280.1 Owner: NA Pre Clean: **Not Known** P.O.#: Surveyor: PSR: P-303-035-034 Selasie Honu

Customer: Clean Date: 01/01/1900 Shape: C

Street: OFF W 38TH AVE Flow Control: Not Controlled

City: Hobart, IN Year Renewed:
Location: Other Tape/Media #:

Purpose: Not Known Dia/Height: 10"
Use: Sanitary Material: VCP

Drain Area: NA Lining:

Category: NA

Comment:

Location Details: Direction of Survey: Upstream

US MH: M-303-034 DS MH: M-303-035 Total Length Surveyed (ft): 91.0

2.33 3122 7.00 O&M Index: O&M Quick: O&M Rating: 3.00 3200 6.00 Structural Index: Structural Quick: Structural Rating: 3322 2.60 13.00 Overall Index: Overall Quick: Overall Rating:

Position	Code	Observation	Video (sec)	Grade
303-035				
.0	AMH	Manhole	10	NA
0.0	MWL	Water Level	21	NA
5.7	IS	Infil Stain	44	NA
6.4	TBI	Tap Break-in Intruding	57	M 2
18.4	TFC	Tap Factory Capped	94	NA
19.9	TFC	Tap Factory Capped	110	NA
65.9	FS	Fracture Spiral	214	S 3
65.9	IS	Infil Stain	225	NA
66.9	TBI	Tap Break-in Intruding	239	M 2
67.3	FL	Fracture Longitudinal	252	S 3
71.7	TFC	Tap Factory Capped	275	NA
73.5	TFC	Tap Factory Capped	294	NA
73.6	IS	Infil Stain	308	NA
89.8	OBB	Obstacle Brick	352	M 3
91.0	MSA	Abandoned Survey	366	NA

Code:

Description:



·	
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-303-035

AMH

Manhole



Code: MWL
Description: Water Level

Distance (ft): .0
Structural Grade: 0

O&M Grade: **0** 

Clock Start/From:

Clock To: 1st Value: 2nd Value:


Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

NO

Remarks:

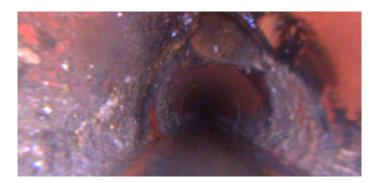


Code: IS

Description: Infil Stain

Distance (ft): 5.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 7
Clock To: 5
1st Value:
2nd Value:

Value Percent: Continuous Index: Within 8" of Joint:

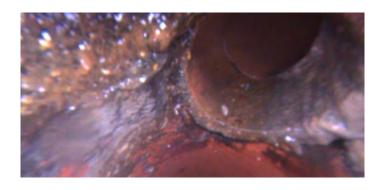

Code: TBI

Description: **Tap Break-in Intruding** 

Distance (ft): 6.4 Structural Grade: 0 2 O&M Grade: Clock Start/From: 1


Clock To:

1st Value: 4.000 2nd Value: 1.000

Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

active

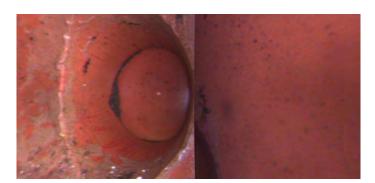

TFC Code:


Description: **Tap Factory Capped** 

Distance (ft): 18.4 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 9

Clock To:

1st Value: 4.000

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

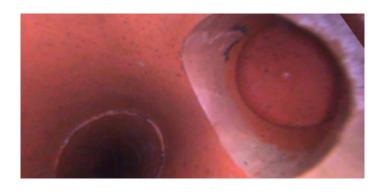

Code: **TFC** 

Description: Tap Factory Capped

4.000

Distance (ft): 19.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value:

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

Code: FS

Description: Fracture Spiral


3



Distance (ft): 65.9 Structural Grade: 3

O&M Grade: 0
Clock Start/From: 1

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

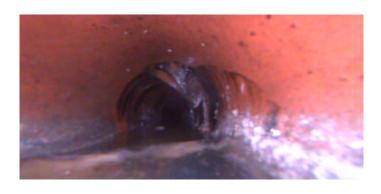

Code: IS

Description: Infil Stain

Distance (ft): 65.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 7
Clock To: 5

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: TBI

Description: Tap Break-in Intruding



Distance (ft): 66.9
Structural Grade: 0

O&M Grade: 2


Clock Start/From: 2

Clock To:

 1st Value:
 4.000

 2nd Value:
 1.000

Value Percent: Continuous Index: Within 8" of Joint:

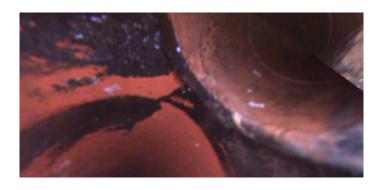

Code: FL

Description: Fracture Longitudinal

Distance (ft): 67.3
Structural Grade: 3
O&M Grade: 0
Clock Start/From: 12

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint:

Remarks:



Code: TFC

Description: Tap Factory Capped

Distance (ft): 71.7
Structural Grade: 0

O&M Grade: 0


Clock Start/From: 9

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

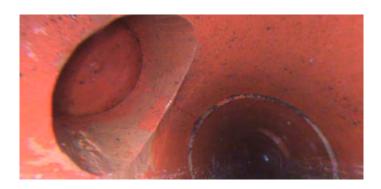

Code: TFC

Description: Tap Factory Capped


Distance (ft): 73.5
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

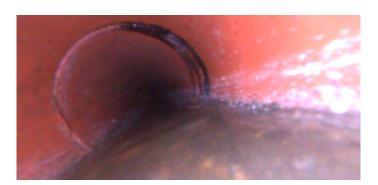


Code: IS

Description: Infil Stain

Distance (ft): 73.6
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 12
Clock To: 5
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: YES

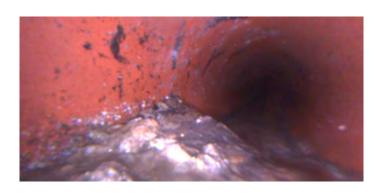

Code: OBB

Description: Obstacle Brick

Distance (ft): 89.8
Structural Grade: 0

O&M Grade: 3

Clock Start/From: 6

Clock To: 9

1st Value: 2nd Value:

Value Percent: 20.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: MSA

Description: Abandoned Survey

Distance (ft): 91.0
Structural Grade: 0
O&M Grade: 0
Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: camera stopped