Profile/Photo Observation Report



Date: 03/28/2018 Weather: **PACP 6.0** Coding: Pipe Length (ft): 280.1 Owner: NA Pre Clean: **Not Known** P.O.#: PSR: P-303-035-034 Surveyor: Selasie Honu

Customer: Clean Date: 01/01/1900 Shape: C

Street: W 38TH AVE Flow Control: Not Controlled
City: Hobart, IN Year Renewed:

Location: Other Tape/Media #:
Purpose: Not Known Dia/Height: 10"

Use: Sanitary Material: VCP

Drain Area: NA Lining: Category: NA

Comment:


Location Details: Direction of Survey: Upstream

US MH: M-303-034 DS MH: M-303-035 Total Length Surveyed (ft): 91.0

2.33 3122 7.00 O&M Index: O&M Quick: O&M Rating: 3.00 3200 6.00 Structural Quick: Structural Rating: Structural Index: 3322 2.60 13.00 Overall Quick: Overall Rating: Overall Index:

	Video (sec)	Observation	Code	Position
				35
NA	10	Manhole	AMH	.0
NA	21	Water Level	MWL	\.0
NA	44	Infil Stain	IS	5.7
M 2	57	Tap Break-in Intruding	TBI	6.4
NA	94	Tap Factory Capped	TFC	18.4
NA	110	Tap Factory Capped	TFC	19.9
S 3	214	Fracture Spiral	FS	65.9
NA	225	Infil Stain	IS	65.9
M 2	239	Tap Break-in Intruding	ТВІ	66.9
S 3	252	Fracture Longitudinal	FL	67.3
NA	275	Tap Factory Capped	TFC	71.7
NA	294	Tap Factory Capped	TFC	73.5
NA	308	Infil Stain	IS	73.6
M 3	352	Obstacle Brick	OBB	89.8
NA	366	Abandoned Survey	MSA	91.0
				34

Code:

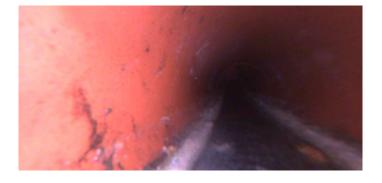

Description:	Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-303-035

AMH



Code: MWL Description: **Water Level**

Distance (ft): .0 Structural Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

O&M Grade:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO

0

Code: IS Description: **Infil Stain**


Distance (ft):


5.7

5

Structural Grade: 0 O&M Grade: 0 Clock Start/From: 7

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

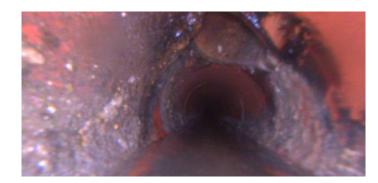

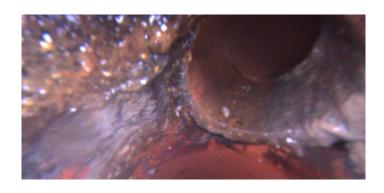

Code: TBI

Description: **Tap Break-in Intruding**


Distance (ft): 6.4 Structural Grade: 0 2 O&M Grade: Clock Start/From: 1

Clock To:

1st Value: 4.000 2nd Value: 1.000

Value Percent: Continuous Index: Within 8" of Joint:

Remarks: active

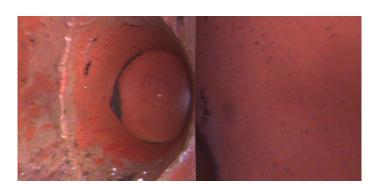

TFC Code:


Description: **Tap Factory Capped**

Distance (ft): 18.4 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 9

Clock To:

1st Value: 4.000

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

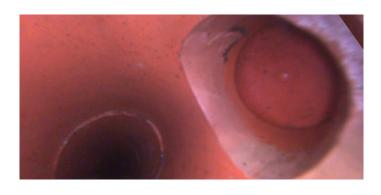

Code: **TFC**

Description: Tap Factory Capped

Distance (ft): 19.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value:

4.000

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:




Code: FS

Description: Fracture Spiral

Distance (ft): 65.9
Structural Grade: 3
O&M Grade: 0
Clock Start/From: 1
Clock To: 3
1st Value:
2nd Value:
Value Percent:

Remarks:

Continuous Index: Within 8" of Joint:

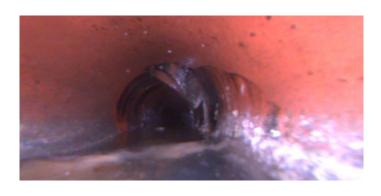

Code: IS

Description: Infil Stain

Distance (ft): 65.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 7
Clock To: 5

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: TBI

Description: Tap Break-in Intruding

Distance (ft): 66.9
Structural Grade: 0

O&M Grade: 2


Clock Start/From: 2

Clock To:

 1st Value:
 4.000

 2nd Value:
 1.000

Value Percent: Continuous Index: Within 8" of Joint:

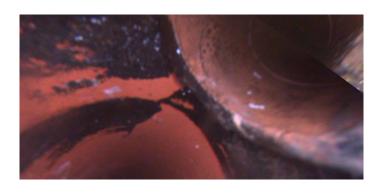

Code: FL

Description: Fracture Longitudinal

Distance (ft): 67.3
Structural Grade: 3
O&M Grade: 0
Clock Start/From: 12

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint:

Remarks:



Code: **TFC**

Description: Tap Factory Capped


Distance (ft): 71.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **4.000** 2nd Value:

Value Percent: Continuous Index:

Within 8" of Joint: NO

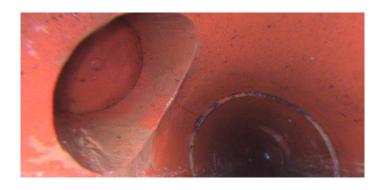

Code: TFC

Description: Tap Factory Capped


Distance (ft): 73.5
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

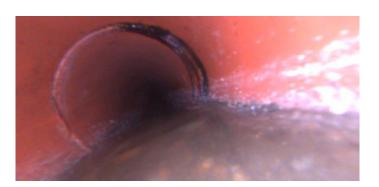


Code: IS

Description: Infil Stain

Distance (ft): 73.6
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 12
Clock To: 5
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: YES

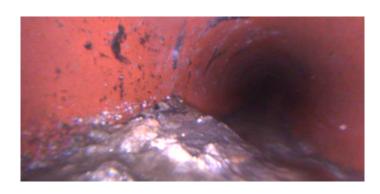

Code: OBB

Description: Obstacle Brick

Distance (ft): 89.8
Structural Grade: 0

O&M Grade: 3

Clock Start/From: 6

Clock To: 9

1st Value: 2nd Value:

Value Percent: 20.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: MSA

Description: Abandoned Survey

Distance (ft): 91.0
Structural Grade: 0
O&M Grade: 0
Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: camera stopped