

Profile/Photo Observation Report



Date:	10/24/2021	Weather:		Coding:	PACP 7.0
Pipe Length (ft):	167.3	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-404-008-007
Customer:	City of Hobart	Clean Date:	10/22/2021	Shape:	C


Street:	North Wabash Street	Flow Control:	Not Controlled
City:	Hobart, IN	Year Renewed:	
Location:	Alley	Tape/Media #:	
Purpose:	Routine Assessment	Dia/Height:	10"
Use:	Sanitary Sewage Pipe	Material:	VCP
Drain Area:		Lining:	None
Category:	NA		
Comment:			
Location Details:		Direction of Survey:	Downstream
US MH:	M-404-008	DS MH:	M-404-007
		Total Length Surveyed (ft):	167.3

O&M Index:	2.13	O&M Quick:	4231	O&M Rating:	85.00
Structural Index:	2.96	Structural Quick:	5148	Structural Rating:	83.00
Overall Index:	2.47	Overall Quick:	514A	Overall Rating:	168.00

	Position	Code	Observation	Video (sec)	Grade
	.0	AMH	Manhole	1	NA
	.0	MWL	Miscellaneous Water Level	68	NA
	.0	DSF(S01)	Deposits Settled Fine	76	M 2
	5.0	CM	Crack Multiple	143	S 3
	6.7	OBM	Obstruction Pipe Material in Invert	181	M 2
	11.0	FM	Fracture Multiple	233	S 4
	16.4	DSF(F01)	Deposits Settled Fine	262	M 2
	19.9	CM	Crack Multiple	328	S 3
	23.2	CL	Crack Longitudinal	362	S 2
	24.2	MWLS(S02)	Miscellaneous Water Level Sag	380	S 2
	24.2	DSF(S03)	Deposits Settled Fine	390	M 2
	26.0	CM	Crack Multiple	438	S 3
	32.2	CM	Crack Multiple	523	S 3
	37.6	MWLS(F02)	Miscellaneous Water Level Sag	566	S 2
	38.2	FM	Fracture Multiple	595	S 4
	38.2	SMW	Surface Damage Missing Wall	616	S 5
	39.4	TBI	Tap Break-in Intruding	638	M 2
	44.2	FM	Fracture Multiple	696	S 4
	47.7	B	Broken	762	S 4

48.2	TBI	Tap Break-in Intruding	786	M 2
48.2	IDC	Infiltration Dripper Connection	797	M 3
56.5	CM	Crack Multiple	914	S 3
71.8	SSS	Surface Damage Surface Spalling	1017	S 2
95.8	MWL	Miscellaneous Water Level	1115	NA
104.6	CM	Crack Multiple	1209	S 3
109.2	MWL	Miscellaneous Water Level	1285	NA
109.2	MCU	Miscellaneous Camera Underwater	1293	M 4
116.7	B	Broken	1489	S 4
116.7	IRB	Infiltration Runner Barrel	1500	M 4
117.3	TBI	Tap Break-in Intruding	1519	M 2
119.6	SSS	Surface Damage Surface Spalling	1559	S 2
119.6	FM	Fracture Multiple	1580	S 4
120.0	TBI	Tap Break-in Intruding	1595	M 2
122.7	CL	Crack Longitudinal	1638	S 2
125.6	FM	Fracture Multiple	1681	S 4
128.4	FL	Fracture Longitudinal	1732	S 3
128.4	MWL	Miscellaneous Water Level	1744	NA
131.9	CL	Crack Longitudinal	1781	S 2
141.0	CL	Crack Longitudinal	1842	S 2
141.0	SSS	Surface Damage Surface Spalling	1854	S 2
149.9	MWLS(S04)	Miscellaneous Water Level Sag	1918	S 2
152.9	B	Broken	1961	S 4
156.0	MWLS(F04)	Miscellaneous Water Level Sag	1989	S 2
164.6	DAE	Deposits Attached Encrustation	2036	M 2
165.0	CM	Crack Multiple	2062	S 3
166.2	DSF(F03)	Deposits Settled Fine	2086	M 2
167.3	AMH	Manhole	2150	NA

M-404-007

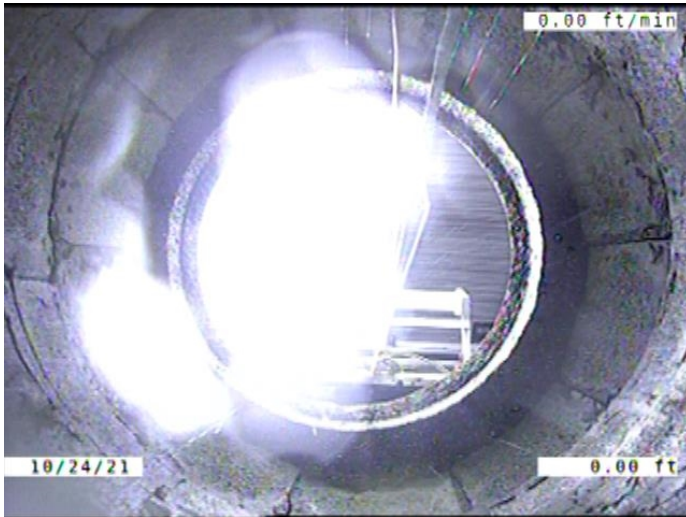

Code: **AMH**
Description: **Manhole**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **M-404-008**




Code: **MWL**
Description: **Miscellaneous Water Level**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:




Code: **DSF**
 Description: **Deposits Settled Fine**

Distance (ft): **.0**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **S01**
 Within 8" of Joint: **YES**
 Remarks:

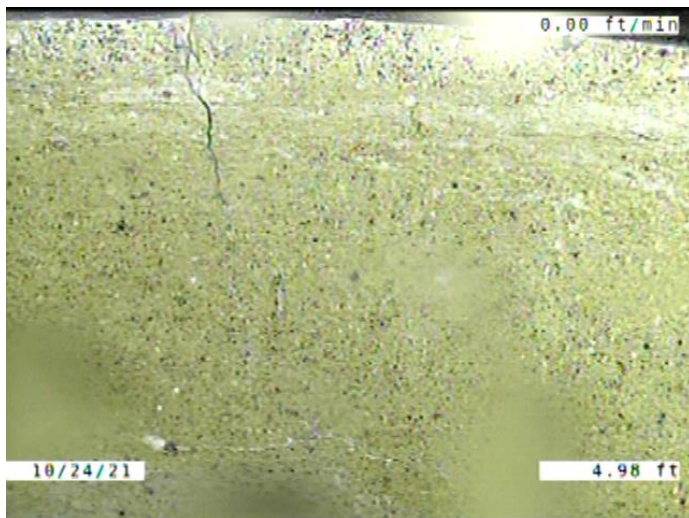


Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **5.0**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

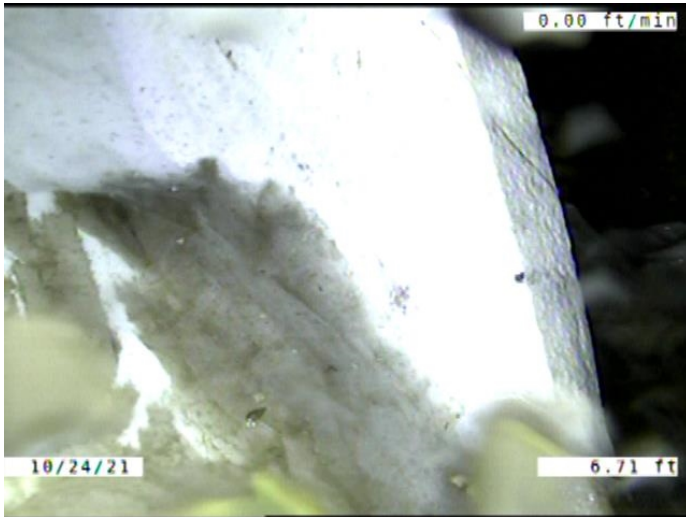


Code:	OBM
Description:	Obstruction Pipe Material in Invert
Distance (ft):	6.7
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	5
Clock To:	7
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

Code:	FM
Description:	Fracture Multiple
Distance (ft):	11.0
Structural Grade:	4
O&M Grade:	0
Clock Start/From:	9
Clock To:	11
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

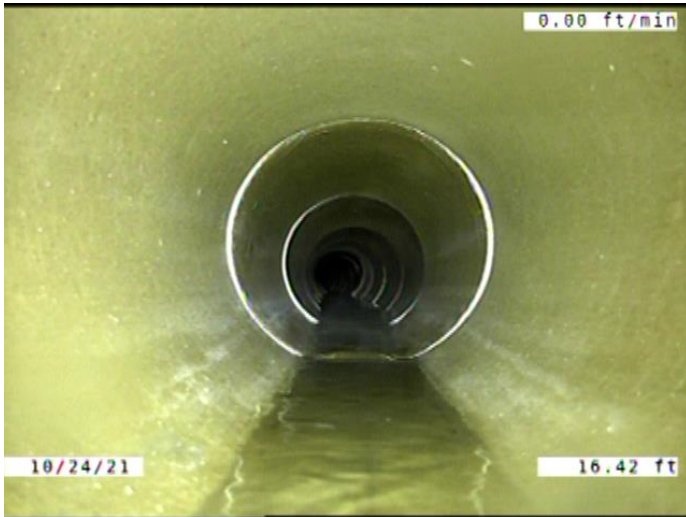


Code: **DSF**
Description: **Deposits Settled Fine**

Distance (ft): **16.4**
Structural Grade: **0**
O&M Grade: **2**
Clock Start/From: **5**
Clock To: **7**
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **F01**
Within 8" of Joint: **YES**
Remarks:

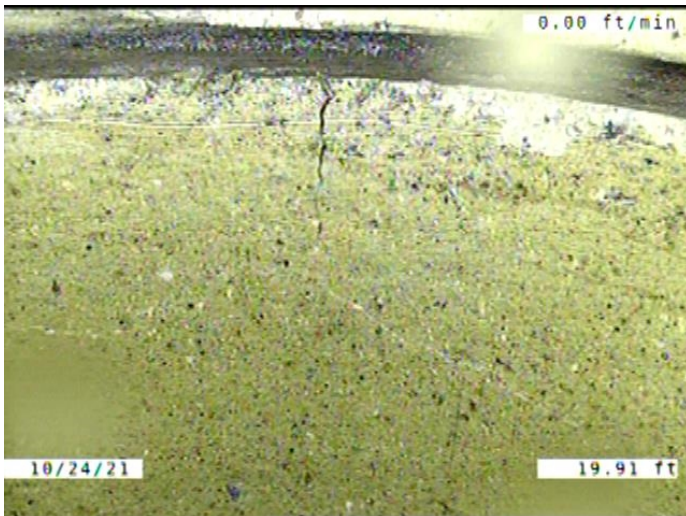

Code: **CM**
Description: **Crack Multiple**

Distance (ft): **19.9**
Structural Grade: **3**
O&M Grade: **0**
Clock Start/From: **10**
Clock To: **2**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

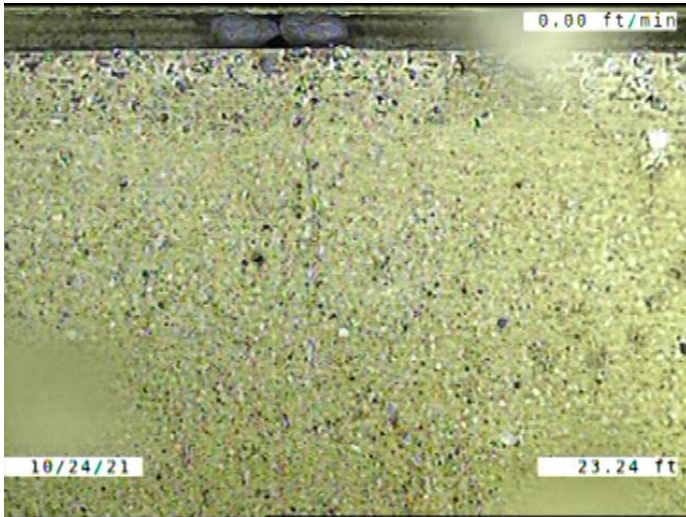

Code: **CL**
Description: **Crack Longitudinal**

Distance (ft): **23.2**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **2**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:




Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **24.2**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **S02**
Within 8" of Joint: **NO**
Remarks:




Code: **DSF**
 Description: **Deposits Settled Fine**

Distance (ft): **24.2**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **S03**
 Within 8" of Joint: **YES**
 Remarks:

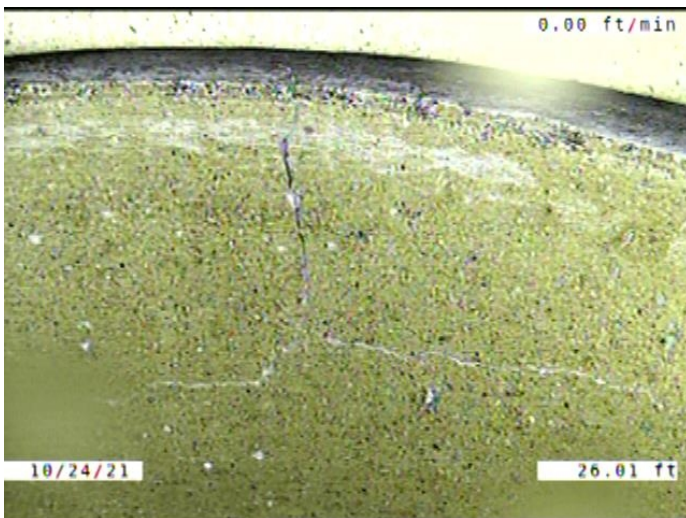


Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **26.0**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **10**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

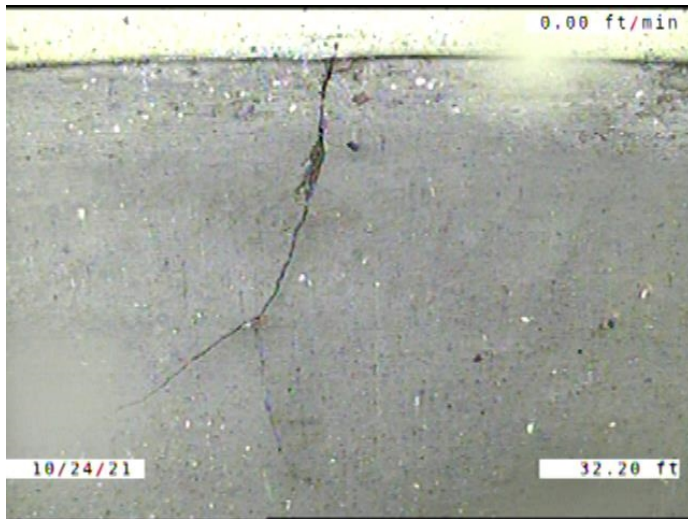


Code: **CM**
Description: **Crack Multiple**

Distance (ft): **32.2**
Structural Grade: **3**
O&M Grade: **0**
Clock Start/From: **9**
Clock To: **4**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

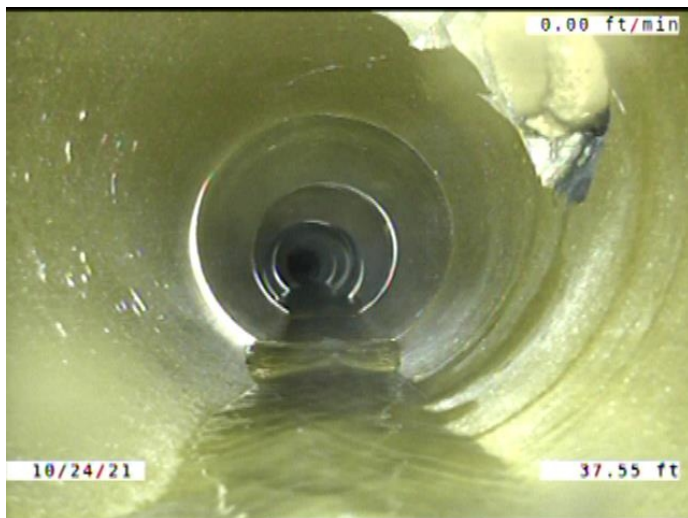


Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **37.6**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **F02**
Within 8" of Joint: **NO**
Remarks:

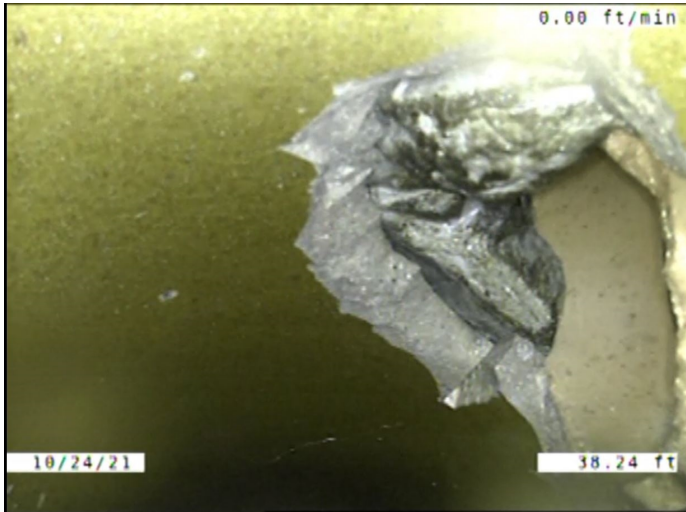


Code: **FM**
 Description: **Fracture Multiple**

Distance (ft): **38.2**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **12**
 Clock To: **2**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

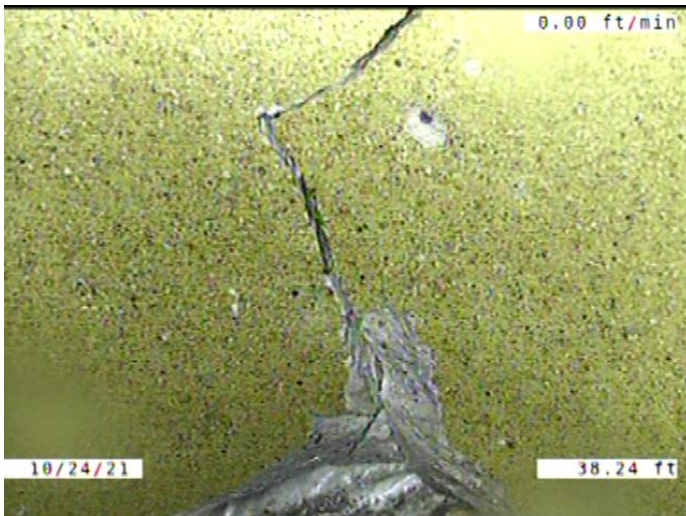


Code: **SMW**
 Description: **Surface Damage Missing Wall**

Distance (ft): **38.2**
 Structural Grade: **5**
 O&M Grade: **0**
 Clock Start/From: **11**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

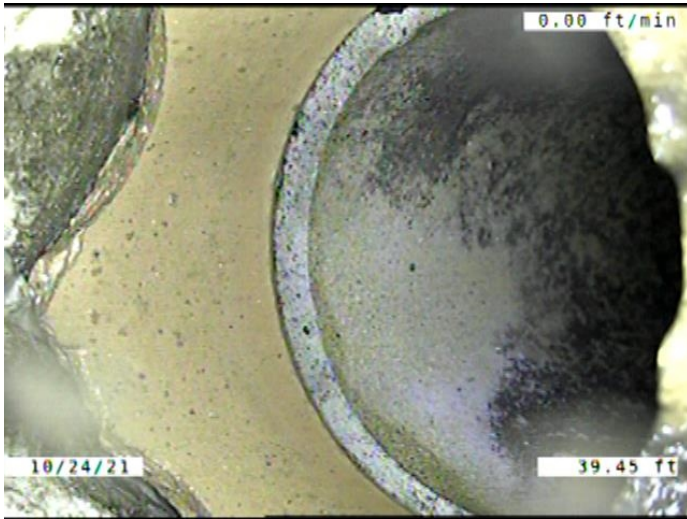


Code: **TBI**
 Description: **Tap Break-in Intruding**

Distance (ft): **39.4**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **1**
 Clock To:
 1st Value: **4.000**
 2nd Value: **1.000**
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

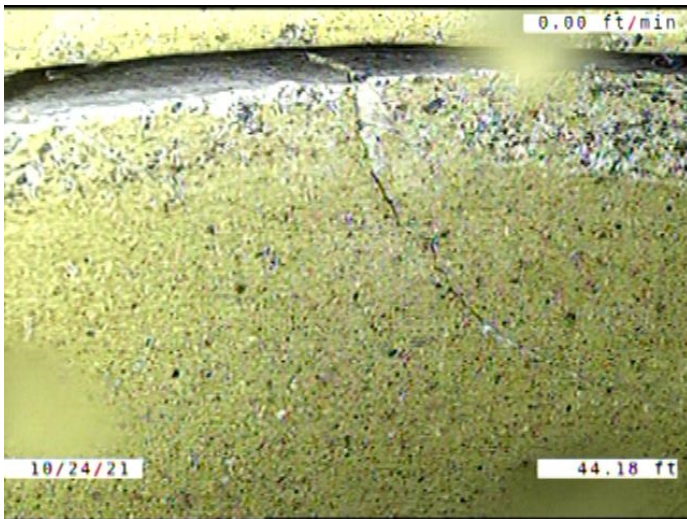


Code: **FM**
 Description: **Fracture Multiple**

Distance (ft): **44.2**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **9**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

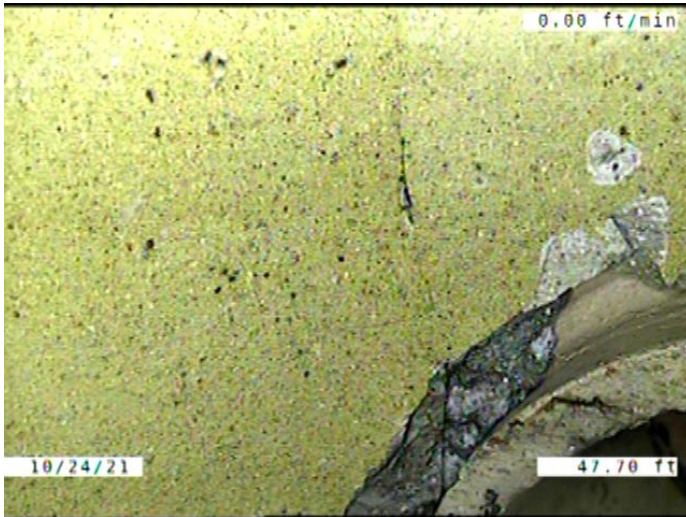


Code: **B**
 Description: **Broken**

Distance (ft): **47.7**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **11**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

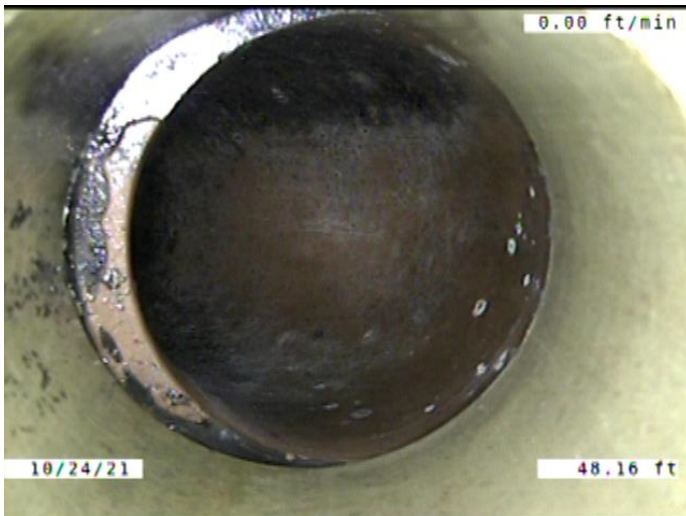


Code: **TBI**
 Description: **Tap Break-in Intruding**

Distance (ft): **48.2**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **12**
 Clock To:
 1st Value: **4.000**
 2nd Value: **1.000**
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

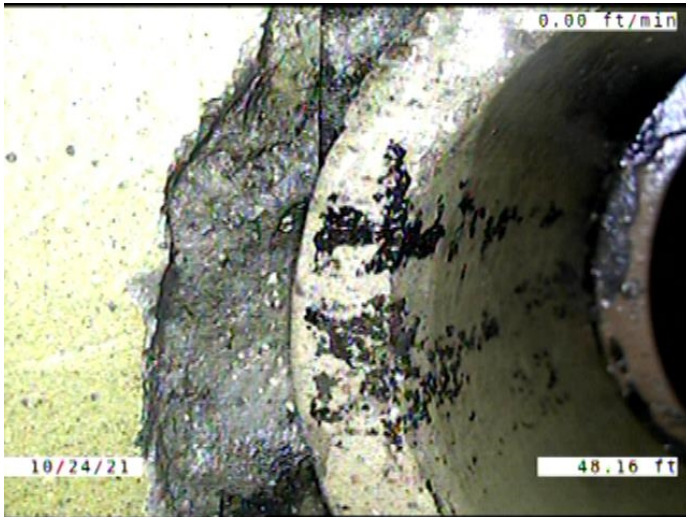


Code: **IDC**
 Description: **Infiltration Dripper Connection**

Distance (ft): **48.2**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **11**
 Clock To: **12**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

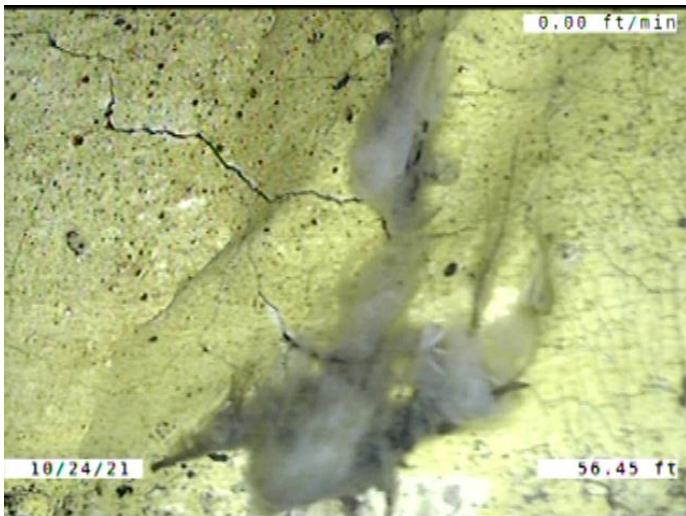

Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **56.5**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **5**
 Clock To: **11**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

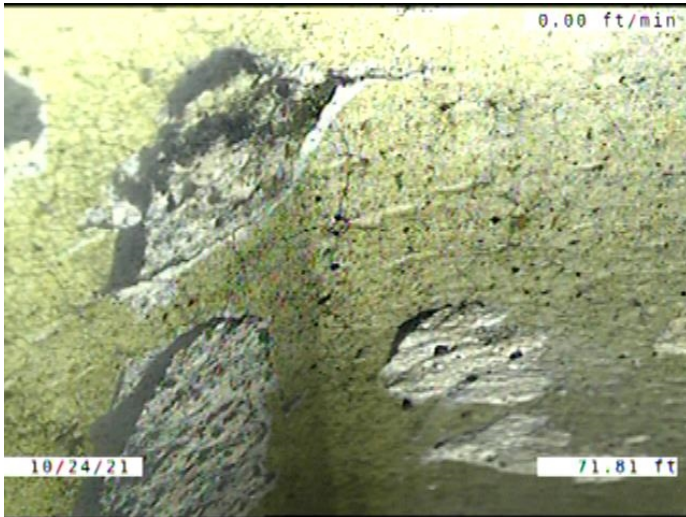


Code: **SSS**
 Description: **Surface Damage Surface Spalling**

Distance (ft): **71.8**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **12**
 Clock To: **12**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **MWL**
 Description: **Miscellaneous Water Level**

Distance (ft): **95.8**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

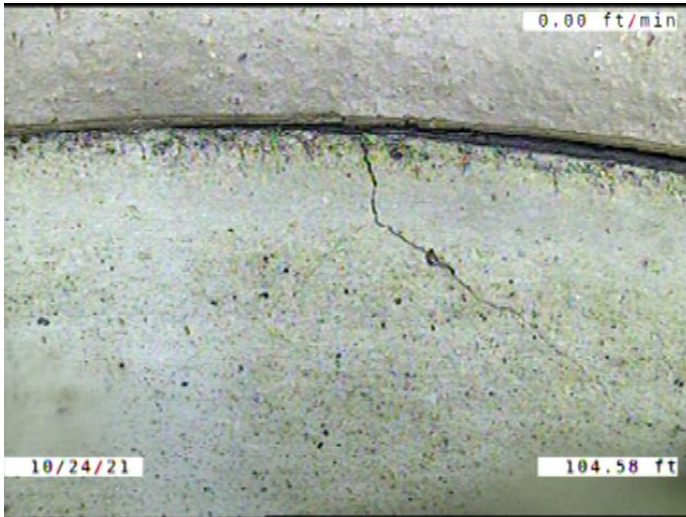


Code: **CM**
Description: **Crack Multiple**

Distance (ft): **104.6**
Structural Grade: **3**
O&M Grade: **0**
Clock Start/From: **11**
Clock To: **2**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

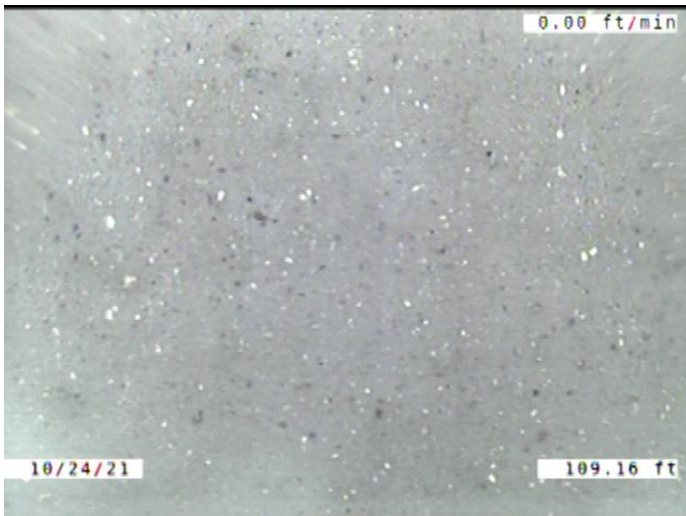

Code: **MWL**
Description: **Miscellaneous Water Level**

Distance (ft): **109.2**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **35.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:

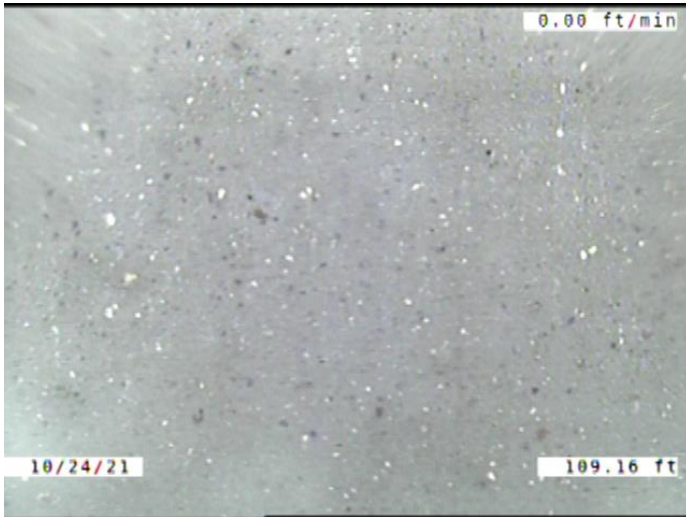


Code: **MCU**
Description: **Miscellaneous Camera Underwater**

Distance (ft): **109.2**
Structural Grade: **0**
O&M Grade: **4**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **Section retelevised from 97ft**




Code: **B**
Description: **Broken**

Distance (ft): **116.7**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **9**
Clock To: **2**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

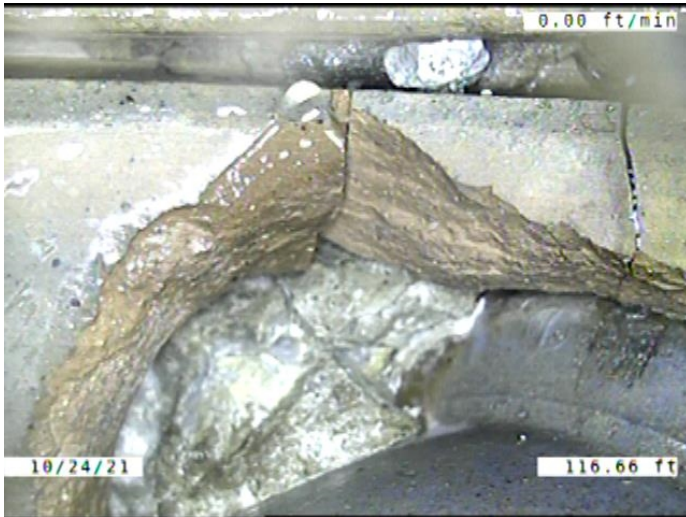


Code: **IRB**
 Description: **Infiltration Runner Barrel**

Distance (ft): **116.7**
 Structural Grade: **0**
 O&M Grade: **4**
 Clock Start/From: **12**
 Clock To: **2**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

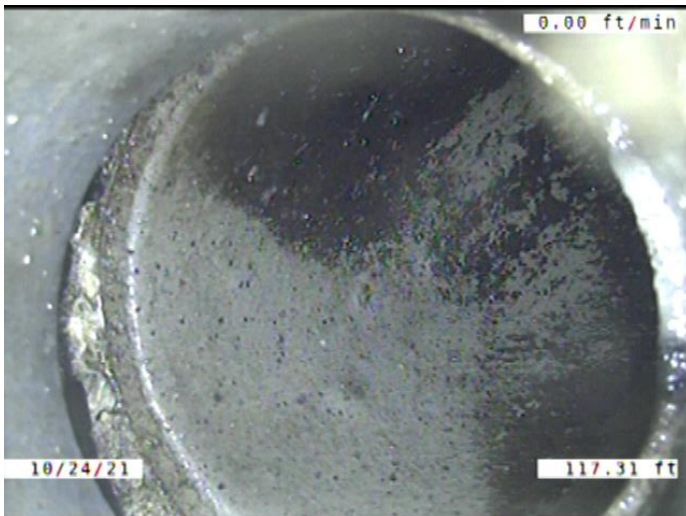

Code: **TBI**
 Description: **Tap Break-in Intruding**

Distance (ft): **117.3**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **1**
 Clock To:
 1st Value: **4.000**
 2nd Value: **2.000**
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

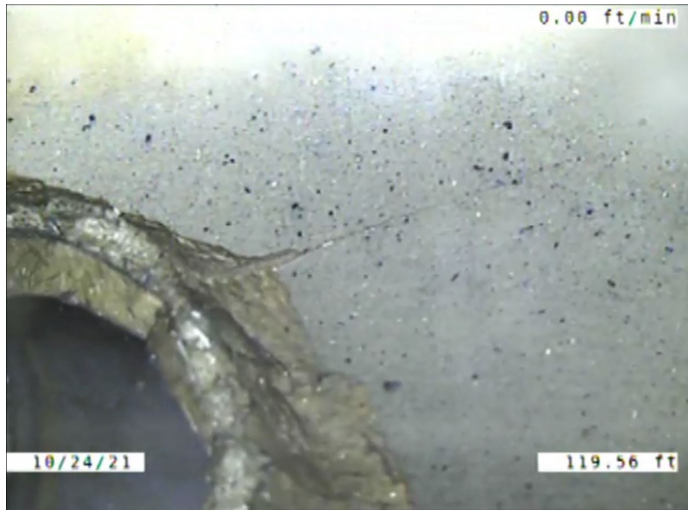


Code: **SSS**
Description: **Surface Damage Surface Spalling**

Distance (ft): **119.6**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **9**
Clock To: **1**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks:




Code: **FM**
Description: **Fracture Multiple**

Distance (ft): **119.6**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **9**
Clock To: **1**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

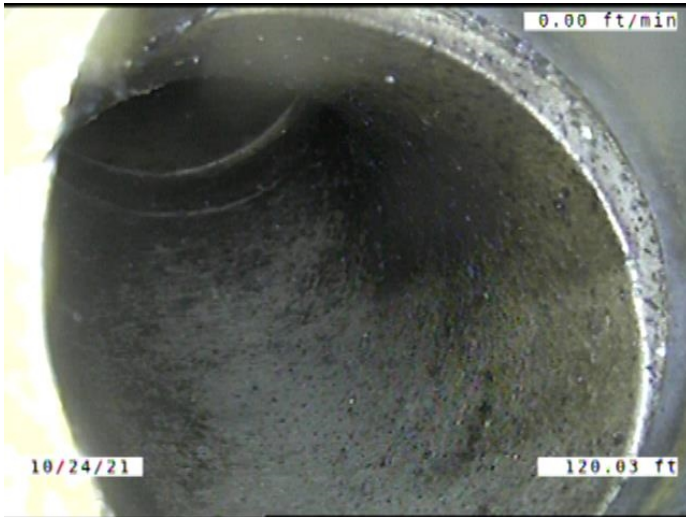


Code: **TBI**
Description: **Tap Break-in Intruding**

Distance (ft): **120.0**
Structural Grade: **0**
O&M Grade: **2**
Clock Start/From: **10**
Clock To:
1st Value: **4.000**
2nd Value: **1.000**
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **CONSTANTLY RUNNING WATER**

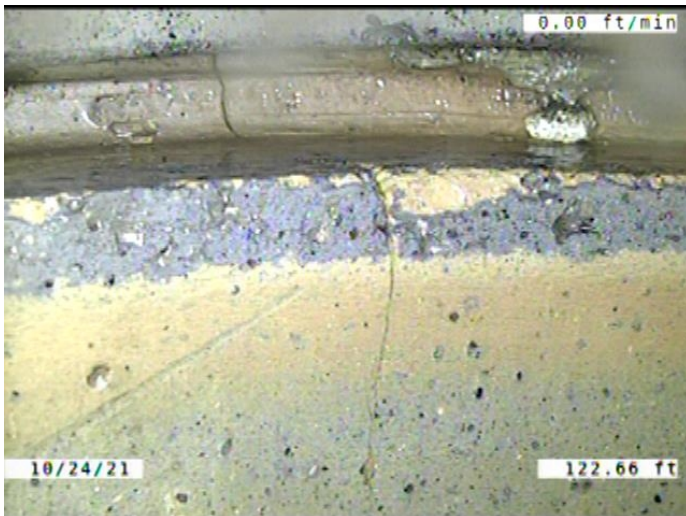


Code: **CL**
Description: **Crack Longitudinal**

Distance (ft): **122.7**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **10**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

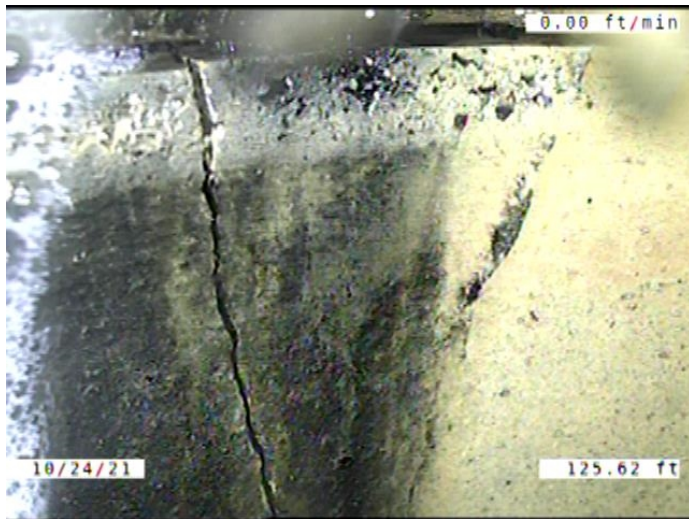


Code: **FM**
 Description: **Fracture Multiple**

Distance (ft): **125.6**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **8**
 Clock To: **10**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

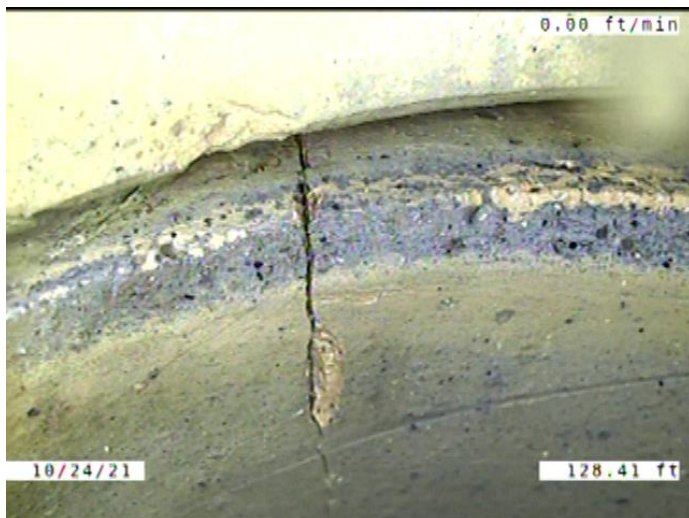


Code: **FL**
 Description: **Fracture Longitudinal**

Distance (ft): **128.4**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **8**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

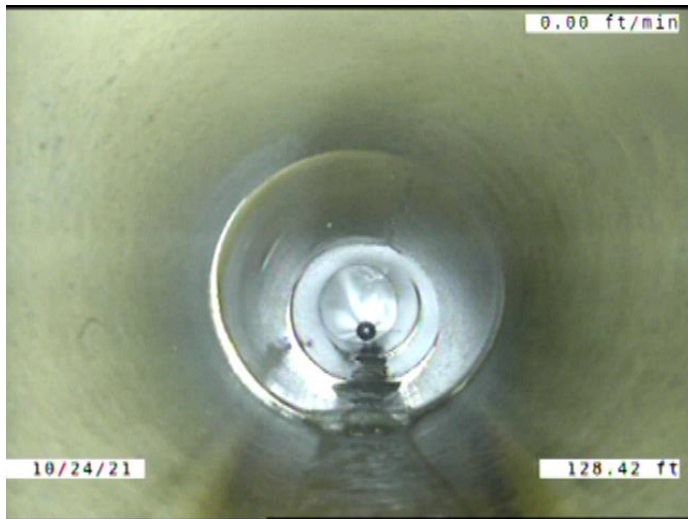


Code: **MWL**
Description: **Miscellaneous Water Level**

Distance (ft): **128.4**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:

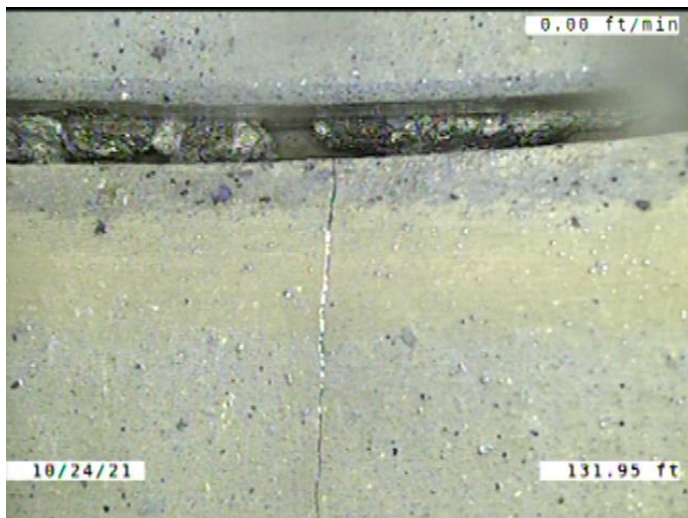


Code: **CL**
Description: **Crack Longitudinal**

Distance (ft): **131.9**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **2**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

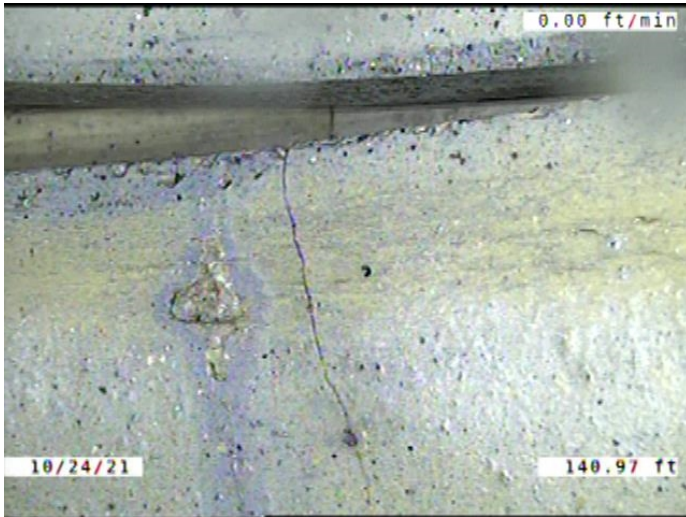


Code: **CL**
Description: **Crack Longitudinal**

Distance (ft): **141.0**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **2**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

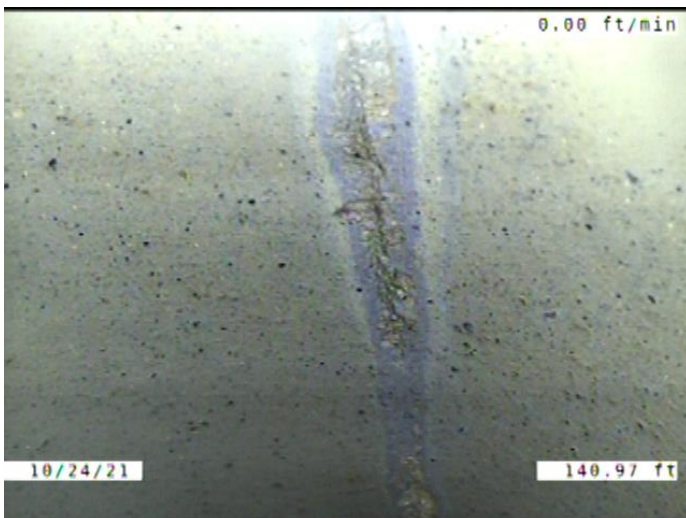


Code: **SSS**
Description: **Surface Damage Surface Spalling**

Distance (ft): **141.0**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **2**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

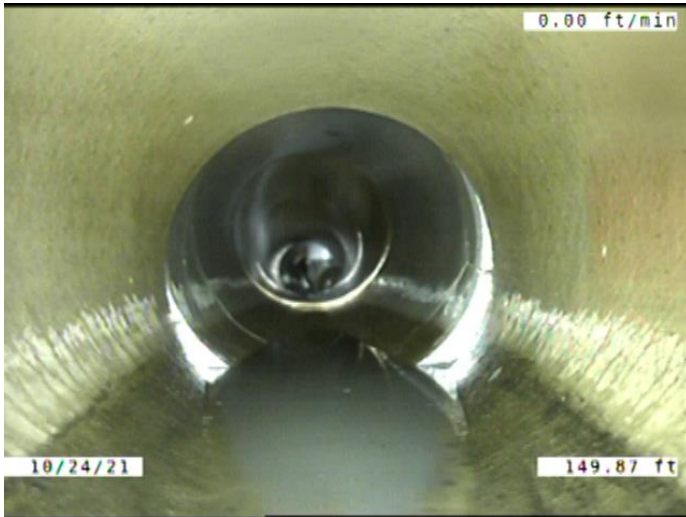


Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **149.9**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **10.000**
 Continuous Index: **S04**
 Within 8" of Joint: **NO**
 Remarks:

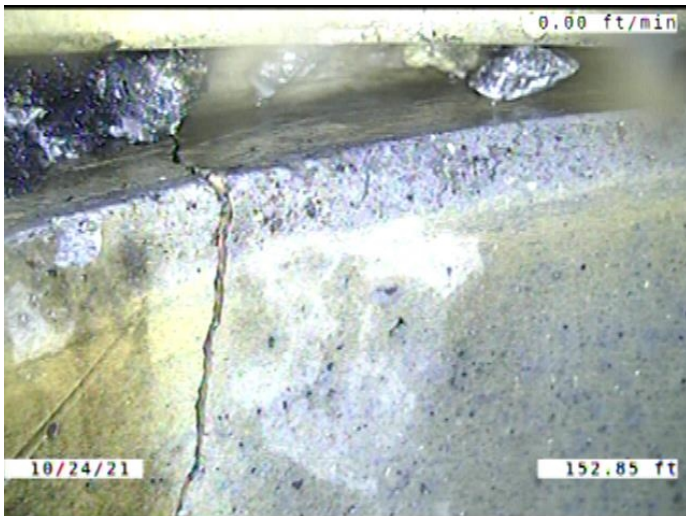

Code: **B**
 Description: **Broken**

Distance (ft): **152.9**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To: **9**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

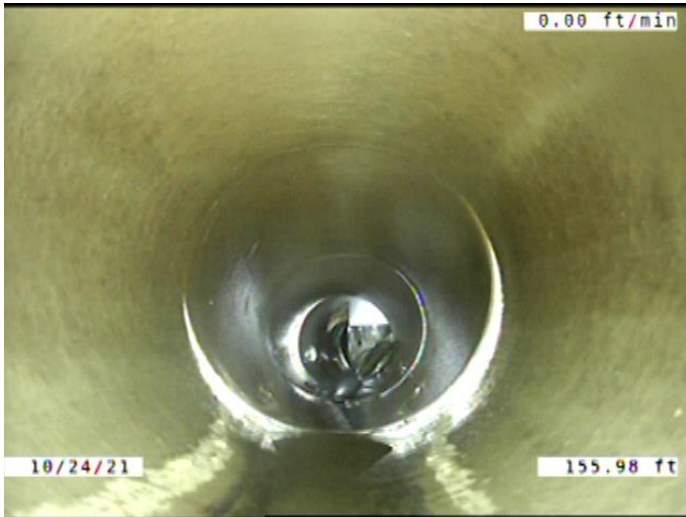


Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **156.0**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **10.000**
 Continuous Index: **F04**
 Within 8" of Joint: **NO**
 Remarks:




Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **164.6**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

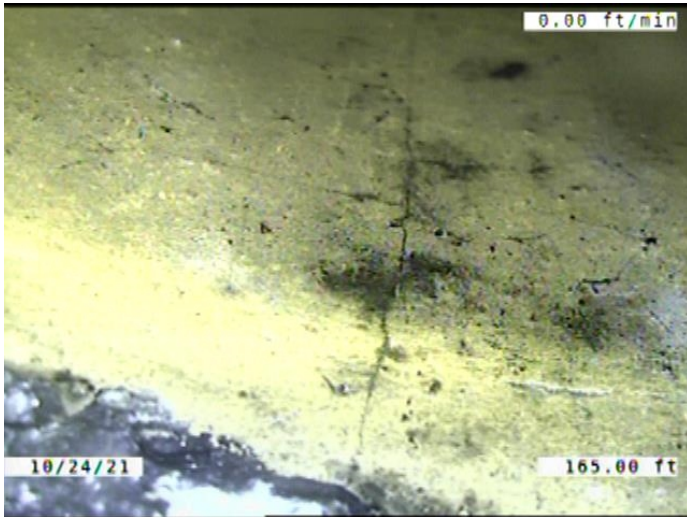


Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **165.0**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

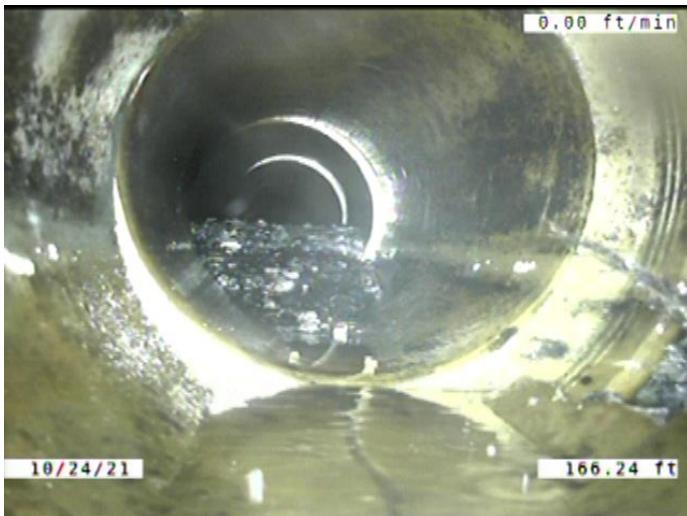

Code: **DSF**
 Description: **Deposits Settled Fine**

Distance (ft): **166.2**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **F03**
 Within 8" of Joint: **YES**
 Remarks:

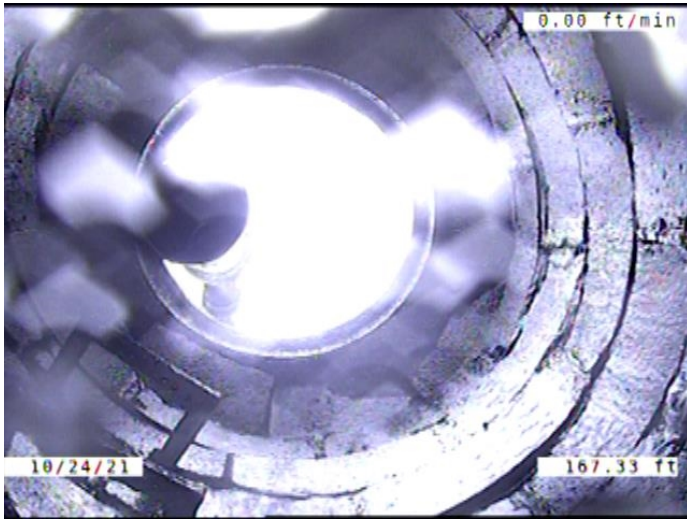

Code:	AMH
Description:	Manhole
Distance (ft):	167.3
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-404-007