## **Profile/Photo Observation Report**



Date:	10/24/2021	Weather:		Coding:	PACP 7.0
Pipe Length (ft):	159.8	Owner:	City of Hobart	Pre Clean:	<b>Heavy Cleaning</b>
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-404-010-009
Customer:	City of Hobart	Clean Date:	10/22/2021	Shape:	С

Street:	North Wabash Street	Flow Control:	Not Controlled

City: Hobart, IN Year Renewed:

Location: Local rural streets with light traffic, t Tape/Media #:
Purpose: Routine Assessment Dia/Height:

Purpose: Routine Assessment Dia/Height: 8"
Use: Sanitary Sewage Pipe Material: VCP
Drain Area: Lining: None

Category: NA


Comment:

Location Details: Direction of Survey: **Downstream** 


US MH: M-404-010 DS MH: M-404-009 Total Length Surveyed (ft): 159.8

O&M Index:	2.05	O&M Quick:	4231	O&M Rating:	82.00
Structural Index:	2.13	Structural Quick:	3127	Structural Rating:	17.00
Overall Index:	2.06	Overall Quick:	4232	Overall Rating:	99.00

	Position	Code	Observation	Video (sec)	Grade
104	-010				
	.0	АМН	Manhole	1	NA
Ш		MWL	Miscellaneous Water Level	52	NA
П	.3	CM	Crack Multiple	124	S 3
П	.3	DAE	Deposits Attached Encrustation	155	M 2
	5.7	DSF(S01)	Deposits Settled Fine	193	M 2
П	10.9	MWLS(S02)	Miscellaneous Water Level Sag	236	S 2
Ш	26.5	MWLS(F02)	Miscellaneous Water Level Sag	307	S 2
П	27.5	DAE	Deposits Attached Encrustation	366	M 2
Н	31.5	RFJ	Roots Fine Joint	423	M 1
П	35.5	ISJ	Infiltration Stain Joint	501	M 1
Н	35.5	IRJ	Infiltration Runner Joint	515	M 4
П	43.7	ISJ	Infiltration Stain Joint	600	M 1
Н	56.1	IDJ	Infiltration Dripper Joint	679	M 3
н	60.1	MWLS(S03)	Miscellaneous Water Level Sag	714	S 2
П	64.3	DAE	Deposits Attached Encrustation	786	M 2
П	64.3	IRJ	Infiltration Runner Joint	805	M 4
П	67.7	MWLS(F03)	Miscellaneous Water Level Sag	834	S 2
П	72.0	MWLS(S04)	Miscellaneous Water Level Sag	863	S 2
П	84.3	MWLS(F04)	Miscellaneous Water Level Sag	984	S 2
П	88.9	DAE	Deposits Attached Encrustation	1026	M 2
П	147.3	TF	Tap Factory	1320	NA
П	156.9	DSF(F01)	Deposits Settled Fine	1375	M 2
	159.8	AMH	Manhole	1474	NA

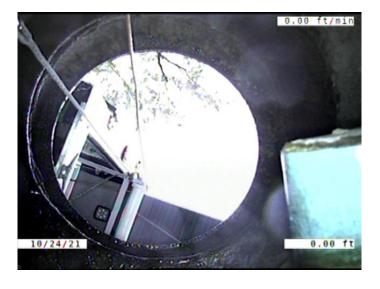

Code:	AMH
Description:	Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-404-010

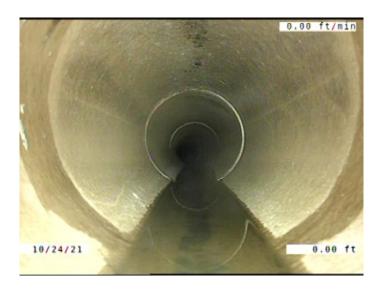

Code: MWL Description: **Miscellaneous Water Level** 

5.000

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To:

1st Value: 2nd Value: Value Percent:

Continuous Index: Within 8" of Joint: NO

Remarks:

0.00 ft/min 19/24/21 0.32 ft

Code: CM Description: **Crack Multiple** 

Distance (ft): .3 Structural Grade: 3 O&M Grade: 0 Clock Start/From: 12 Clock To: 12 1st Value: 2nd Value: Value Percent:

Continuous Index: Within 8" of Joint:

YES

Remarks:



Code: DAE Description: **Deposits Attached Encrustation** 

Distance (ft): .3 Structural Grade: 0 2 O&M Grade: Clock Start/From: 9 Clock To: 3 1st Value:

2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: YES

Remarks:



DSF Code:

Description: **Deposits Settled Fine** 

5.7 Distance (ft): Structural Grade: 0 O&M Grade: 2 Clock Start/From: 5 7 Clock To: 1st Value:

Value Percent: 5.000 Continuous Index: **S01** Within 8" of Joint: YES

Remarks:

2nd Value:



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 10.9
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: S02
Within 8" of Joint: NO

Remarks:



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 26.5
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: F02
Within 8" of Joint: NO

Remarks:

...........



Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 27.5
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 9
Clock To: 3

1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: RFJ

Description: Roots Fine Joint

Distance (ft): 31.5
Structural Grade: 0
O&M Grade: 1
Clock Start/From: 9
Clock To: 3
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: YES

Remarks:



Code: ISJ

Description: **Infiltration Stain Joint** 

Distance (ft): 35.5 Structural Grade: 0 O&M Grade: 1 Clock Start/From: 9 Clock To: 3

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:



Code: IRJ


Description: **Infiltration Runner Joint** 

Distance (ft): 35.5 Structural Grade: 0 O&M Grade: Clock Start/From: 11

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:

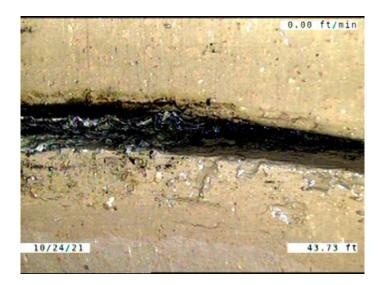

Code: ISJ

Description: Infiltration Stain Joint

Distance (ft): 43.7
Structural Grade: 0

O&M Grade: 1

Clock Start/From: 9


Clock To: 3

1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint:

Remarks:

YES

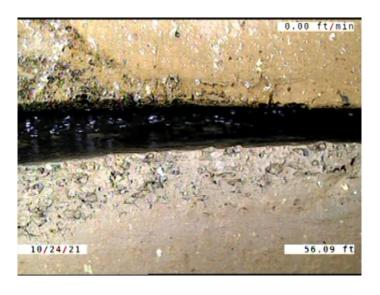

Code: IDJ

Description: Infiltration Dripper Joint


Distance (ft): 56.1
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 10
Clock To:

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:

5 01 JOHNE.

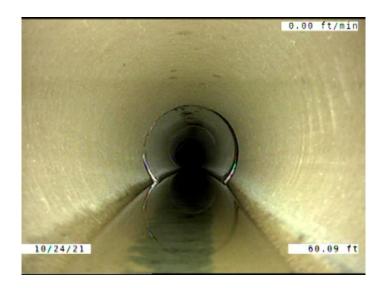

Code: **MWLS** 

Description: **Miscellaneous Water Level Sag** 


Distance (ft): 60.1 Structural Grade: 2 0 O&M Grade:

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000 Continuous Index: **S03** Within 8" of Joint: NO

Remarks:

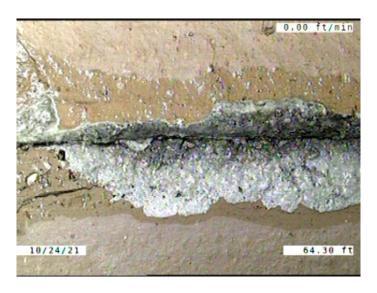

Code: DAE

Description: **Deposits Attached Encrustation** 

Distance (ft): 64.3 Structural Grade: 0 O&M Grade: 2 Clock Start/From: 10 Clock To: 11 1st Value:

Value Percent:


Continuous Index:

Within 8" of Joint: YES

Remarks:

2nd Value:

5.000

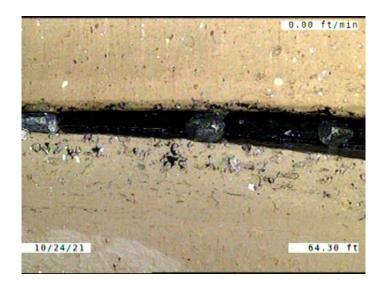

Code: IRJ

Description: Infiltration Runner Joint

Distance (ft): 64.3
Structural Grade: 0

O&M Grade: 4

Clock Start/From: 1

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 67.7
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: F03
Within 8" of Joint: NO

Remarks:



Code: **MWLS** 

Description: **Miscellaneous Water Level Sag** 


Distance (ft): 72.0 Structural Grade: 2 0 O&M Grade:

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000 Continuous Index: **S04** Within 8" of Joint: NO

Remarks:

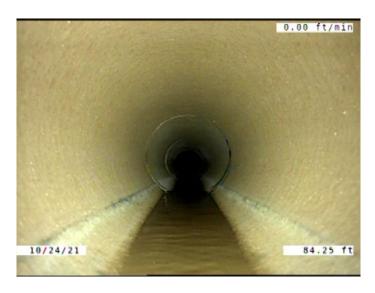

Code: **MWLS** 

Description: **Miscellaneous Water Level Sag** 


Distance (ft): 84.3 Structural Grade: 2 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000 Continuous Index: F04 Within 8" of Joint: NO

Remarks:

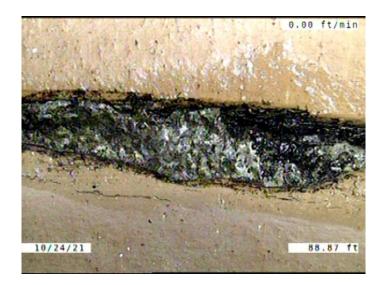

Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 88.9
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 12
Clock To: 3


1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: YES

Remarks:

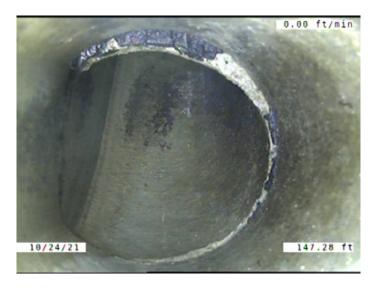

Code: TF

Description: Tap Factory

Distance (ft): 147.3
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:



Code: **DSF** 


Description: Deposits Settled Fine

Distance (ft): 156.9
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 5
Clock To: 7

1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: F01
Within 8" of Joint: YES

Remarks:

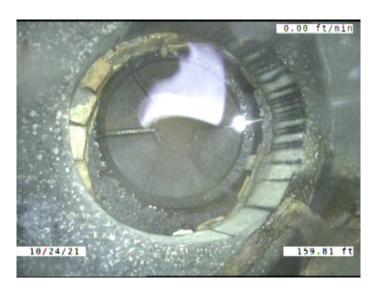

Code: AMH
Description: Manhole

Distance (ft): 159.8
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: M-404-009