
Date: Pipe Length (ft	<b>04/08/2018</b>	Weather: Owner:	City of Ho	hart	Coding: Pre Clean:	PACP 6.0 No Pre-Cleaning
P.O.#:	19-1	Surveyor:	M. Pielach		PSR:	M-404-025-M-404-014
Customer:	City of Hobart	Clean Date:			Shape:	C
Street:	Old Ridge Road		Flow Contro	ol:	Not Controlled	
City:	Hobart, IN		Year Renew	ved:		
Location:	Light Highway		Tape/Media	a #:	<b>DEP 19</b>	
Purpose:	Routine Assessment	:	Dia/Height:		18"	
Use:	Sanitary		Material:		VCP	
Drain Area:			Lining:			
Category:	NA					
Comment:						
Location Detai	ls:		Direction of	f Survey:	Downstream	
US MH:	M-404-025	DS MH:	M-404-014	Т	otal Length Surveyed (ft)	: <b>339.7</b>
&M Index:	2.36	O&M Quick:		3427	O&M Rating:	26.00
tructural Index	0.00	Structural Qu	uick:	0000	Structural Rating:	0.00
Overall Index:	2.36	Overall Quick		3427	Overall Rating:	26.00

	Position	Code	Observation	Video (sec)	Grade
1 404	-025				
$\mathbf{i}$	0. /	AMH	Manhole	0	NA
	.0	MWL	Water Level	11	NA
	65.8	DAE	Deposits Attached Encrustation	112	M 2
	91.6	ID	Infil Dripper	189	M 3
	_/ / 101.6	DAE	Deposits Attached Encrustation	218	M 2
	//121.9	DAE(S01)	Deposits Attached Encrustation	259	M 2
- 88	_///130.2	DAE(F01)	Deposits Attached Encrustation	282	M 2
11	_///155.7	ТВА	Tap Break-in Active	315	NA
-	_// 164.2	TFC	Tap Factory Capped	339	NA
5	_/ // 216.5	ID	Infil Dripper	407	M 3
	// 231.6	ID	Infil Dripper	439	M 3
	_/ 231.6	DAE	Deposits Attached Encrustation	447	M 2
Lamera Direction	264.0	ТВ	Tap Break-in	497	NA
	275.6	ID	Infil Dripper	521	M 3
	280.5	DAE	Deposits Attached Encrustation	535	M 2
	-////321.0	DAE	Deposits Attached Encrustation	596	M 2
		AMH	Manhole	640	NA
	-/				

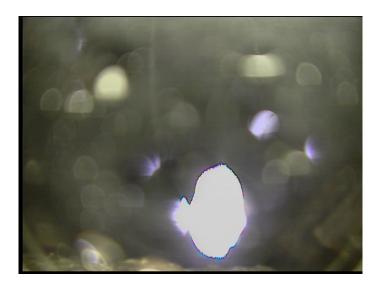

Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-404-025

Thursday, May 4, 2023

M(404)014



Code:	MWL
Description:	Water Level
Distance (ft):	.0
Structural Grade:	0
	•
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	20.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	65.8 0 2 12 5 5.000 YES



Code:	ID
Description:	Infil Dripper
Distance (ft):	91.6
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	1
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:	101.6 0 2 7 5 5.000 YES
Remarks:	



Code:	DAE
Description:	Deposits Attached Encrustation

Distance (ft):	121.9
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	5
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S01
Within 8" of Joint:	YES
Remarks:	



Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:	130.2 0 2 7 5 5.000 F01 NO
Remarks:	




Code: Description:	TBA Tap Break-in Active
Distance (ft):	155.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	12
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Code: Description:	TFC Tap Factory Capped
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	164.2 0 0 11 4.000 NO



Code:	ID
Description:	Infil Dripper
Distance (ft):	216.5
	210.5
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	1
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

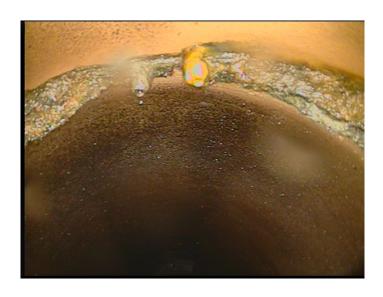

Code: Description:	ID Infil Dripper
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:	231.6 0 3 12
Within 8" of Joint: Remarks:	YES

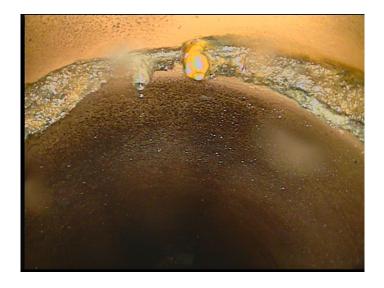

Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	231.6
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	5
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES

Remarks:



Code: Description:	TB Tap Break-in
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:	264.0 0 0 10 4.000
Within 8" of Joint: Remarks:	ΝΟ



Code:	ID
Description:	Infil Dripper
Distance (ft):	275.6
Distance (ft):	2/5.0
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	1
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Distance (ft):280.5Structural Grade:0O&M Grade:2Clock Start/From:7Clock To:111st Value:	Code: Description:	DAE Deposits Attached Encrustation
Nethanks.	Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:	0 2 7 11 10.000



Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	321.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	10
1st Value:	
2nd Value:	


10.000

YES

Value Percent: Continuous Index:

Remarks:

Within 8" of Joint:

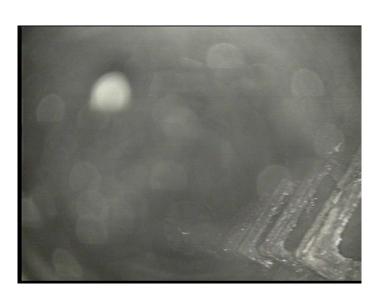

Code: Description:	AMH Manhole
Distance (ft):	339.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-404-014