
Date:	04/15/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft)	: 218.3	Owner:	NA	Pre Clean:	No Pre-Cleaning
P.O.#:		Surveyor:	Selasie Honu	PSR:	P-405-004-006
Customer:		Clean Date:	01/01/1900	Shape:	С
Street:	S WABASH ST		Flow Control:	Not Controlle	d
City:	Hobart, IN		Year Renewed:		
Location:	Yard		Tape/Media #:		
Purpose:	Routine Assessment	t	Dia/Height:	12"	
Use:	Sanitary		Material:	VCP	
Drain Area:	NA		Lining:	Cured in Place	2
Category:	NA				
Comment:	Flow direction is ma	arked wrong.			
Location Detail	s:		Direction of Surv	vey: Upstream	
US MH:	M-405-006	DS MH:	M-405-004	Total Length Surveyed (f	t): 76.2
D&M Index:	4.00	O&M Quick:	4A0	0 O&M Rating:	56.00
Structural Index:	0.00	 Structural Qu	uick: 000		. 0.00
Overall Index:	4.00	Overall Quick			56.00





Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-405-004

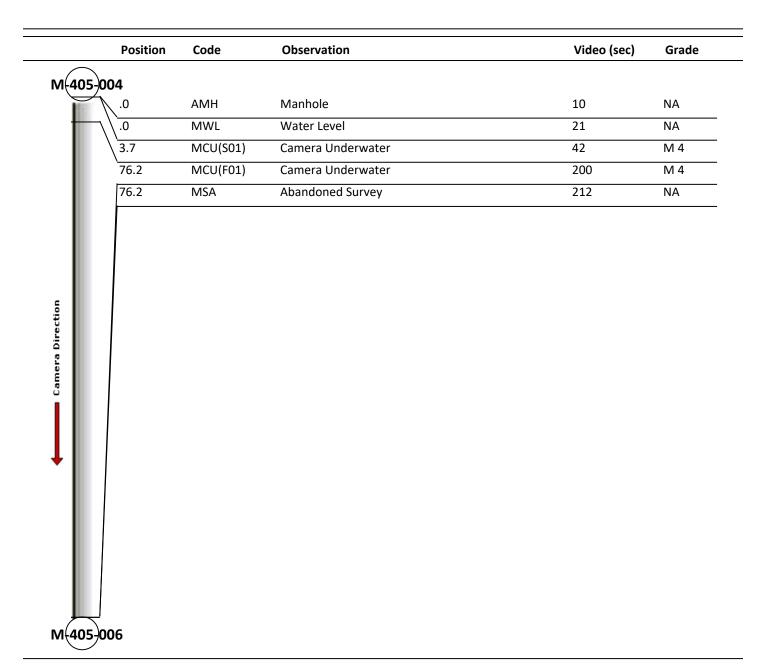

Code: MWL Description: Water Level

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: 5.000 Continuous Index: Within 8" of Joint: NO Remarks:



Code: Description:	MCU Camera Underwater
Distance (ft):	3.7
Structural Grade:	0
O&M Grade:	4
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	S01
Within 8" of Joint:	NO

Remarks:



Code:MCUDescription:Camera Underwater

Distance (ft):	76.2
Structural Grade:	0
O&M Grade:	4
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	F01
Within 8" of Joint:	NO
Remarks:	

Code:	
Description:	

MSA Abandoned Survey

Distance (ft):	76.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	mcu