


Profile/Ph	oto Observation	Report			RedZone
Date:	04/24/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft	): <b>262.5</b>	Owner:	NA	Pre Clean:	No Pre-Cleaning
P.O.#:		Surveyor:	Jen Costello	PSR:	P-405-022-021
Customer:		Clean Date:	01/01/1900	Shape:	С
Street:	FOXCROFT STREET		Flow Control:	Not Controlled	
City:	Hobart, IN		Year Renewed:		
Location:	Yard		Tape/Media #:		
Purpose:	Routine Assessmen	t	Dia/Height:	12"	
Use:	Sanitary		Material:	PVC	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:	P_C at 11 ft roots				
Location Detail	ls:		Direction of Survey	: Upstream	
US MH:	M-405-022	DS MH:	M-405-021	Total Length Surveyed (ft)	12.5
0&M Index:	2.50	O&M Quick:	3121	O&M Rating:	5.00
tructural Index:	1.00	Structural Quid	ck: 1100	Structural Rating:	1.00
Verall Index:	2.00	Overall Quick:	3121	Overall Rating:	6.00

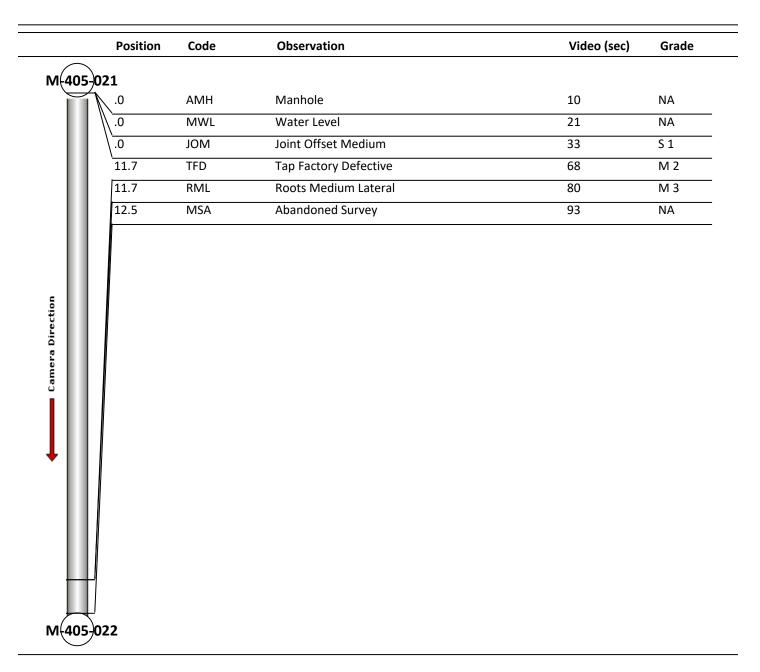

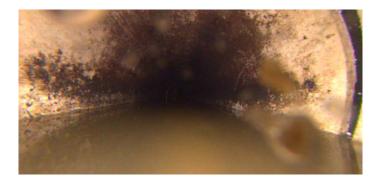

Code:	АМН
Description:	Manhole
Distance (ft):	.0
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-405-021

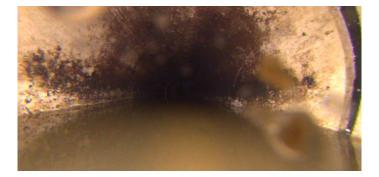

Code: MWL Description: Water Level

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: 30.000 Continuous Index: Within 8" of Joint: NO Remarks:


Code:



Description:	Joint Offset Medium	
Distance (ft):	.0	
Structural Grade:	1	
O&M Grade:	0	
Clock Start/From:		
Clock To:		
1st Value:		
2nd Value:		
Value Percent:		
Continuous Index:		
Within 8" of Joint:	NO	
Remarks:		

JOM

Tuesday, December 8, 2020

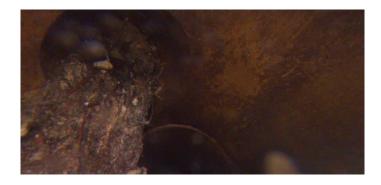

Code:TFDDescription:Tap Factory Defective


Distance (ft):	11.7
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	11
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	rml



Code:	RML	
Description:	<b>Roots Medium Lateral</b>	

....

Distance (ft):	11.7
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	8
Clock To:	11
1st Value:	
2nd Value:	
Value Percent:	30.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

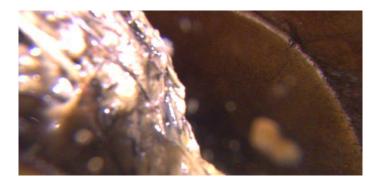

Code: MSA Description: Aba

MSA Abandoned Survey

Distance (ft):	12.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	roots