

Profile/Photo Observation Report



Date:	10/19/2021	Weather:		Coding:	PACP 7.0
Pipe Length (ft):	167.1	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-503-016-009
Customer:	City of Hobart	Clean Date:	09/06/2021	Shape:	C


Street:	West 39th Place	Flow Control:	Not Controlled
City:	Hobart, IN	Year Renewed:	
Location:	Alley	Tape/Media #:	
Purpose:	Routine Assessment	Dia/Height:	12"
Use:	Sanitary Sewage Pipe	Material:	VCP
Drain Area:		Lining:	
Category:	NA		
Comment:			
Location Details:		Direction of Survey:	Downstream
US MH:	M-503-009	DS MH:	M-503-016
		Total Length Surveyed (ft):	167.1

O&M Index:	2.04	O&M Quick:	322H	O&M Rating:	96.00
Structural Index:	2.70	Structural Quick:	5345	Structural Rating:	100.00
Overall Index:	2.33	Overall Quick:	5345	Overall Rating:	196.00

Position	Code	Observation	Video (sec)	Grade
.0	AMH	Manhole	1	NA
.0	MWL	Miscellaneous Water Level	63	NA
.0	DSF(S01)	Deposits Settled Fine	72	M 2
6.3	DAE(S02)	Deposits Attached Encrustation	127	M 2
12.6	MWLS	Miscellaneous Water Level Sag	195	S 2
14.4	FM	Fracture Multiple	243	S 4
18.5	SZ	Surface Damage Other	281	NA
20.1	FM	Fracture Multiple	312	S 4
20.1	B	Broken	342	S 4
20.1	SMW	Surface Damage Missing Wall	353	S 5
30.9	CM	Crack Multiple	438	S 3
37.1	FM	Fracture Multiple	541	S 4
39.1	MWLS(S04)	Miscellaneous Water Level Sag	568	S 2
41.2	BVV	Broken Void Visible	612	S 5
47.3	HVV	Hole Void Visible	704	S 5
53.8	DAE(F02)	Deposits Attached Encrustation	754	M 2
57.5	MWLS(F04)	Miscellaneous Water Level Sag	778	S 2
64.8	TFD	Tap Factory Defective	825	M 3
73.2	JOM	Joint Offset Medium	877	S 3


74.8	MWLS(S05)	Miscellaneous Water Level Sag	900	S 2
84.7	SSS	Surface Damage Surface Spalling	950	S 2
84.7	B	Broken	962	S 4
87.1	TFC	Tap Factory Capped	980	NA
88.8	CL	Crack Longitudinal	1006	S 2
98.2	DAE	Deposits Attached Encrustation	1061	M 2
104.8	FL	Fracture Longitudinal	1101	S 3
109.0	MWLS(F05)	Miscellaneous Water Level Sag	1121	S 2
113.3	CL	Crack Longitudinal	1146	S 2
113.6	MWLS(S06)	Miscellaneous Water Level Sag	1151	S 2
116.6	DAE	Deposits Attached Encrustation	1200	M 2
129.0	CM	Crack Multiple	1283	S 3
129.7	TFC	Tap Factory Capped	1293	NA
132.2	TFD	Tap Factory Defective	1330	M 3
136.4	CM(S07)	Crack Multiple	1400	S 3
142.9	SSS	Surface Damage Surface Spalling	1443	S 2
142.9	MWLS(F06)	Miscellaneous Water Level Sag	1470	S 2
153.7	CM(F07)	Crack Multiple	1517	S 3
157.7	MMC	Miscellaneous Material Change	1570	NA
164.0	MMC	Miscellaneous Material Change	1639	NA
165.5	DSF(F01)	Deposits Settled Fine	1666	M 2
167.1	AMH	Manhole	0	NA

M-503-016

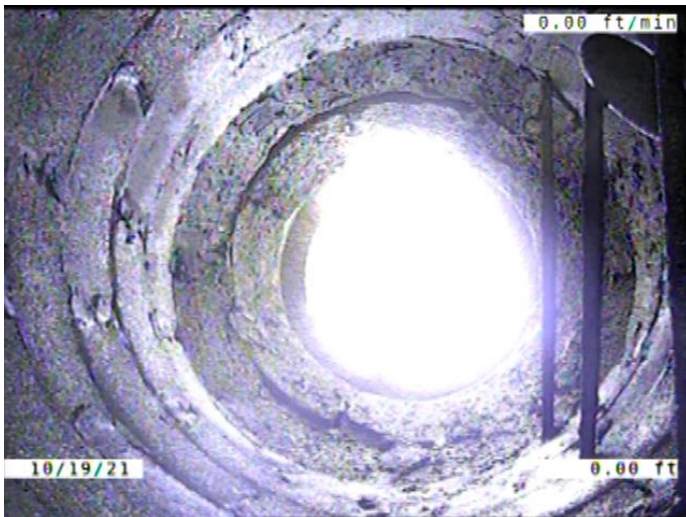


Code: **AMH**
Description: **Manhole**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **M-503-009**

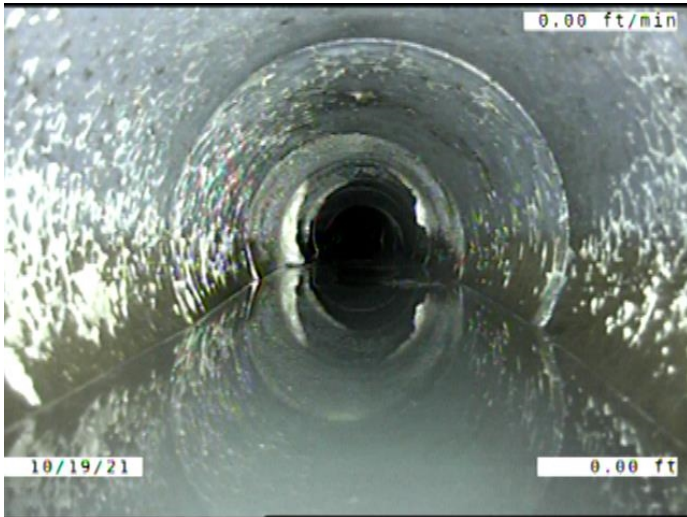


Code: **MWL**
 Description: **Miscellaneous Water Level**

Distance (ft): **.0**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **10.000**
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

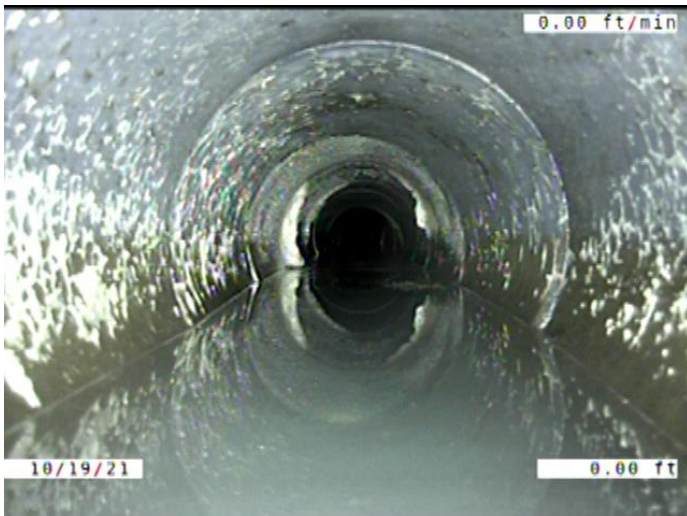


Code: **DSF**
 Description: **Deposits Settled Fine**


Distance (ft): **.0**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **S01**
 Within 8" of Joint: **YES**
 Remarks:

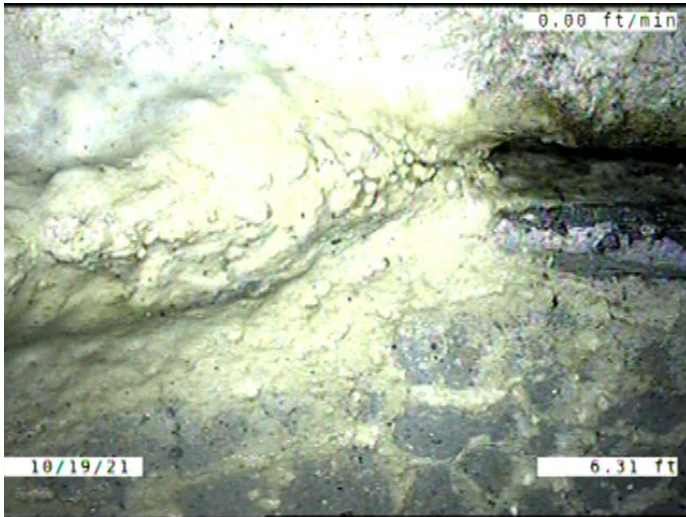

Code:	DAE
Description:	Deposits Attached Encrustation
Distance (ft):	6.3
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S02
Within 8" of Joint:	YES
Remarks:	

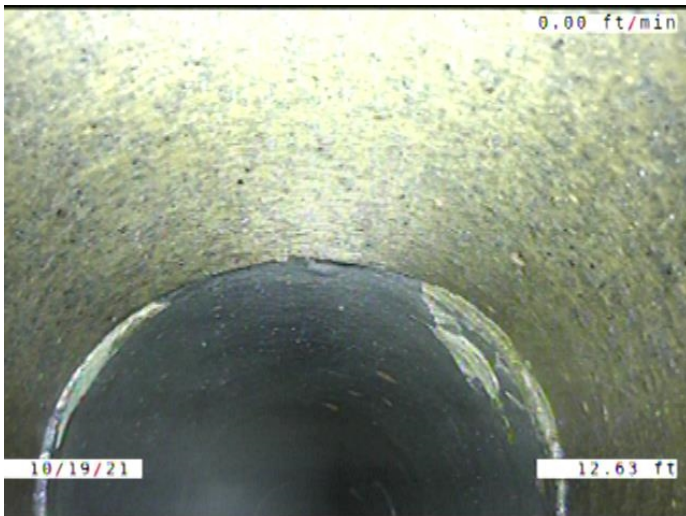


Code:	MWLS
Description:	Miscellaneous Water Level Sag
Distance (ft):	12.6
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	15.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

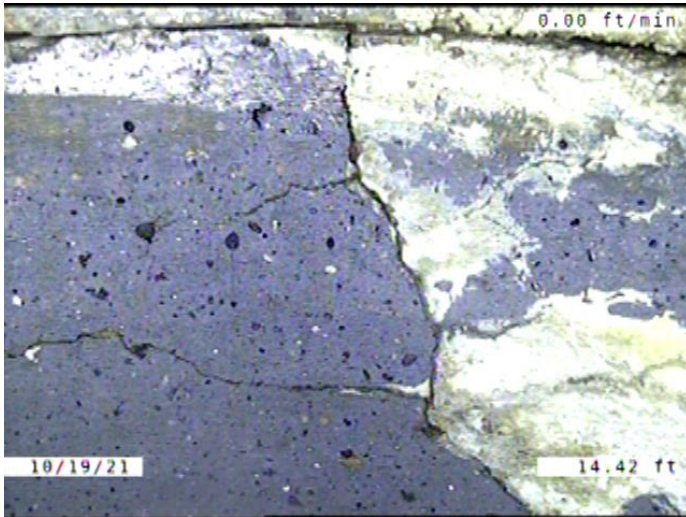

Code: **FM**
 Description: **Fracture Multiple**

Distance (ft): **14.4**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **10**
 Clock To: **2**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

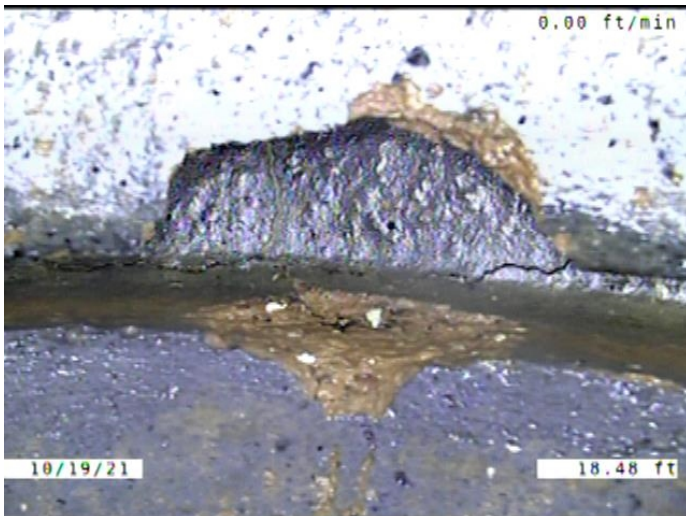


Code: **SZ**
 Description: **Surface Damage Other**

Distance (ft): **18.5**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **A PIECE CHIPPED AWAY FROM THE JOINT**




Code: **FM**
Description: **Fracture Multiple**

Distance (ft): **20.1**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **12**
Clock To: **5**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

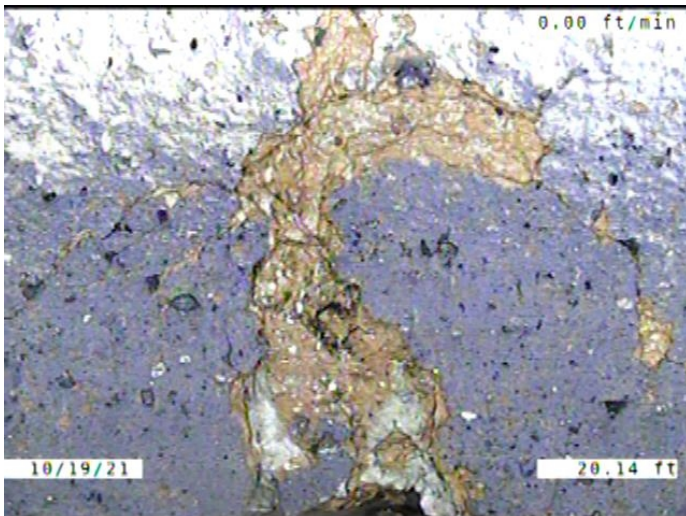


Code: **B**
Description: **Broken**

Distance (ft): **20.1**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **2**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

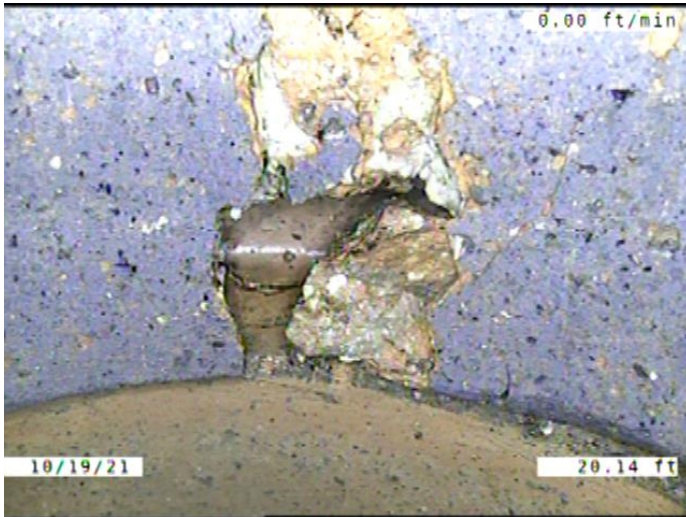


Code: **SMW**
 Description: **Surface Damage Missing Wall**

Distance (ft): **20.1**
 Structural Grade: **5**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **INSIDE OF THE JOINT**

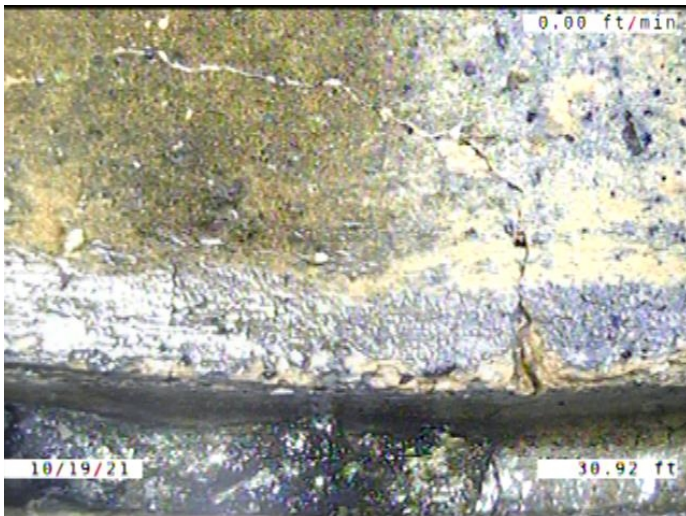

Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **30.9**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **3**
 Clock To: **6**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

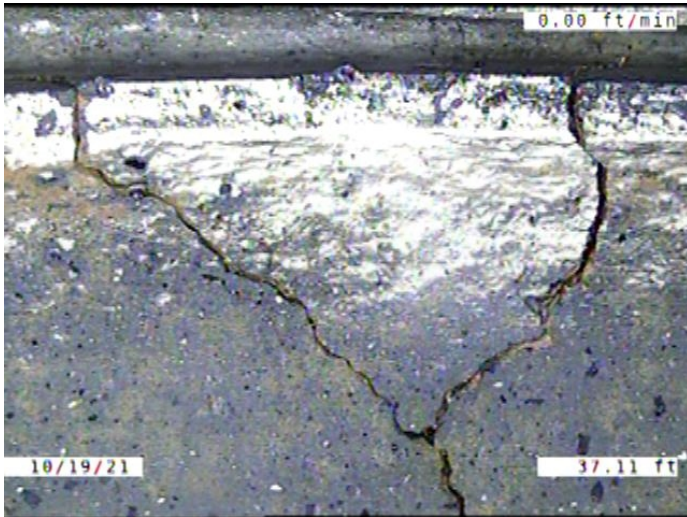


Code: **FM**
 Description: **Fracture Multiple**

Distance (ft): **37.1**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **8**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **39.1**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index: **S04**
 Within 8" of Joint: **NO**
 Remarks:

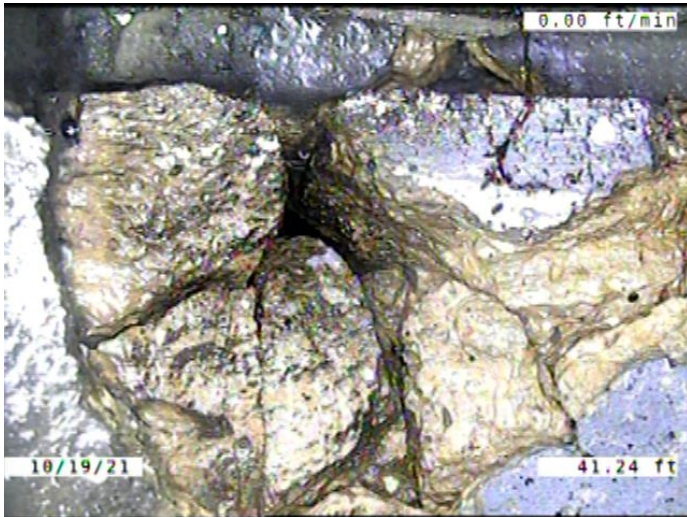


Code: **BVV**
Description: **Broken Void Visible**

Distance (ft): **41.2**
Structural Grade: **5**
O&M Grade: **0**
Clock Start/From: **8**
Clock To: **9**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

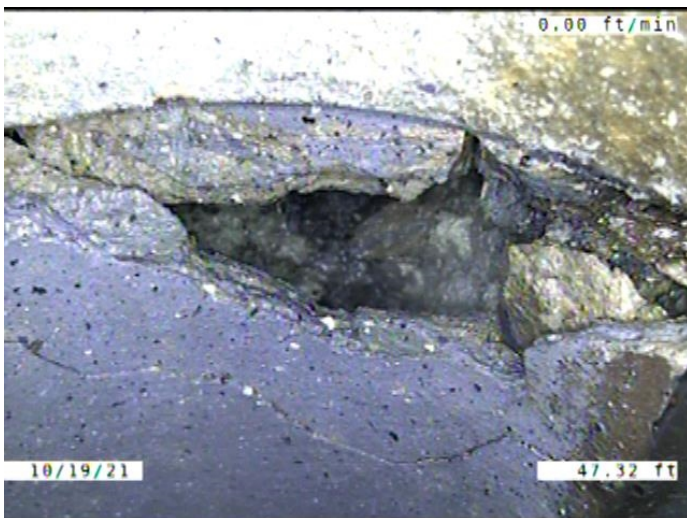


Code: **HVV**
Description: **Hole Void Visible**

Distance (ft): **47.3**
Structural Grade: **5**
O&M Grade: **0**
Clock Start/From: **1**
Clock To: **3**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **SOIL AND VOID VISIBLE**

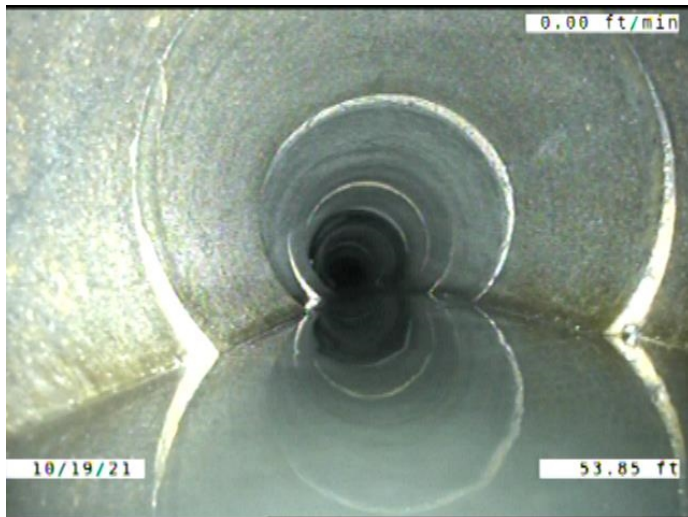


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **53.8**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **8**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **F02**
 Within 8" of Joint: **YES**
 Remarks:

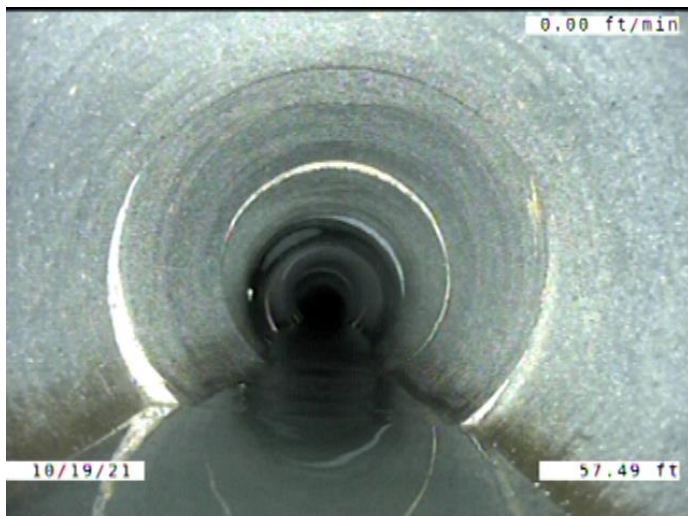


Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **57.5**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index: **F04**
 Within 8" of Joint: **NO**
 Remarks:

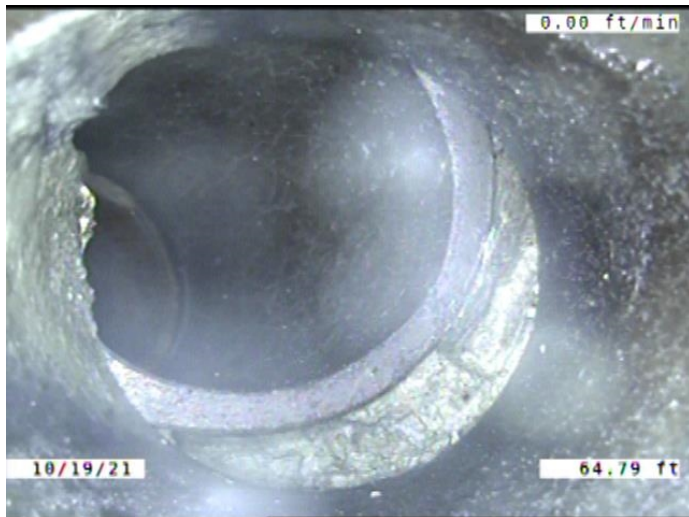

Code: **TFD**
 Description: **Tap Factory Defective**

Distance (ft): **64.8**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **11**
 Clock To:
 1st Value: **4.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **CONSTANTLY RUNNING WATER.
 LARGE OFFSET FIRST JOINT BACK**

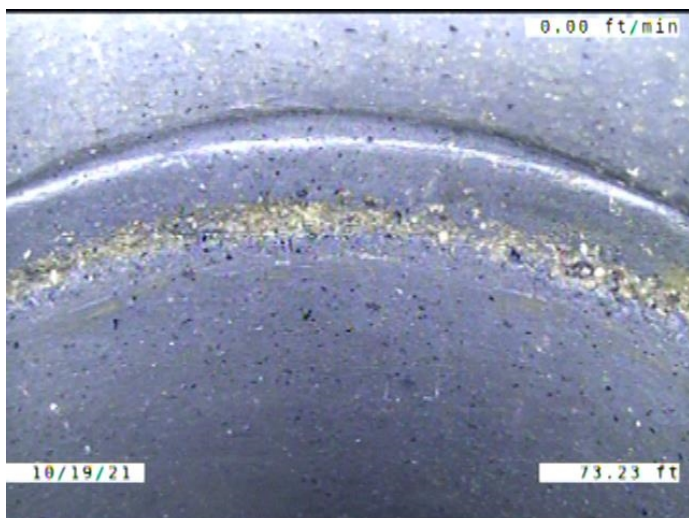


Code: **JOM**
 Description: **Joint Offset Medium**

Distance (ft): **73.2**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:



Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **74.8**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **15.000**
Continuous Index: **S05**
Within 8" of Joint: **NO**
Remarks:

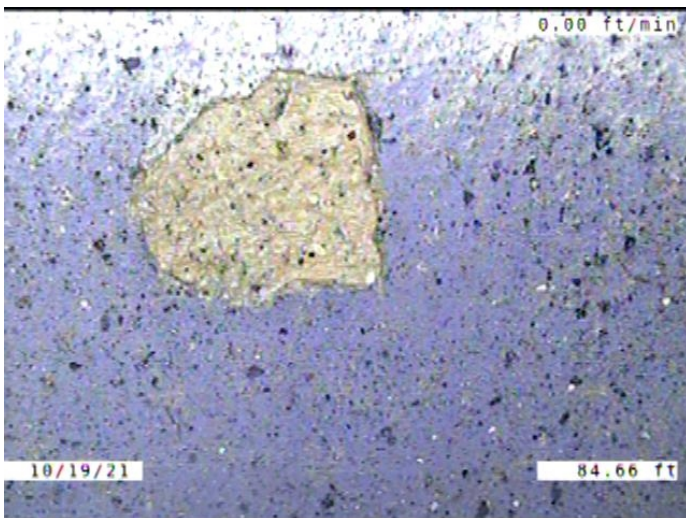


Code: **SSS**
Description: **Surface Damage Surface Spalling**

Distance (ft): **84.7**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **10**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks:



Code: **B**
Description: **Broken**

Distance (ft): **84.7**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **8**
Clock To: **11**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

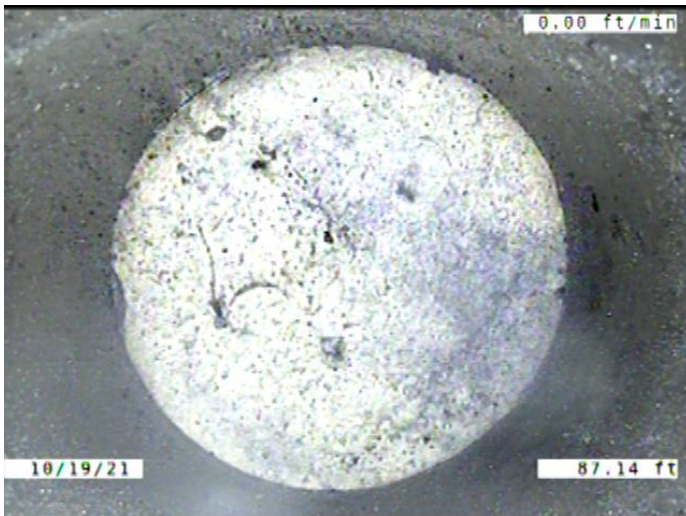


Code: **TFC**
Description: **Tap Factory Capped**

Distance (ft): **87.1**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From: **11**
Clock To:
1st Value: **4.000**
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:



Code: **CL**
 Description: **Crack Longitudinal**

Distance (ft): **88.8**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **2**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

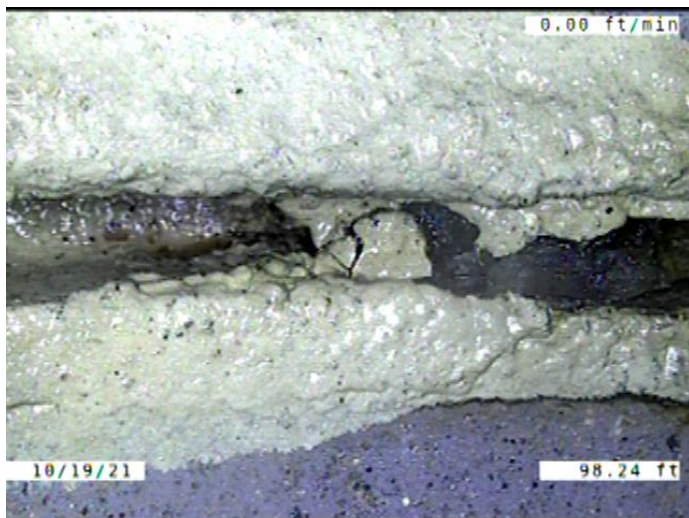

Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **98.2**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **9**
 Clock To: **12**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **FL**
 Description: **Fracture Longitudinal**

Distance (ft): **104.8**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **4**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **109.0**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index: **F05**
 Within 8" of Joint: **NO**
 Remarks:




Code: **CL**
 Description: **Crack Longitudinal**

Distance (ft): **113.3**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **2**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **113.6**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index: **S06**
 Within 8" of Joint: **NO**
 Remarks:

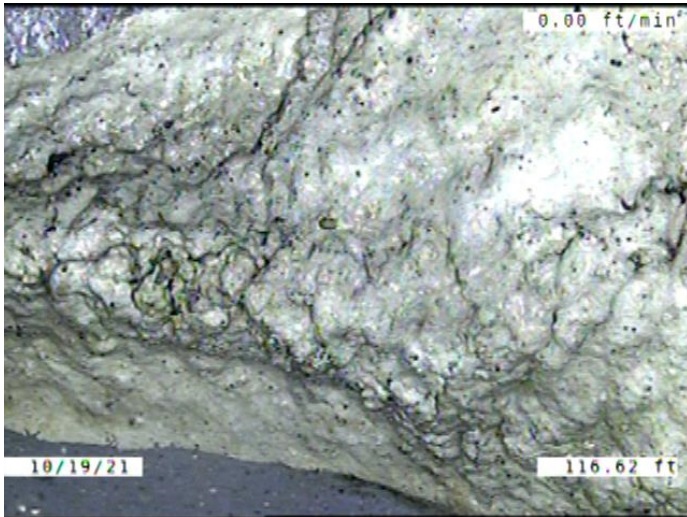

Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **116.6**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **10**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **129.0**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **12**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:




Code: **TFC**
 Description: **Tap Factory Capped**

Distance (ft): **129.7**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To:
 1st Value: **4.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

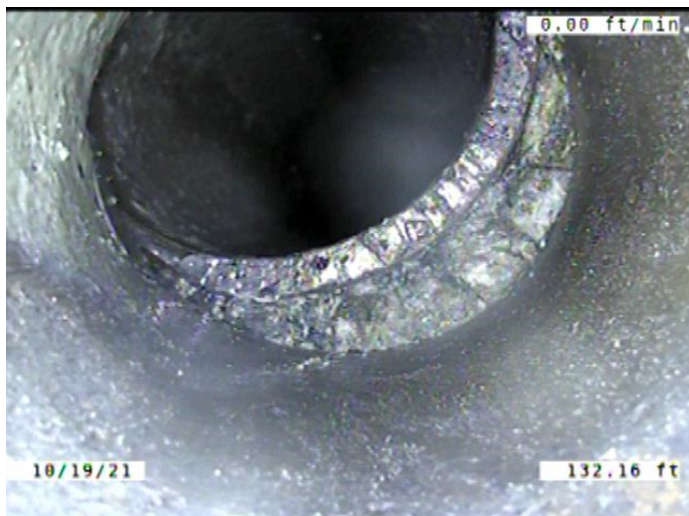


Code: **TFD**
 Description: **Tap Factory Defective**

Distance (ft): **132.2**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **11**
 Clock To:
 1st Value: **4.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **Defective**

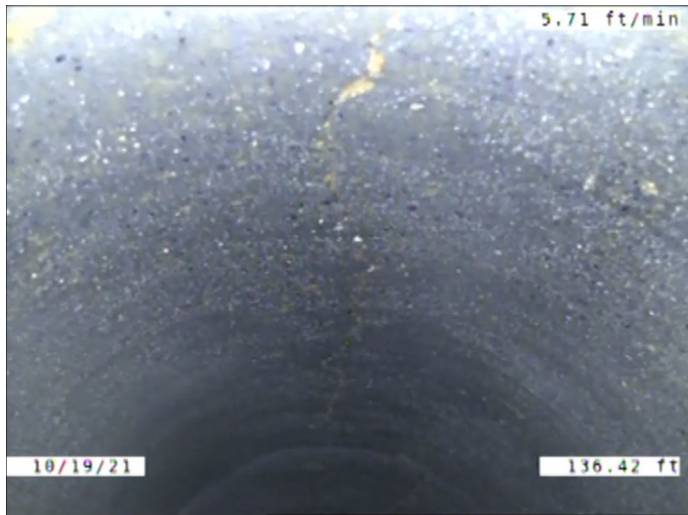

Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **136.4**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **10**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index: **S07**
 Within 8" of Joint: **YES**
 Remarks: **Wandering**

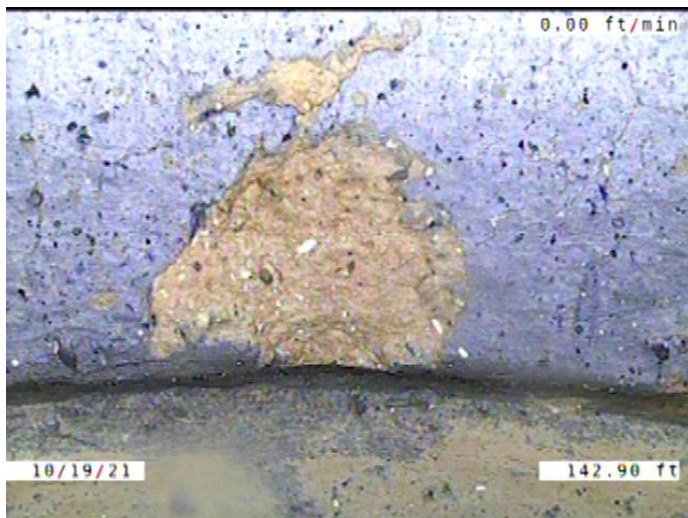

Code: **SSS**
 Description: **Surface Damage Surface Spalling**

Distance (ft): **142.9**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **12**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **142.9**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index: **F06**
 Within 8" of Joint: **NO**
 Remarks:




Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **153.7**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **10**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index: **F07**
 Within 8" of Joint: **YES**
 Remarks: **Wandering**

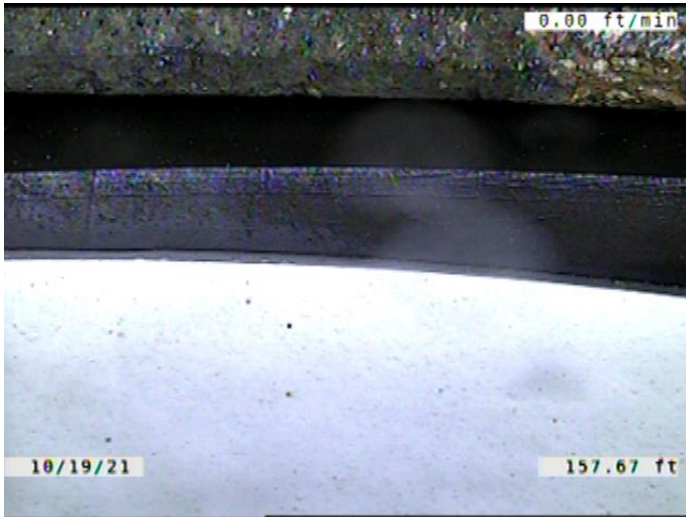

Code: **MMC**
Description: **Miscellaneous Material Change**

Distance (ft): **157.7**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **VCP TO PVC**

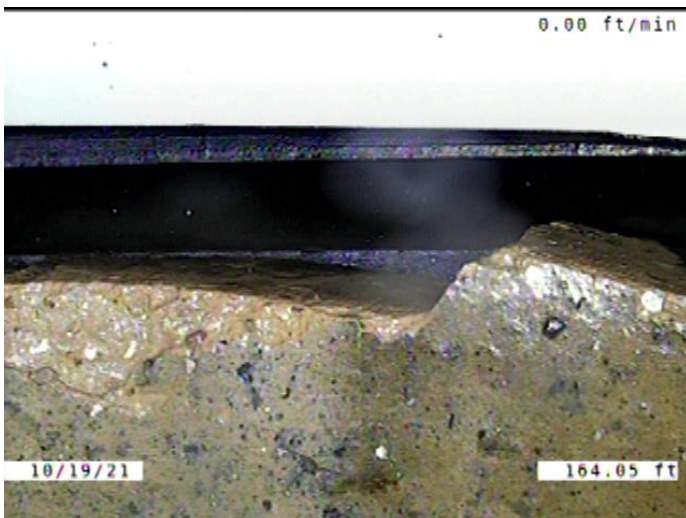


Code: **MMC**
Description: **Miscellaneous Material Change**

Distance (ft): **164.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **PVC TO VCP**



Code: **DSF**
 Description: **Deposits Settled Fine**

Distance (ft): **165.5**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **F01**
 Within 8" of Joint: **YES**
 Remarks:

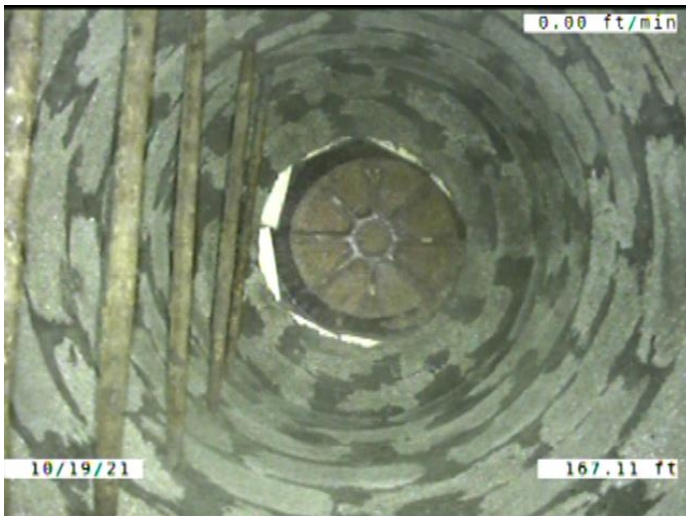

Code: **AMH**
 Description: **Manhole**

Distance (ft): **167.1**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks: **M-503-016**