

Profile/Photo Observation Report					
Date:	09/20/2021	Weather:		Coding:	PACP 7.0
Pipe Length (ft)	: 157.2	Owner:	City of Hobart	Pre Clean:	Light Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-503-026-090
Customer:	City of Hobart	Clean Date:	08/28/2021	Shape:	С
Street:	West 41st Avenue		Flow Control:	Not Controlled	
City:	Hobart, IN		Year Renewed:		
Location:	Local rural streets	with light traffic,	t Tape/Media #:		
Purpose:	Routine Assessmer	t	Dia/Height:	12"	
Use:	Sanitary Sewage Pi	pe	Material:	VCP	
Drain Area:			Lining:	None	
Category:	NA				
Comment:					
Location Details	5:		Direction of Surve	y: Downstream	
US MH:	M-503-026	DS MH:	M-504-090	Total Length Surveyed (ft):	157.2
O&M Index:	1.96	O&M Quick:	342F	O&M Rating:	94.00
Structural Index:	3.60	Structural Qu	ick: 4E31	Structural Rating:	155.00
Overall Index:	2.74	Overall Quick	4E35	~ ~	249.00

	Position	Code	Observation	Video (sec)	Grade
M-503-0)26				
Y	0.	AMH	Manhole	1	NA
Ň	.0	MWL	Miscellaneous Water Level	113	NA
	1.0	DSF(S01)	Deposits Settled Fine	136	M 2
	2.7	FS	Fracture Spiral	188	S 3
	10.8	FM(S02)	Fracture Multiple	316	S 4
	13.1	ISB(S03)	Infiltration Stain Barrel	370	M 1
	19.2	ISB(F03)	Infiltration Stain Barrel	431	M 1
	22.5	OBZ	Obstruction Other	481	M 2
	50.2	В	Broken	730	S 4
5	/50.8	ТВІ	Tap Break-in Intruding	748	M 2
ecti	// 51.1	ISB(S04)	Infiltration Stain Barrel	775	M 1
Camera Direction	53.0	TFD	Tap Factory Defective	809	M 3
	55.2	TFD	Tap Factory Defective	851	M 3
	62.4	В	Broken	920	S 4
	66.4	DAE	Deposits Attached Encrustation	974	M 2
	75.7	TBI	Tap Break-in Intruding	1128	M 2
Ļ	/ 78.1	ISB(F04)	Infiltration Stain Barrel	1178	M 1
	85.1	В	Broken	1251	S 4
	93.3	DAE	Deposits Attached Encrustation	1336	M 2
	/102.5	TF	Tap Factory	1406	NA
	//104.7	TF	Tap Factory	1435	NA
	// 108.7	SSS	Surface Damage Surface Spalling	1496	S 2
	//109.1	TBI	Tap Break-in Intruding	1511	M 2
	// 113.7	В	Broken	1588	S 4
	/ 114.9	RPPD	Point Repair Patch Patch Defective	1716	S 4
	115.5	TBD	Tap Break-in/Hammer Defective	1743	M 3
	122.4	MWLS(S07)	Miscellaneous Water Level Sag	1797	S 2
	136.5	ТВ	Tap Break-in/Hammer	1861	NA
	/147.0	ТВІ	Tap Break-in Intruding	1965	M 2
	//151.5	TFD	Tap Factory Defective	2028	M 3
/	//153.4	TF	Tap Factory	2059	NA
	/// 155.8	MWLS(F07)	Miscellaneous Water Level Sag	2092	S 2
	/// 155.8	FM(F02)	Fracture Multiple	2100	S 4
	// 155.8	DSF(F01)	Deposits Settled Fine	2107	M 2
	157.2	AMH	Manhole	2199	NA

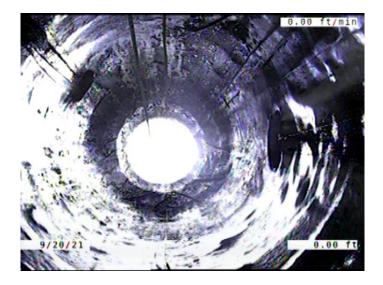

Code:	AMH
Description:	Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-503-026

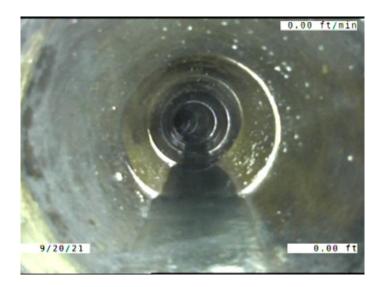

Code: Description:	MWL Miscellaneous Water Level
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	DSF Deposits Settled Fine
Distance (ft):	1.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	5
Clock To:	7
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S01
Within 8" of Joint:	YES
Remarks:	



Code: Description:	FS Fracture Spiral
Distance (ft):	2.7
Structural Grade:	3
O&M Grade:	0
Clock Start/From:	2
Clock To:	3
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	




Code:	FM
Description:	Fracture Multiple
Distance (ft):	10.8
Structural Grade:	4
O&M Grade:	0
Clock Start/From:	12
Clock To:	12
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	S02
Within 8" of Joint:	YES
Remarks:	




Code: Description:	ISB Infiltration Stain Barrel
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	13.1 0 1 8 4 SO3 YES




Code: Description:	ISB Infiltration Stain Barrel
Distance (ft):	19.2
Structural Grade:	0
O&M Grade:	1
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	F03
Within 8" of Joint:	YES
Remarks:	

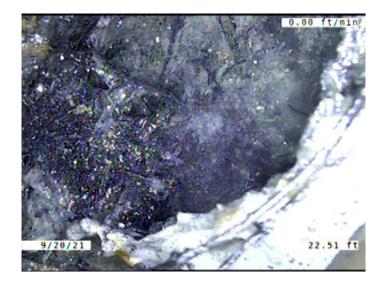


Code: Description:	OBZ Obstruction Other
Distance (ft):	22.5
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	6
Clock To:	8
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	LEAVES

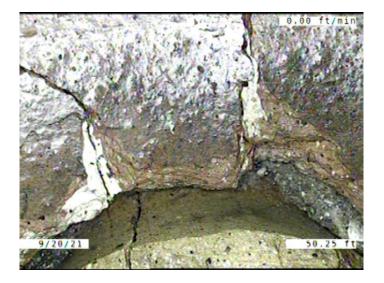


Code:	В
Description:	Broken
Distance (ft):	50.2
Structural Grade:	4
O&M Grade:	0
Clock Start/From:	9
Clock To:	2
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

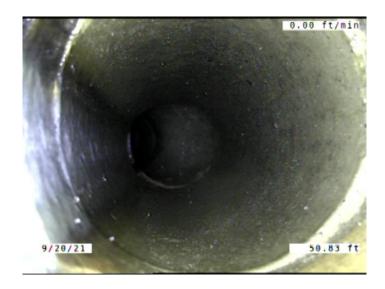


Code:	TBI
Description:	Tap Break-in Intruding
Distance (ft):	50.8
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	11
Clock To: 1st Value: 2nd Value: Value Percent:	4.000 1.000
Continuous Index: Within 8" of Joint: Remarks:	YES CONSTANTLY RUNNING WATER

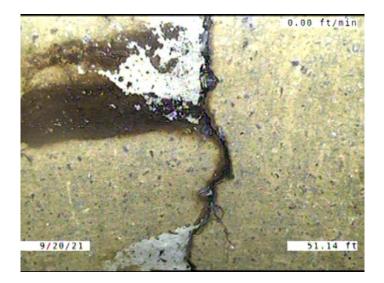

Code: Description:	ISB Infiltration Stain Barrel
Distance (ft):	51.1
Structural Grade:	0
O&M Grade:	1
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	S04
Within 8" of Joint:	YES
Remarks:	

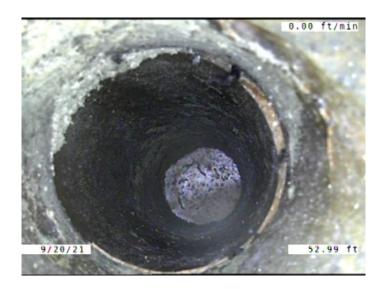


Code: Description:	TFD Tap Factory Defective
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value:	53.0 0 3 11 4.000
Value Percent: Continuous Index: Within 8" of Joint: Remarks:	YES CAPPED

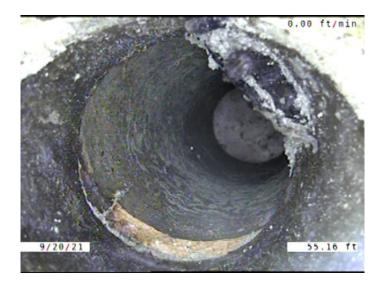

Code:	TFD
Description:	Tap Factory Defective
Distance (ft):	55.2
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	1
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	LOOKS CAPPED



Code: Description:	B Broken	
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent:	62.4 4 0 3 4	
Continuous Index: Within 8" of Joint: Remarks:	YES	

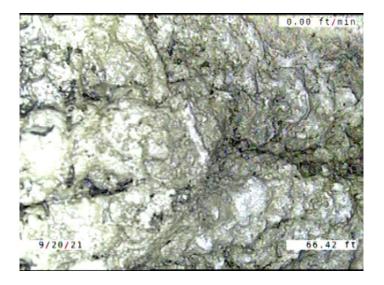


Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	66.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	10
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES

Remarks:



Code: Description:	TBI Tap Break-in Intruding
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	75.7 0 2 1 4.000 2.000 YES ACTIVITY

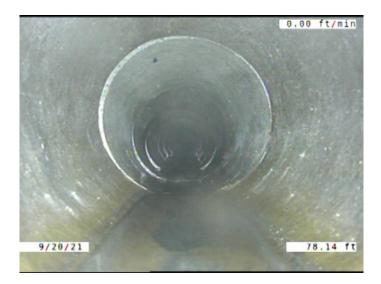


Code: Description:	ISB Infiltration Stain Barrel
Distance (ft):	78.1
Structural Grade:	0
O&M Grade:	1
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	F04
Within 8" of Joint:	YES
Remarks:	




Code: Description:	B Broken
Distance (ft):	85.1
Structural Grade:	4
O&M Grade:	0
Clock Start/From:	3
Clock To:	7
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	




Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	93.3
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	3
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

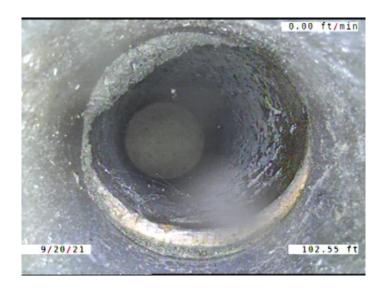


Code:	TF
Description:	Tap Factory
Distance (ft):	102.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	11
Clock To: 1st Value: 2nd Value: Value Porsont:	4.000
Value Percent: Continuous Index: Within 8" of Joint: Remarks:	YES LOOKS CAPPED

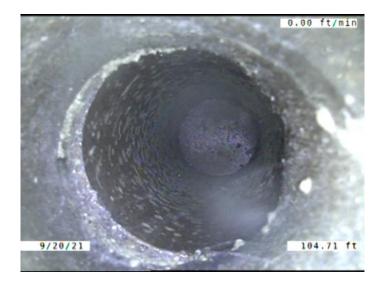

Code:	TF
Description:	Tap Factory
Distance (ft):	104.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	1
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	LOOKS CAPPED

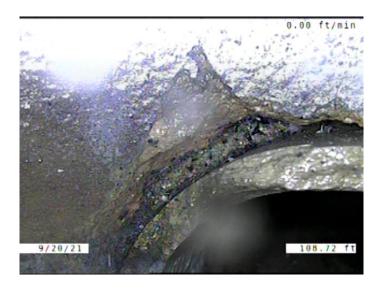


Code: Description:	SSS Surface Damage Surface Spalling
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	108.7 2 0 10 1 YES

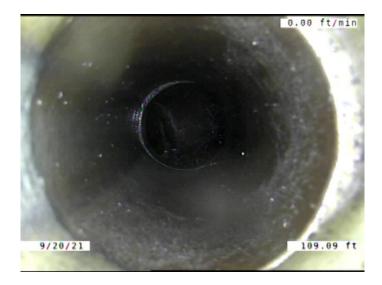


Code:	ТВІ
Description:	Tap Break-in Intruding
Distance (ft):	109.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	11
Clock To:	
1st Value:	4.000
2nd Value:	1.000
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	B Broken
Distance (ft): Structural Grade:	113.7 4
O&M Grade: Clock Start/From:	0 12
Clock To:	12
1st Value: 2nd Value:	
Value Percent:	
Continuous Index:	VEC
Within 8" of Joint: Remarks:	YES

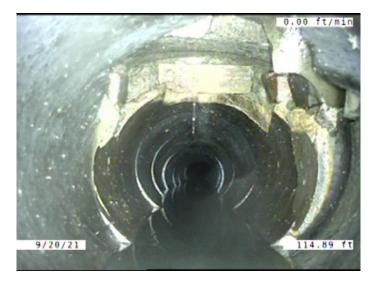


Code: RPPD Description: **Point Repair Patch Patch Defective** Distance (ft): 114.9 Structural Grade: 4 O&M Grade: 0 Clock Start/From: 10 Clock To: 2 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: YES Remarks: LOOKS LIKE THE PIPE WAS PAVED OVER BUT THE PIPE WALL IS MISSIN

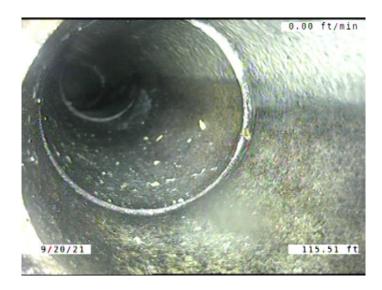


TBD Tap Break-in/Hammer Defective
115.5
0
3
1
4.000
YES
Defective




Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	122.4
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	S07
Within 8" of Joint:	NO
Remarks:	

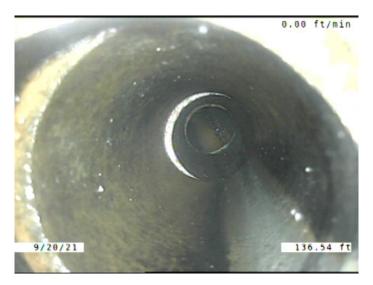


Code: Description:	TB Tap Break-in/Hammer
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	136.5 0 0 1 4.000 YES

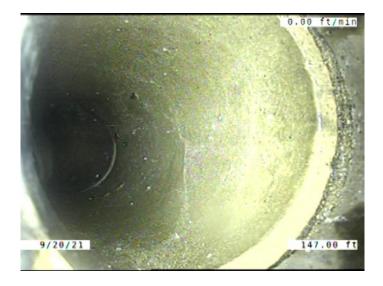

Code:	TBI Tan Darah in Interdica
Description:	Tap Break-in Intruding
Distance (ft):	147.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	11
Clock To:	
1st Value:	4.000
2nd Value:	3.000
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

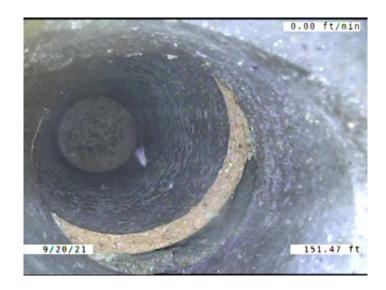

Code:	TFD
Description:	Tap Factory Defective
Distance (ft):	151.5
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	11
Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:	4.000
Within 8" of Joint:	YES
Remarks:	LOOKS CAPPED

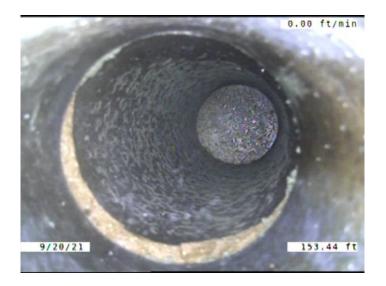

Code:	TF
Description:	Tap Factory
Distance (ft):	153.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	1
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	LOOKS CAPPED




Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	155.8
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	F07
Within 8" of Joint:	NO
Remarks:	



FM
Fracture Multiple
1
155.8
4
0
12
12
F02
YES



Code: Description:	DSF Deposits Settled Fine
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value:	155.8 0 2 5 7
Value Percent: Continuous Index: Within 8" of Joint: Remarks:	5.000 F01 YES

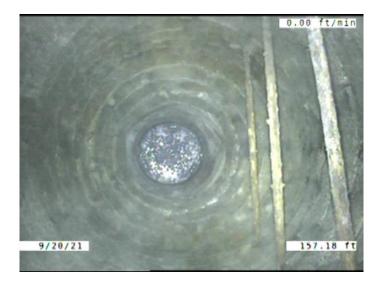

Code: Description:	AMH Manhole
Distance (ft):	457.2
Distance (ft):	157.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-504-090