Profile/Ph	oto Observatio	n Report			RedZon
Date: Pipe Length (ft)	04/12/2018 : 276.6	Weather: Owner:	NA	Coding: Pre Clean:	PACP 6.0 Not Known
P.O.#:		Surveyor:	Jen Costello	PSR:	P-503-046-045
Customer:		Clean Date:	01/01/1900	Shape:	C
Street:	W 39TH AVE & W	/ 38TH PL	Flow Control:	Not Controlled	
City:	Hobart, IN		Year Renewed:		
Location:	Other		Tape/Media #:		
Purpose:	Not Known		Dia/Height:	10"	
Use:	Sanitary		Material:	VCP	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:					
Location Detail	s:		Direction of Surv	ey: Downstream	
US MH:	M-503-045	DS MH:	M-503-046	Total Length Surveyed (ft)	: 168.0
0&M Index:	2.17	O&M Quick:	352	B O&M Rating:	50.00
tructural Index:	0.00	Structural Qu	uick: 000	0 Structural Rating:	0.00
Overall Index:	2.17	Overall Quicl	c: 352	B Overall Rating:	50.00

	Position	Code	Observation	Video (sec)	Grad
503-0	045				
\leq	.0	AMH	Manhole	10	NA
	.0	MWL	Water Level	21	NA
	3.5	DAE	Deposits Attached Encrustation	39	M 2
	3.5	IW	Infil Weeper	51	M 2
	8.0	DAE	Deposits Attached Encrustation	71	M 2
	\ <u>8.0</u>	ID	Infil Dripper	82	M 3
	18.1	IW	Infil Weeper	114	M 2
	30.0	TF	Tap Factory	149	NA
	30.0	DAGS	Deposits Attached Grease	161	M 2
	45.3	ТВ	Tap Break-in	203	NA
	45.9	DAE	Deposits Attached Encrustation	216	M 2
	45.9	ID	Infil Dripper	227	M 3
	50.9	DAE	Deposits Attached Encrustation	249	M 2
	52.8	TFC	Tap Factory Capped	264	NA
	58.2	DAE	Deposits Attached Encrustation	287	M 2
	58.2	ID	Infil Dripper	298	M 3
, 🕇 🗖	\\73.9	IW	Infil Weeper	341	M 2
	84.1	IW	Infil Weeper	373	M 2
	94.2	IW	Infil Weeper	404	M 2
	95.9	TF	Tap Factory	420	NA
	97.7	TF	Tap Factory	435	NA
	97.7	DAE	Deposits Attached Encrustation	446	M 2
	103.6	DAE	Deposits Attached Encrustation	470	M 2
	103.6	ID	Infil Dripper	480	M 3
	114.0	DAE	Deposits Attached Encrustation	512	M 2
	114.0	IW	Infil Weeper	523	M 2
	124.1	DAE	Deposits Attached Encrustation	554	M 2
	129.3	IS	Infil Stain	575	NA
	160.1	RFJ	Roots Fine Joint	648	M 1
	/ 166.7	TFD	Tap Factory Defective	672	M 2
	//166.7	RML	Roots Medium Lateral	683	M 3
	168.0	MSA	Abandoned Survey	696	NA



Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	

Continuous Index: Within 8" of Joint:

Remarks:

Code:

Description:

NO M-503-045

MWL

Water Level




Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Distance (ft):	3.5
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	11
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	IW Infil Weeper
Distance (ft):	3.5
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	10
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

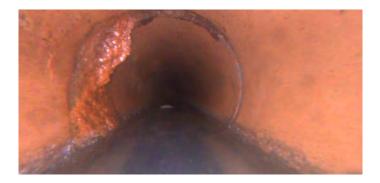

Distance (ft):	8.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	11
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

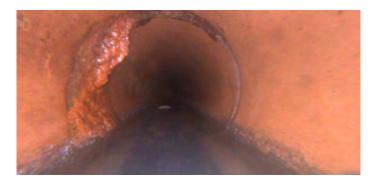


Code:	ID
Description:	Infil Dripper
Distance (ft):	8.0
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	11
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code:	IW
Description:	Infil Weeper

Distance (ft):	18.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

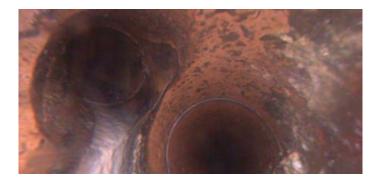


TF Tap Factory
30.0
0
0
10
4.000



Code:DAGSDescription:Deposits Attached Grease

Distance (ft):	30.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

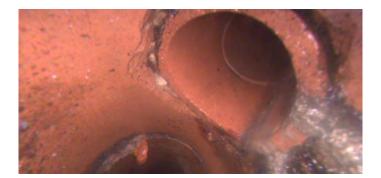

TB Tap Break-in
45.3
0
0
1
4.000



Distance (ft):	45.9
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	12
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	ID Infil Dripper
Distance (ft):	45.9
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	12
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	




Distance (ft):	50.9
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	11
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

1000


Code:	TFC
Description:	Tap Factory Capped
Distance (ft):	52.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	

Remarks:


Thursday, November 16, 2023

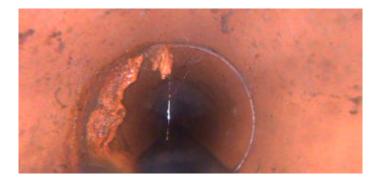

Distance (ft):	58.2
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	11
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

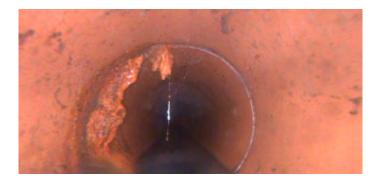

Code:	ID
Description:	Infil Dripper
Distance (ft):	58.2
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	12
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

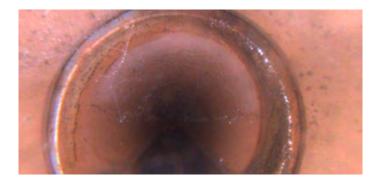


Code:	IW
Description:	Infil Weeper
Distance (ft):	72 0

Distance (ft):	73.9
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	12
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	IW Infil Weeper
Distance (ft):	84.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

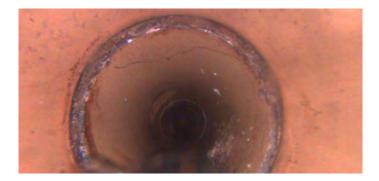

Code:	IW
Description:	Infil Weeper

Distance (ft):	94.2
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	




Code: Description:	TF Tap Factory
Distance (ft):	95.9
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code:	TF
Description:	Tap Factory
Distance (ft):	97.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	


Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	

Remarks:

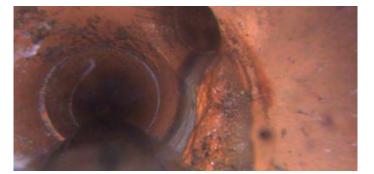


Code:	DAE
Description:	Deposits Attached Encrustation


Distance (ft):	97.7
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	2
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

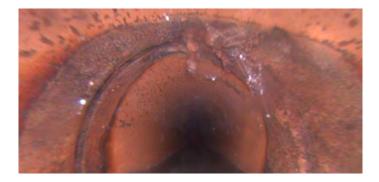


Distance (ft):	103.6
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

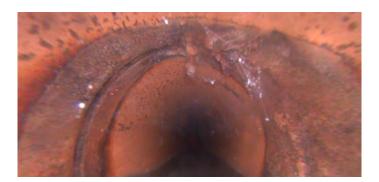

Code: Description:	ID Infil Dripper
Distance (ft):	103.6
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	12
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

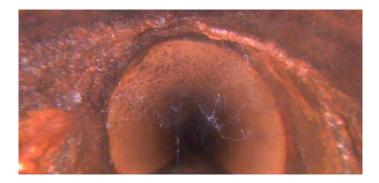

Distance (ft):	114.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

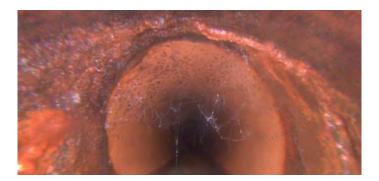


Code:	IW
Description:	Infil Weeper
Distance (ft)	114.0
Distance (ft):	114.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Distance (ft):	124.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	




Code: Description:	IS Infil Stain
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:	129.3 0 0 8 4
Within 8" of Joint: Remarks:	YES

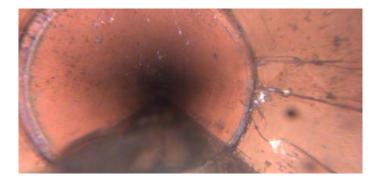

Code:RFJDescription:Roots Fine Joint


Distance (ft):	160.1
Structural Grade:	0
O&M Grade:	1
Clock Start/From:	12
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

Remarks:

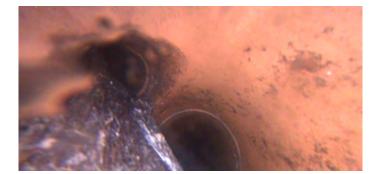


Code:	TFD
Description:	Tap Factory Defective
Distance (ft):	166.7
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	

ROOTS

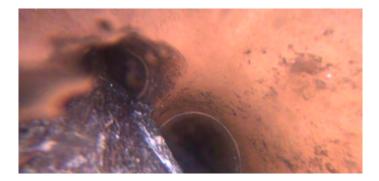

Code:RMLDescription:Roots Medium Lateral

Distance (ft):	166.7
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	6
Clock To:	10
1st Value:	
2nd Value:	
Value Percent:	40.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

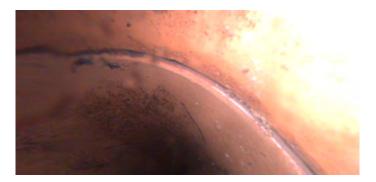

Code:	
Description:	
Distance (ft):	

Distance (ft):	168.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	ROOTS

MSA

Abandoned Survey