Profile/Photo Observation Report



Date: 04/14/2018 Weather: **PACP 6.0** Coding: Pipe Length (ft): 260.8 Owner: NA Pre Clean: **Not Known** P.O.#: Jen Costello PSR: P-503-048-049 Surveyor:

Customer: Clean Date: 01/01/1900 Shape: C

Street: W 40th ave Flow Control: Not Controlled
City: Hobart, IN Year Renewed:

Location: Other Tape/Media #:

Purpose: Not Known Dia/Height: 10"
Use: Sanitary Material: VCP

DS MH:

Drain Area: NA Lining:

Category: NA

M-503-049

Comment:

US MH:

Location Details: Direction of Survey: **Downstream**


M-503-048 Total Length Surveyed (ft): 248.3

 O&M Index:
 1.94
 O&M Quick:
 322A
 O&M Rating:
 35.00

 Structural Index:
 4.00
 Structural Quick:
 4100
 Structural Rating:
 4.00

Overall Index: 2.05 Overall Quick: 4132 Overall Rating: 39.00

F	Position	Code	Observation	Video (sec)	Grade
503-049					
).	ס	AMH	Manhole	10	NA
\)	MWL	Water Level	22	NA
1	3.1	RFJ	Roots Fine Joint	60	M 1
1	4.2	TFD	Tap Factory Defective	73	M 2
\1	4.2	RFL	Roots Fine Lateral	85	M 1
4	0.1	MMC	Material Change	148	NA
4	5.2	MMC	Material Change	170	NA
5	1.7	TFA	Tap Factory Active	195	NA
<u></u>	2.2	DAE	Deposits Attached Encrustation	227	M 2
8	4.0	TFA	Tap Factory Active	283	NA
9	4.2	IS	Infil Stain	315	NA
9	9.4	DAE	Deposits Attached Encrustation	337	M 2
9	9.4	IW	Infil Weeper	348	M 2
1	06.1	TFA	Tap Factory Active	374	NA
1	26.2	DAE	Deposits Attached Encrustation	425	M 2
$\sqrt{1}$	46.4	IW	Infil Weeper	477	M 2
$\sqrt{1}$	47.8	TFA	Tap Factory Active	492	NA
$\frac{1}{\sqrt{1}}$	53.6	DAE	Deposits Attached Encrustation	514	M 2
$\frac{1}{\sqrt{1}}$	53.6	IW	Infil Weeper	525	M 2
$\frac{1}{1}$	75.2	TFA	Tap Factory Active	579	NA
$\sqrt{1}$	75.9	IW	Infil Weeper	592	M 2
$\frac{1}{\sqrt{1}}$	86.3	FM	Fracture Multiple	624	S 4
$\sqrt{1}$	96.2	IW	Infil Weeper	654	M 2
$\frac{1}{\sqrt{2}}$	01.2	DAE	Deposits Attached Encrustation	675	M 2
$\frac{1}{2}$	01.2	RFJ	Roots Fine Joint	686	M 1
$\frac{1}{2}$	32.9	TFA	Tap Factory Active	760	NA
/2	33.5	IW	Infil Weeper	773	M 2
$\frac{1}{\sqrt{2}}$	38.8	RMJ	Roots Medium Joint	794	M 3
//2	40.3	TFD	Tap Factory Defective	808	M 2
 // 2	40.3	RML	Roots Medium Lateral	819	M 3
2	48.3	AMH	Manhole	846	NA

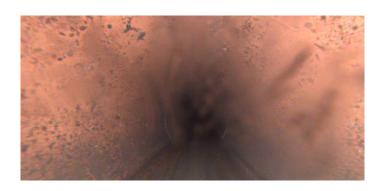

Code: AMH
Description: Manhole

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-503-049



Code: MWL
Description: Water Level


Distance (ft): .0
Structural Grade: 0
O&M Grade: 0
Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: NO

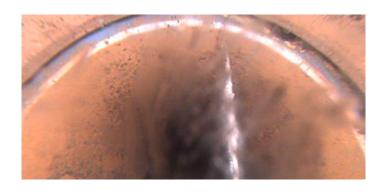

Code: RFJ

Description: Roots Fine Joint


Distance (ft): 13.1
Structural Grade: 0
O&M Grade: 1
Clock Start/From: 12

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint:

Remarks:

YES

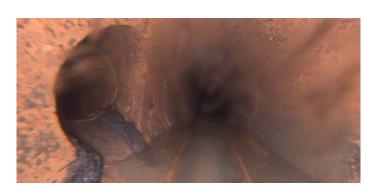

Code: **TFD**

Description: Tap Factory Defective

Distance (ft): 14.2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 9

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks: roots



Code: RFL

Description: Roots Fine Lateral

Distance (ft): 14.2
Structural Grade: 0
O&M Grade: 1
Clock Start/From: 8

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: MMC

Description: Material Change


Distance (ft): 40.1
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO Remarks: PVC

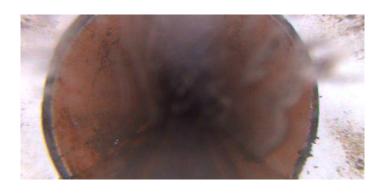

Code: MMC

Description: Material Change

Distance (ft): 45.2
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks: vcp



Code: **TFA**

Description: Tap Factory Active

NO

Distance (ft): 51.7
Structural Grade: 0


O&M Grade: 0

Clock Start/From: 3

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

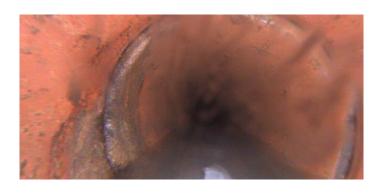

Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 62.2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 11

1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: TFA

Description: Tap Factory Active

Distance (ft): 84.0
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: IS

Description: Infil Stain

Distance (ft): 94.2
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 8
Clock To: 4
1st Value:
2nd Value:

Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: DAE


Description: Deposits Attached Encrustation

Distance (ft): 99.4
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4
1st Value:
2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: YES

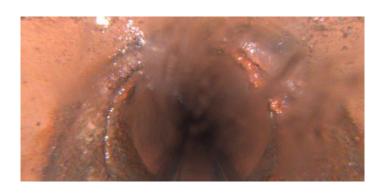

Description: Infil Weeper

Distance (ft): 99.4
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 8

Clock To: 4

1st Value:

2nd Value:

Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: TFA

Description: Tap Factory Active

Distance (ft): 106.1
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 126.2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4
1st Value:

2nd Value:


Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

YES

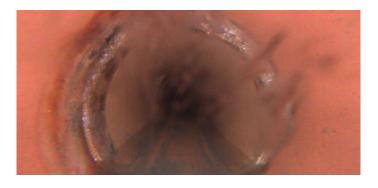

Code: IW

Description: Infil Weeper


Distance (ft): 146.4
Structural Grade: 0

O&M Grade: 2
Clock Start/From: 8

Clock To: 4

1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: YES

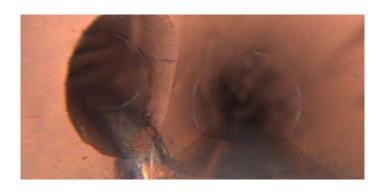

Code: TFA

Description: Tap Factory Active

Distance (ft): 147.8
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 153.6
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 8

Clock To: 4


1st Value: 2

2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: YES

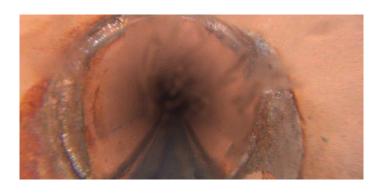

Description: Infil Weeper


Distance (ft): 153.6 Structural Grade: 0 2 O&M Grade: Clock Start/From: 8 Clock To: 4

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

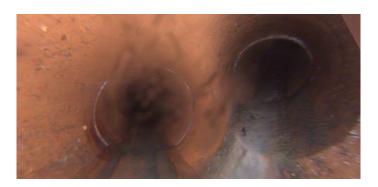

Code: **TFA**


Description: **Tap Factory Active**

Distance (ft): 175.2 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 2

Clock To:

4.000 1st Value:

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

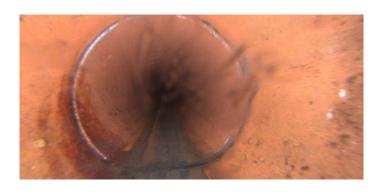

Description: Infil Weeper

Distance (ft): 175.9
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 7
Clock To: 10

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: FM

Description: Fracture Multiple

Distance (ft): 186.3
Structural Grade: 4
O&M Grade: 0
Clock Start/From: 9
Clock To: 12
1st Value:
2nd Value:
Value Percent:

Within 8" of Joint: YES

Remarks:

Continuous Index:



Description: Infil Weeper

Distance (ft): 196.2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 12

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 201.2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 9
1st Value:


Value Percent: 5.000

Continuous Index:

Within 8" of Joint: YES

Remarks:

2nd Value:

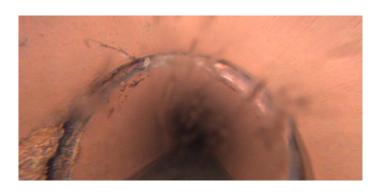

Code: RFJ

Description: Roots Fine Joint

Distance (ft): 201.2
Structural Grade: 0
O&M Grade: 1
Clock Start/From: 11

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: TFA

Description: Tap Factory Active

Distance (ft): 232.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Description: Infil Weeper

Distance (ft): 233.5
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: RMJ

Description: Roots Medium Joint

Distance (ft): 238.8
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 8
Clock To: 4
1st Value:

Value Percent: 30.000

Continuous Index:

Within 8" of Joint: YES

Remarks:

2nd Value:



Code: **TFD**

Description: Tap Factory Defective

Distance (ft): 240.3
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 3

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks: roots



Code: RML

Description: Roots Medium Lateral

Distance (ft): 240.3
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 3
Clock To: 4
1st Value:
2nd Value:

Value Percent: 10.000

Continuous Index:

Within 8" of Joint: NO



Code: AMH
Description: Manhole

Distance (ft): 248.3
Structural Grade: 0
O&M Grade: 0

Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-503-048