
Date:	04/13/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft):		Owner:	NA	Pre Clean:	Not Known
P.O.#:	52015	Surveyor:	Jen Costello	PSR:	P-503-074-073
Customer:		Clean Date:		Shape:	C
Street:	W 40th ave		Flow Control:	Not Controlled	
City:	Hobart, IN		Year Renewed:		
Location:	Other		Tape/Media #:		
Purpose:	Not Known		Dia/Height:	12"	
Use:	Sanitary		Material:	VCP	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:					
Location Details	:		Direction of Survey	: Downstream	
US MH:	M-503-074	DS MH:	M-503-073	Total Length Surveyed (ft)	: 237.0
D&M Index:	2.00	O&M Quick:	2P00	O&M Rating:	172.00
Structural Index:	0.00	Structural Qu	uick: 0000	Structural Rating:	0.00
Overall Index:	2.00	Overall Quic		Overall Rating:	172.00

M.503-074 .0 .0 .0 12. 13. 20.	.5 TF .5 DAE	- Wate 5(S01) Depos Tap Fa	r Level sits Attached Grease actory	10 21 32 69	NA NA M 2
.0 .0 .0 12. 13.	MWI DAG .5 TF .5 DAE	- Wate 5(S01) Depos Tap Fa	r Level sits Attached Grease actory	21 32	NA
.0 12. 12. 13.	DAG .5 TF .5 DAE	5(SO1) Depos Tap Fa	its Attached Grease actory	32	
12. 12. 13.	.5 TF .5 DAE	Tap F	actory		M 2
12.	.5 DAE	•	•	69	
13.		Depos		05	NA
	5 DAF		sits Attached Encrustation	81	M 2
20.	.5 DITE	Depos	sits Attached Encrustation	94	M 2
	.4 DAE	Depos	sits Attached Encrustation	120	M 2
20.	.4 IW	Infil V	/eeper	131	M 2
40.	.6 DAE	Depos	its Attached Encrustation	182	M 2
g 40.	.6 IW(S	02) Infil V	/eeper	193	M 2
40. 133 160 23 23	5.2 IW(F	02) Infil V	/eeper	394	M 2
16	6.1 IW(S	03) Infil V	/eeper	467	M 2
23 <sup>-</sup>	7.0 DAE	Depos	its Attached Encrustation	620	M 2
<u>ل</u> الم	7.0 DAG	S(F01) Depos	its Attached Grease	631	M 2
23	7.0 IW(F	03) Infil V	/eeper	641	M 2
23	7.0 MSA	Abano	doned Survey	652	NA




Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-503-074

M(503-073

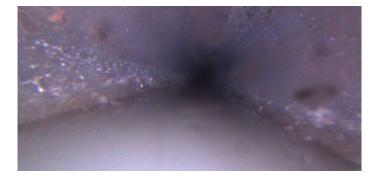

Code: MWL Description: Water Level

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: 30.000 Continuous Index: Within 8" of Joint: NO Remarks:

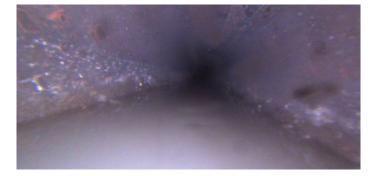


Code:	DAGS
Description:	<b>Deposits Attached Grease</b>

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S01
Within 8" of Joint:	NO
Remarks:	



Code:	TF
Description:	Tap Factory

Distance (ft):	12.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	1
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

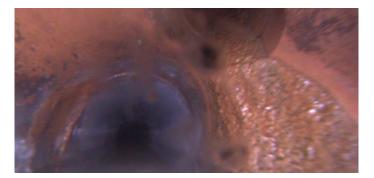

Code:	DAE
Description:	Deposits Attached Encrustation

Distance (ft):	12.5
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	1
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code:DAEDescription:Deposits Attached Encrustation

Distance (ft):	13.5
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	10
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

Code:


Description:

Remarks:

Distance (ft):	20.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES


DAE

**Deposits Attached Encrustation** 

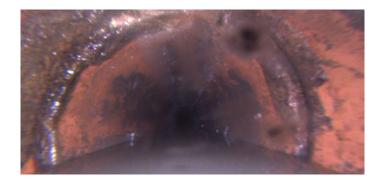


Code:	IW
Description:	Infil Weeper

Distance (ft):	20.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

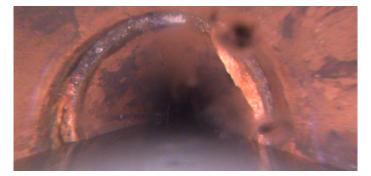


Code:	DAE
Description:	Deposits Attached Encrustation

Distance (ft):	40.6	
Structural Grade:	0	
O&M Grade:	2	
Clock Start/From:	8	
Clock To:	4	
1st Value:		
2nd Value:		
Value Percent:	5.000	
Continuous Index:		
Within 8" of Joint:	YES	
Remarks:		

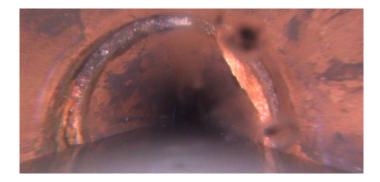


Code:	IW
Description:	Infil Weeper

Distance (ft):	40.6
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	S02
Within 8" of Joint:	YES
Remarks:	

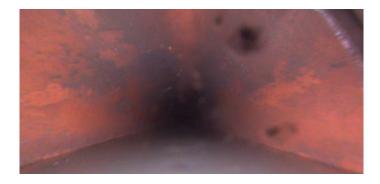


Code: Description:	IW Infil Weeper
Distance (ft):	135.2
Structural Grade:	0
O&M Grade:	2 8
Clock Start/From:	-
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	F02
Within 8" of Joint:	YES
Remarks:	

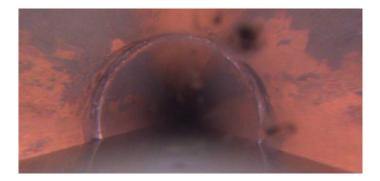


Code:	IW
Description:	Infil Weeper

Distance (ft):	166.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	S03
Within 8" of Joint:	YES
Remarks:	

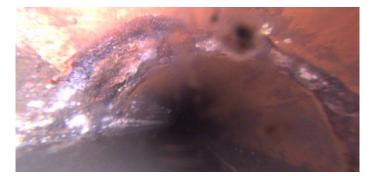


Code:	DAE
Description:	Deposits Attached Encrustation

Distance (ft):	237.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

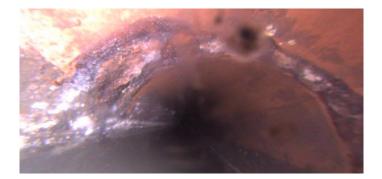


Code:DAGSDescription:Deposits Attached Grease

Distance (ft):	237.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	F01
Within 8" of Joint:	NO
Remarks:	

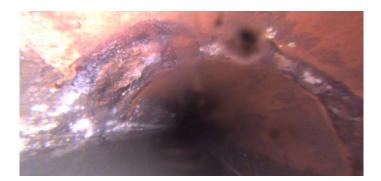

Code: Description:	IW Infil Weeper
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:	237.0 0 2 8 4
Within 8" of Joint: Remarks:	YES

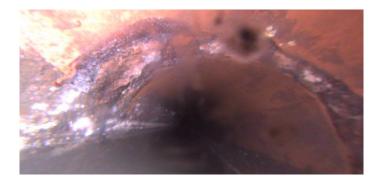

Code: Description: MSA Abandoned Survey

Distance (ft):	237.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	overturned