Date:	04/14/2018	Weather:	City of U-1		Coding:	PACP 6.0
Pipe Length (ft P.O.#:	.): 49-2	Owner:	City of Hob M. Pielach		Pre Clean: PSR:	No Pre-Cleaning M-504-025-M-504-(
P.O.#: Customer:	49-2 City of Hobart	Surveyor: Clean Date:	IVI. Pleiach	a	Shape:	IVI-504-025-IVI-504-0 C
Street:	Cleveland Street		Flow Contro	l:	Not Controlled	
City:	Hobart, IN		Year Renewe	ed:		
Location:	Light Highway		Tape/Media	#:	DEP 49	
Purpose:	Routine Assessment		Dia/Height:		18"	
Use:	Sanitary		Material:		VCP	
Drain Area:			Lining:			
Category:	NA					
Comment:						
Location Detai	ls:		Direction of	Survey:	Downstream	
US MH:	M-504-025	DS MH:	M-504-024		Total Length Surveyed (ft)	: 237.3
0&M Index:	0.00	O&M Quick:		0000	O&M Rating:	0.00
tructural Index	0.00		uick:	0000	Structural Rating:	0.00
Overall Index:	0.00	 Overall Quicl	<i>.</i>	0000	Overall Rating:	0.00

	Position	Code	Observation	Video (sec)	Grade
M-50	04-025				
	.0	AMH	Manhole	0	NA
- ÷	.0	MWL	Water Level	8	NA
	11.6	TBA	Tap Break-in Active	27	NA
	15.1	TBA	Tap Break-in Active	43	NA
	49.6	TBA	Tap Break-in Active	93	NA
- E	53.5	TBA	Tap Break-in Active	109	NA
	95.4	ТВ	Tap Break-in	210	NA
	/99.9	TBA	Tap Break-in Active	229	NA
	// 131.3	TBA	Tap Break-in Active	275	NA
5 -	/ 145.2	TBA	Tap Break-in Active	302	NA
Camera Direction	164.8	TBA	Tap Break-in Active	334	NA
ä	// 175.9	TBA	Tap Break-in Active	358	NA
nera	237.3	AMH	Manhole	668	NA
- E					
- 1 H	/				
- 11					
∔∔	/				
	/				


M-504-024




Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-504-025



Code:	MWL
Description:	Water Level
Distance (ft):	.0
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

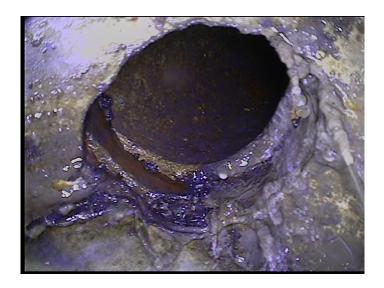

Code: Description:	TBA Tap Break-in Active
Distance (ft): Structural Grade:	11.6
O&M Grade:	0 0
Clock Start/From:	12
Clock To:	
1st Value: 2nd Value:	4.000
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

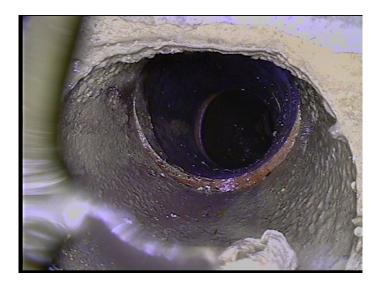

Code: Description:	TBA Tap Break-in Active
Distance (ft):	15.1
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	TBA Tap Break-in Active
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	49.6 0 12 4.000



Code: Description:	TBA Tap Break-in Active
Distance (ft):	53.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	12
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	TB Tap Break-in
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:	95.4 0 0 10 4.000
Remarks:	



Code: Description:	TBA Tap Break-in Active
Distance (ft):	99.9
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	12
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Code: Description:	TBA Tap Break-in Active
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	131.3 0 0 12 4.000




Code:	ТВА
Description:	Tap Break-in Active
Distance (ft):	145.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	1
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	TBA Tap Break-in Active
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	164.8 0 0 12 4.000

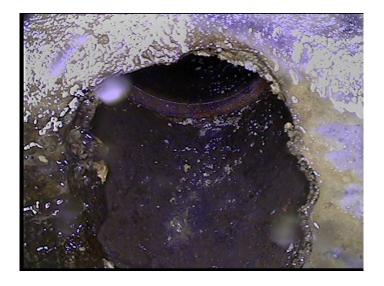

Code: Description:	TBA Tap Break-in Active
Distance (ft):	175.9
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	11
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

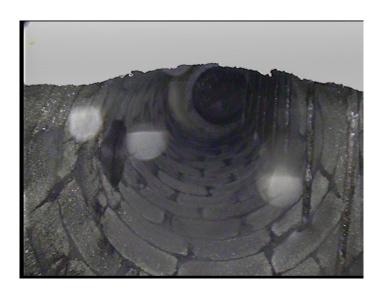

Code: Description:	AMH Manhole
Distance (ft):	237.3
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-504-024