

Profile/Photo Observation Report




Date:	11/05/2021	Weather:		Coding:	PACP 7.0
Pipe Length (ft):	330.0	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-504-057-056
Customer:	City of Hobart	Clean Date:	11/04/2021	Shape:	C

Street:	North Wilson Street	Flow Control:	Not Controlled
City:	Hobart, IN	Year Renewed:	
Location:	Alley	Tape/Media #:	
Purpose:	Routine Assessment	Dia/Height:	12"
Use:	Sanitary Sewage Pipe	Material:	VCP
Drain Area:		Lining:	None
Category:	NA		
Comment:			
Location Details:		Direction of Survey:	Downstream
US MH:	M-504-057	DS MH:	M-504-056
		Total Length Surveyed (ft):	233.0

O&M Index:	1.80	O&M Quick:	5141	O&M Rating:	164.00
Structural Index:	3.49	Structural Quick:	534B	Structural Rating:	122.00
Overall Index:	2.27	Overall Quick:	544B	Overall Rating:	286.00


	Position	Code	Observation	Video (sec)	Grade
	.0	AMH	Manhole	1	NA
	.0	MWL	Miscellaneous Water Level	11	NA
	1.5	MGO	Miscellaneous General Observation	20	NA
	5.2	CM	Crack Multiple	93	S 3
	5.2	DAE	Deposits Attached Encrustation	123	M 2
	5.2	CL	Crack Longitudinal	143	S 2
	5.2	DAE	Deposits Attached Encrustation	164	M 2
	7.8	DAE	Deposits Attached Encrustation	227	M 2
	10.7	SSS	Surface Damage Surface Spalling	268	S 2
	10.7	SSS	Surface Damage Surface Spalling	294	S 2
	16.9	CM	Crack Multiple	370	S 3
	16.9	DAE	Deposits Attached Encrustation	398	M 2
	16.9	DAE	Deposits Attached Encrustation	429	M 2
	20.0	FS	Fracture Spiral	495	S 3
	20.0	DAE	Deposits Attached Encrustation	525	M 2
	23.0	DAE	Deposits Attached Encrustation	567	M 2
	24.9	HSV	Hole Soil Visible	627	S 5
	34.1	SSS	Surface Damage Surface Spalling	694	S 2
	34.1	CM	Crack Multiple	713	S 3



34.1	SSS	Surface Damage Surface Spalling	732	S 2
34.1	CM	Crack Multiple	752	S 3
37.2	FM(S01)	Fracture Multiple	835	S 4
40.0	DR(S02)	Deformed Rigid	902	S 4
42.2	RFB	Roots Fine Barrel	971	M 2
42.5	TBI	Tap Break-in Intruding	987	M 2
43.6	HSV	Hole Soil Visible	1062	S 5
43.6	DAE	Deposits Attached Encrustation	1093	M 2
46.2	RFJ	Roots Fine Joint	1162	M 1
52.1	RFJ	Roots Fine Joint	1238	M 1
64.6	HSV	Hole Soil Visible	1387	S 5
64.6	ISC	Infiltration Stain Connection	1417	M 1
64.6	IRB	Infiltration Runner Barrel	1434	M 4
65.1	TBI	Tap Break-in Intruding	1457	M 2
67.4	DR(F02)	Deformed Rigid	1493	S 4
82.4	RFJ	Roots Fine Joint	1612	M 1
85.5	RFJ	Roots Fine Joint	1658	M 1
85.7	FM(F01)	Fracture Multiple	1674	S 4
88.3	RFJ	Roots Fine Joint	1722	M 1
88.3	MWL	Miscellaneous Water Level	1738	NA
91.2	RFJ	Roots Fine Joint	1787	M 1
94.4	RMJ	Roots Medium Joint	1866	M 3
97.5	RFJ	Roots Fine Joint	1931	M 1
103.4	RFJ	Roots Fine Joint	2012	M 1
104.1	SSS	Surface Damage Surface Spalling	2058	S 2
104.1	RMC	Roots Medium Connection	2077	M 3
104.1	TBI	Tap Break-in Intruding	2104	M 2
105.2	DSF(S03)	Deposits Settled Fine	2125	M 2
109.6	RFJ(S04)	Roots Fine Joint	2187	M 1
110.7	OBM	Obstruction Pipe Material in Invert	2239	M 2
116.8	TBI	Tap Break-in Intruding	2320	M 2
149.5	RMJ	Roots Medium Joint	2502	M 3
157.6	B	Broken	2598	S 4
158.7	DAE	Deposits Attached Encrustation	2645	M 2
160.7	RMC	Roots Medium Connection	2698	M 3
160.7	TBI	Tap Break-in Intruding	2738	M 2
160.8	CM	Crack Multiple	2778	S 3
167.7	RMJ	Roots Medium Joint	2841	M 3
171.2	RMJ	Roots Medium Joint	2889	M 3
172.4	RMC	Roots Medium Connection	2932	M 3
173.2	TBD	Tap Break-in/Hammer Defective	2965	M 3
174.5	OBM	Obstruction Pipe Material in Invert	3045	M 2

190.6	SSS	Surface Damage Surface Spalling	3174	S 2
204.6	FM	Fracture Multiple	3274	S 4
207.1	B	Broken	3307	S 4
207.3	RBB	Roots Ball Barrel	3338	M 5
209.3	TBD	Tap Break-in/Hammer Defective	3380	M 3
222.4	RMJ	Roots Medium Joint	3471	M 3
224.2	TBI	Tap Break-in Intruding	3504	M 2
231.6	RMJ	Roots Medium Joint	3599	M 3
231.7	FS	Fracture Spiral	3634	S 3
232.9	RFJ(F04)	Roots Fine Joint	3660	M 1
232.9	DSF(F03)	Deposits Settled Fine	3678	M 2
233.0	MSA	Miscellaneous Survey Abandoned	3698	NA

M-504-056

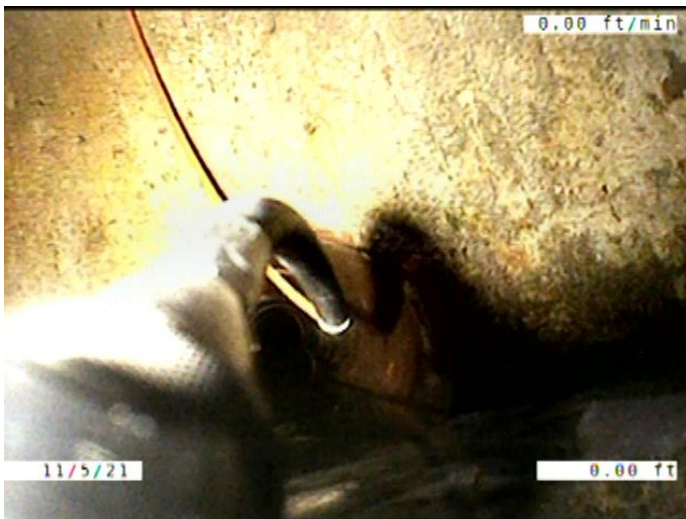

Code: **AMH**
Description: **Manhole**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **M-504-057**




Code: **MWL**
Description: **Miscellaneous Water Level**


Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:



Code:	MGO
Description:	Miscellaneous General Observation
Distance (ft):	1.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	DROP INTO THE MANHOLE. HAD TO START IN THE PIPE.

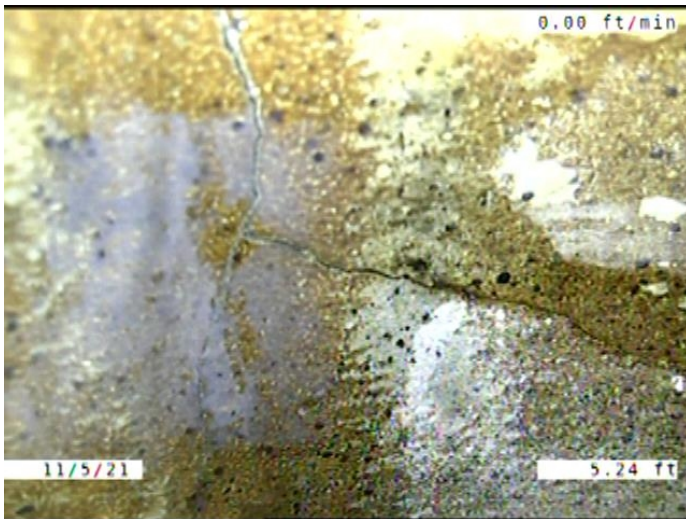


Code:	CM
Description:	Crack Multiple
Distance (ft):	5.2
Structural Grade:	3
O&M Grade:	0
Clock Start/From:	7
Clock To:	12
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

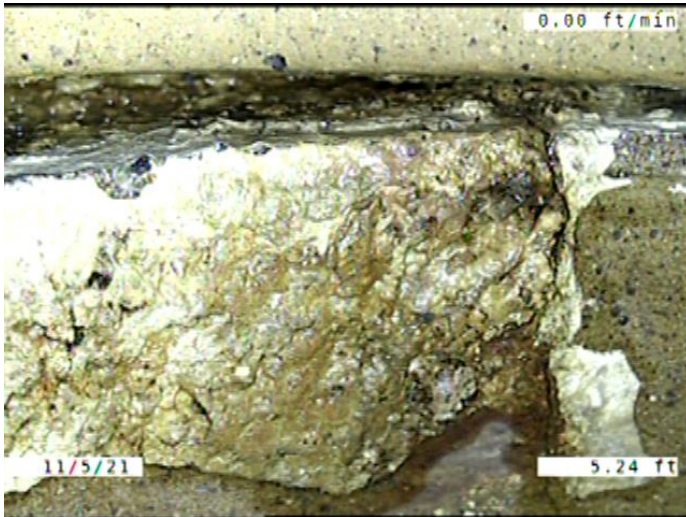


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **5.2**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **8**
 Clock To: **12**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

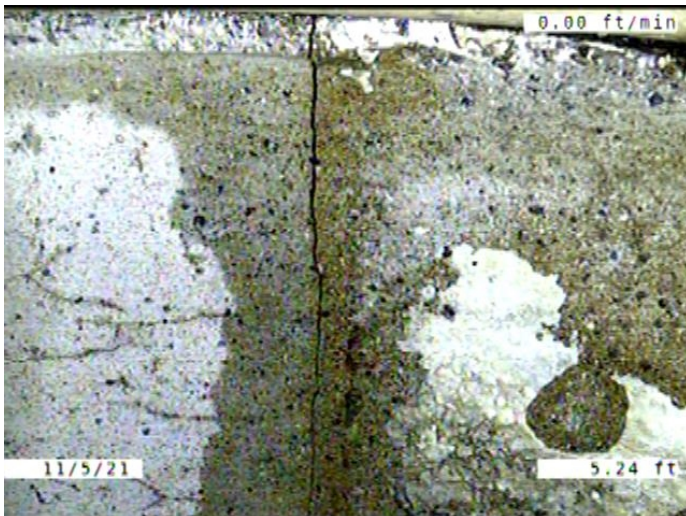

Code: **CL**
 Description: **Crack Longitudinal**

Distance (ft): **5.2**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

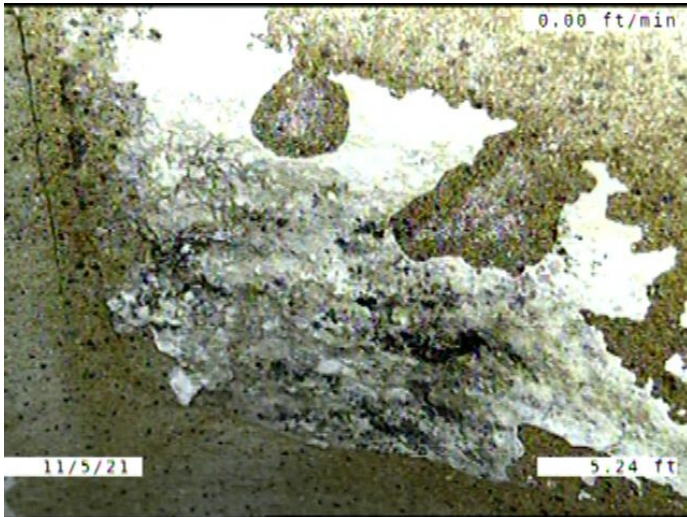


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **5.2**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **1**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **7.8**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **8**
 Clock To: **5**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

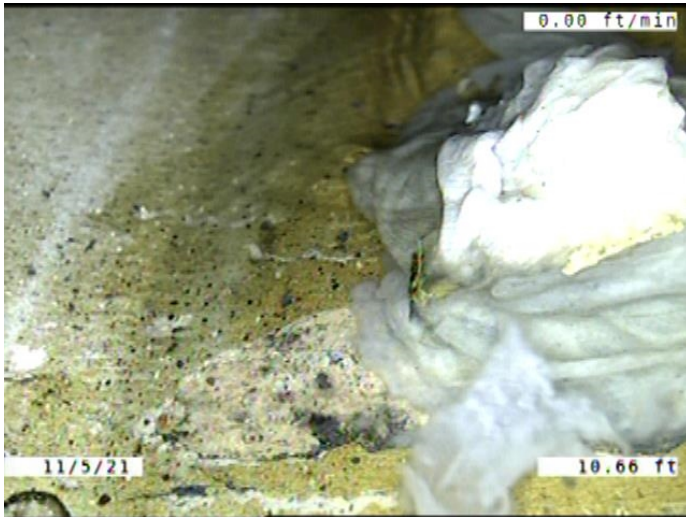

Code: **SSS**
Description: **Surface Damage Surface Spalling**

Distance (ft): **10.7**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **5**
Clock To: **7**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

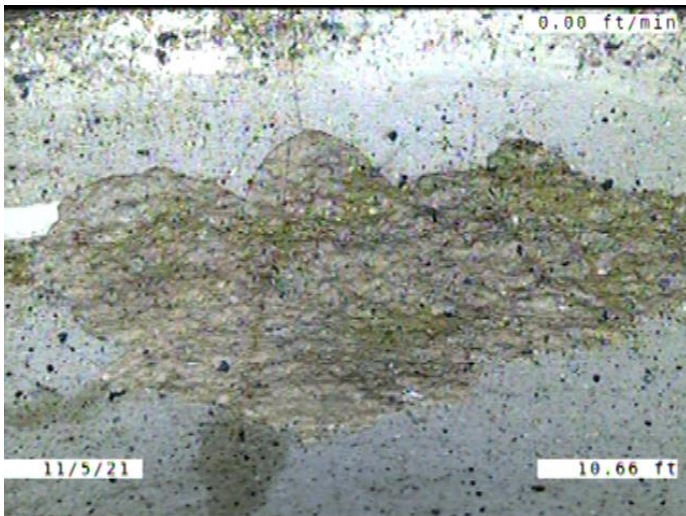


Code: **SSS**
Description: **Surface Damage Surface Spalling**

Distance (ft): **10.7**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **10**
Clock To: **11**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:




Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **16.9**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **11**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

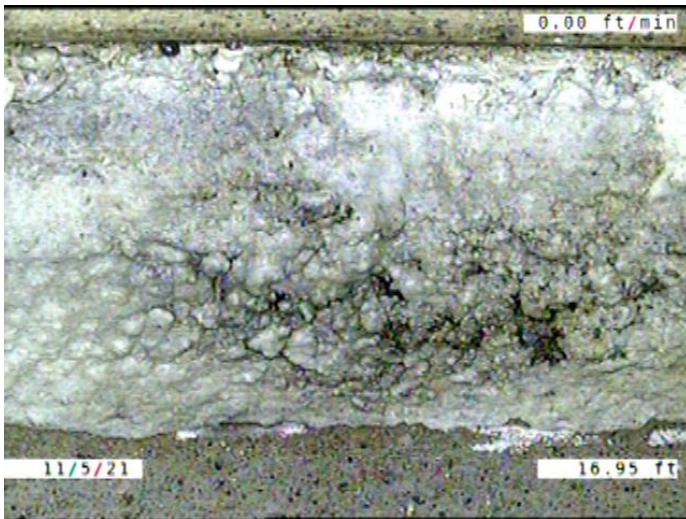


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **16.9**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **8**
 Clock To: **11**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

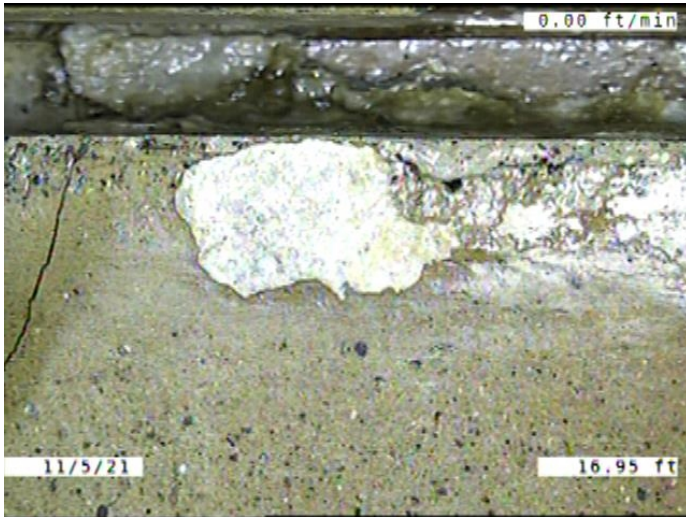


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **16.9**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **3**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

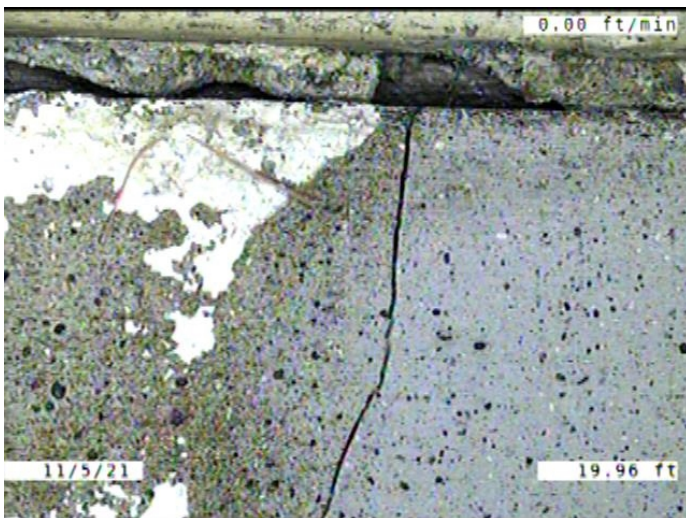


Code: **FS**
 Description: **Fracture Spiral**

Distance (ft): **20.0**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **8**
 Clock To: **11**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

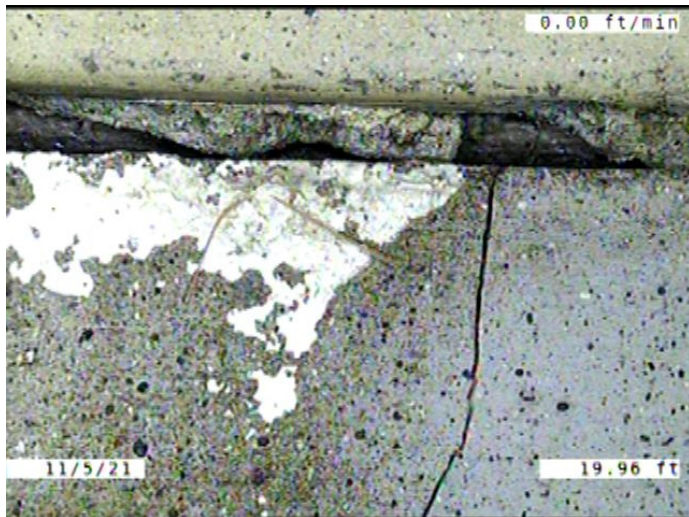


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **20.0**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **9**
 Clock To: **11**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

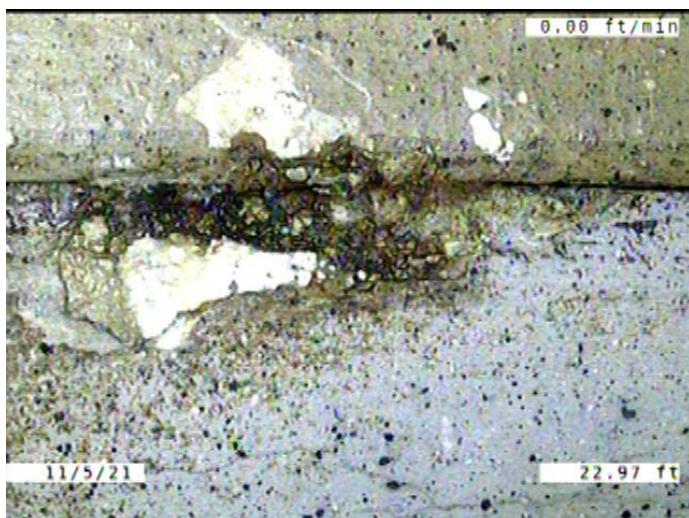


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **23.0**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **8**
 Clock To: **9**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

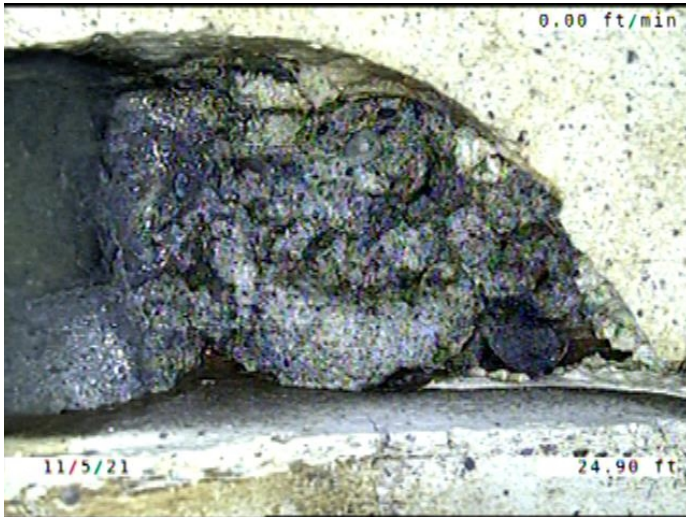


Code: **HSV**
Description: **Hole Soil Visible**

Distance (ft): **24.9**
Structural Grade: **5**
O&M Grade: **0**
Clock Start/From: **5**
Clock To: **9**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **INSIDE OF THE JOINT**

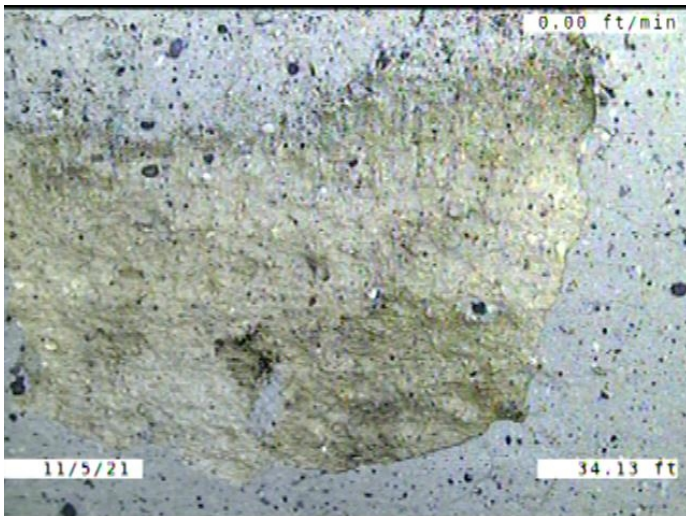


Code: **SSS**
Description: **Surface Damage Surface Spalling**

Distance (ft): **34.1**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **2**
Clock To: **3**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

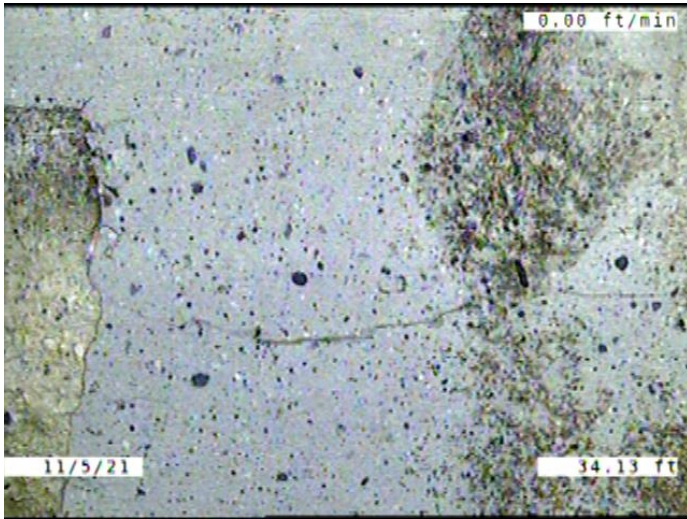


Code: **CM**
Description: **Crack Multiple**

Distance (ft): **34.1**
Structural Grade: **3**
O&M Grade: **0**
Clock Start/From: **3**
Clock To: **5**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

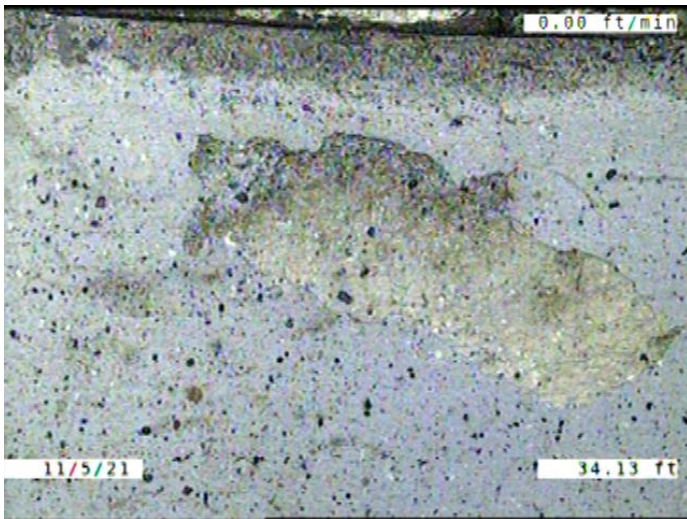


Code: **SSS**
Description: **Surface Damage Surface Spalling**

Distance (ft): **34.1**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From: **11**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

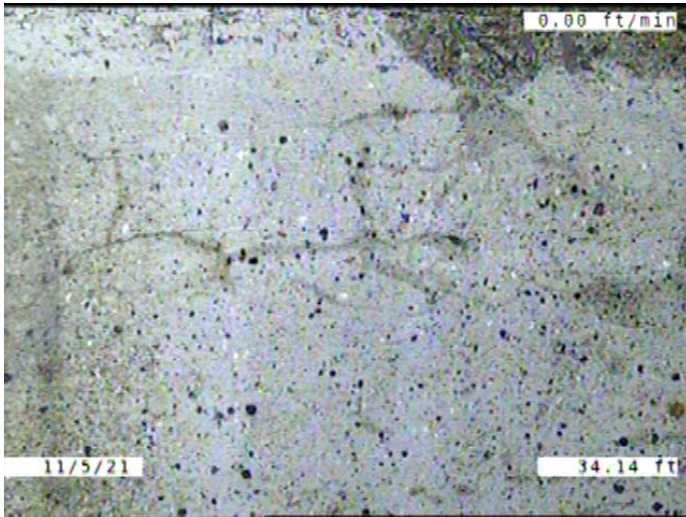


Code: **CM**
Description: **Crack Multiple**

Distance (ft): **34.1**
Structural Grade: **3**
O&M Grade: **0**
Clock Start/From: **9**
Clock To: **10**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

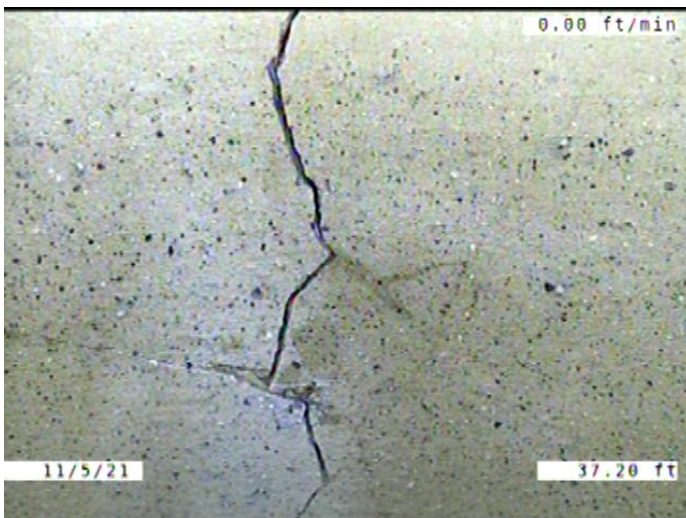

Code: **FM**
Description: **Fracture Multiple**

Distance (ft): **37.2**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **8**
Clock To: **4**
1st Value:
2nd Value:
Value Percent:
Continuous Index: **S01**
Within 8" of Joint: **YES**
Remarks:

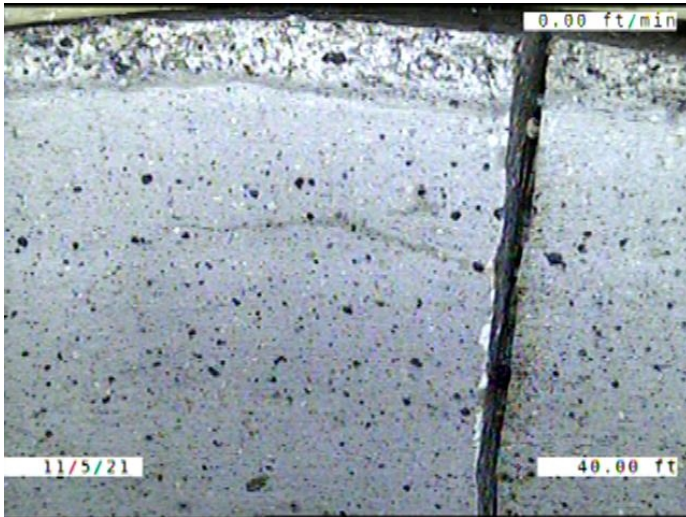


Code: **DR**
Description: **Deformed Rigid**

Distance (ft): **40.0**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **S02**
Within 8" of Joint: **NO**
Remarks:



Code: **RFB**
Description: **Roots Fine Barrel**

Distance (ft): **42.2**
Structural Grade: **0**
O&M Grade: **2**
Clock Start/From: **11**
Clock To: **3**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks:

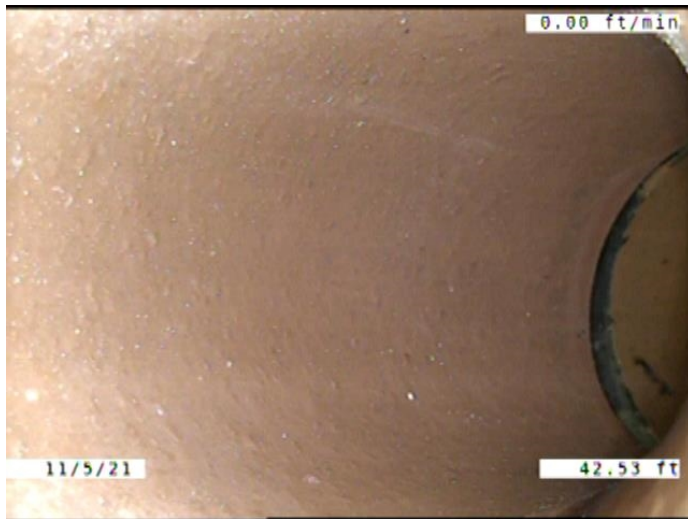


Code: **TBI**
 Description: **Tap Break-in Intruding**

Distance (ft): **42.5**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **1**
 Clock To:
 1st Value: **4.000**
 2nd Value: **1.000**
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **HSV**
 Description: **Hole Soil Visible**

Distance (ft): **43.6**
 Structural Grade: **5**
 O&M Grade: **0**
 Clock Start/From: **12**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

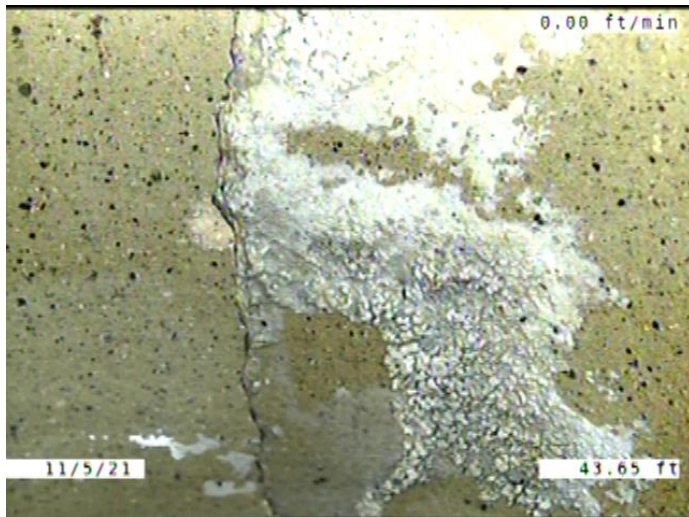

Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **43.6**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **8**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **46.2**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **9**
 Clock To: **11**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **52.1**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **10**
 Clock To: **2**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **HSV**
 Description: **Hole Soil Visible**

Distance (ft): **64.6**
 Structural Grade: **5**
 O&M Grade: **0**
 Clock Start/From: **12**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **SOIL VISIBLE**

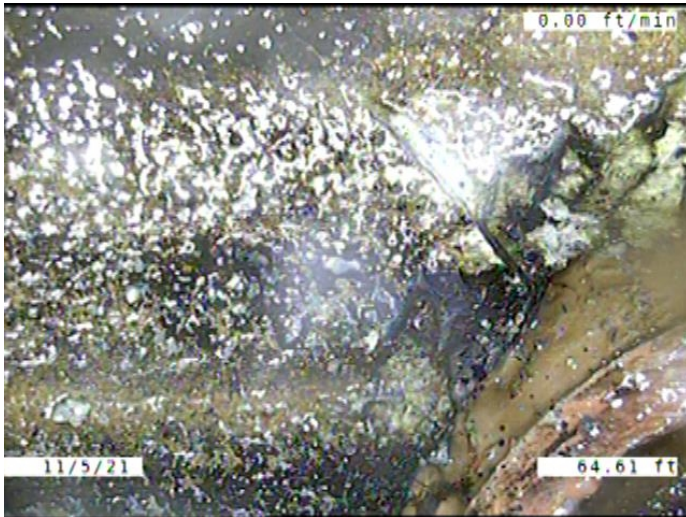


Code: **ISC**
 Description: **Infiltration Stain Connection**

Distance (ft): **64.6**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **8**
 Clock To: **11**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **IRB**
 Description: **Infiltration Runner Barrel**

Distance (ft): **64.6**
 Structural Grade: **0**
 O&M Grade: **4**
 Clock Start/From: **12**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

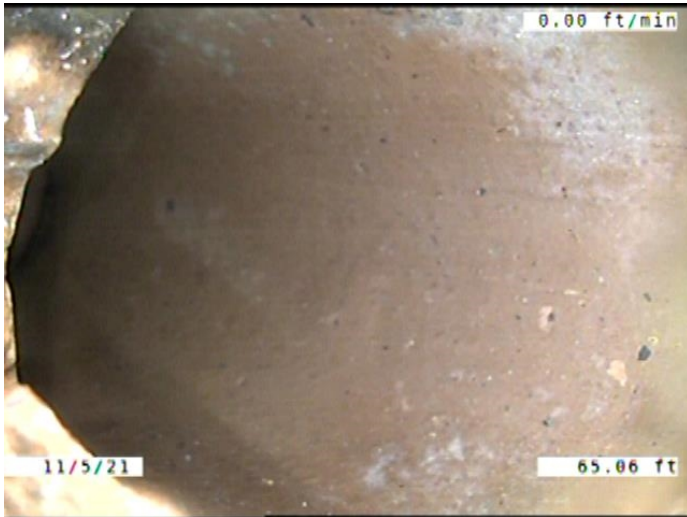

Code: **TBI**
Description: **Tap Break-in Intruding**

Distance (ft): **65.1**
Structural Grade: **0**
O&M Grade: **2**
Clock Start/From: **12**
Clock To:
1st Value: **4.000**
2nd Value: **1.000**
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:



Code: **DR**
Description: **Deformed Rigid**

Distance (ft): **67.4**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **F02**
Within 8" of Joint: **NO**
Remarks:



Code: **RFJ**
Description: **Roots Fine Joint**

Distance (ft): **82.4**
Structural Grade: **0**
O&M Grade: **1**
Clock Start/From: **11**
Clock To: **3**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:




Code: **RFJ**
Description: **Roots Fine Joint**

Distance (ft): **85.5**
Structural Grade: **0**
O&M Grade: **1**
Clock Start/From: **10**
Clock To: **2**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:



Code: **FM**
 Description: **Fracture Multiple**

Distance (ft): **85.7**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **8**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index: **F01**
 Within 8" of Joint: **YES**
 Remarks:

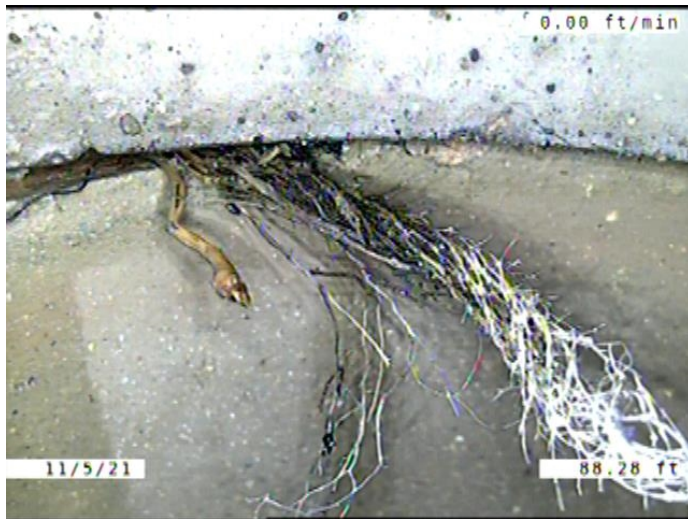


Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **88.3**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **10**
 Clock To: **11**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **MWL**
 Description: **Miscellaneous Water Level**

Distance (ft): **88.3**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

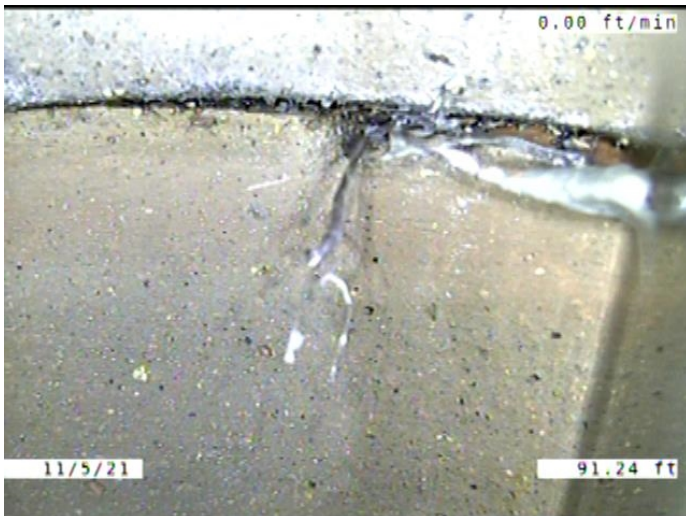


Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **91.2**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **3**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **RMJ**
 Description: **Roots Medium Joint**

Distance (ft): **94.4**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **9**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent: **10.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

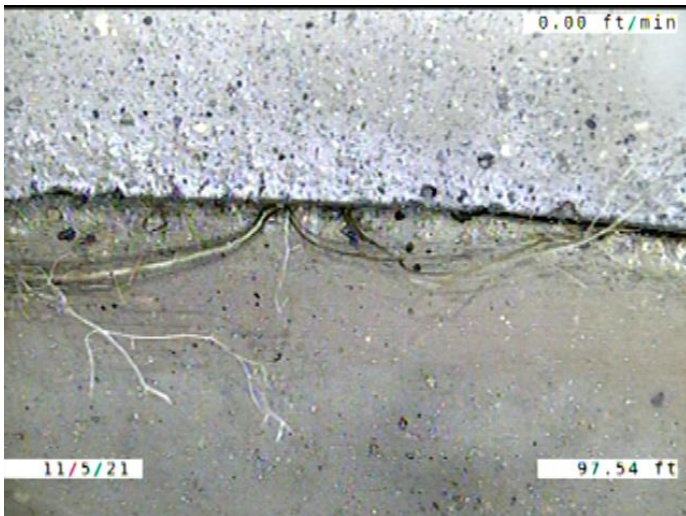


Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **97.5**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **11**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

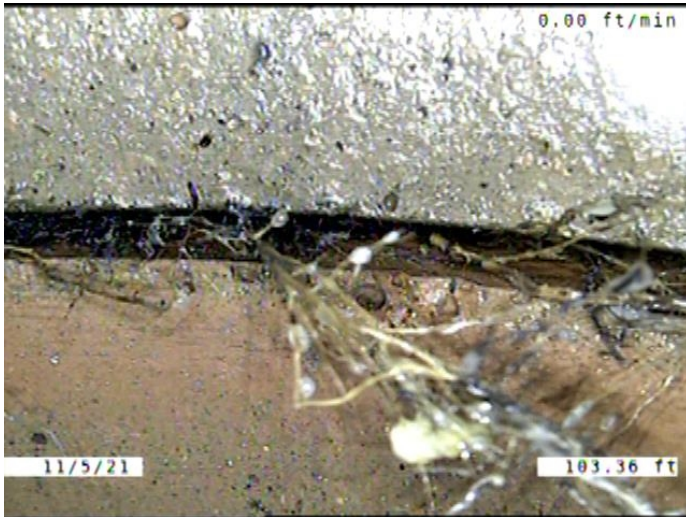


Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **103.4**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **1**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

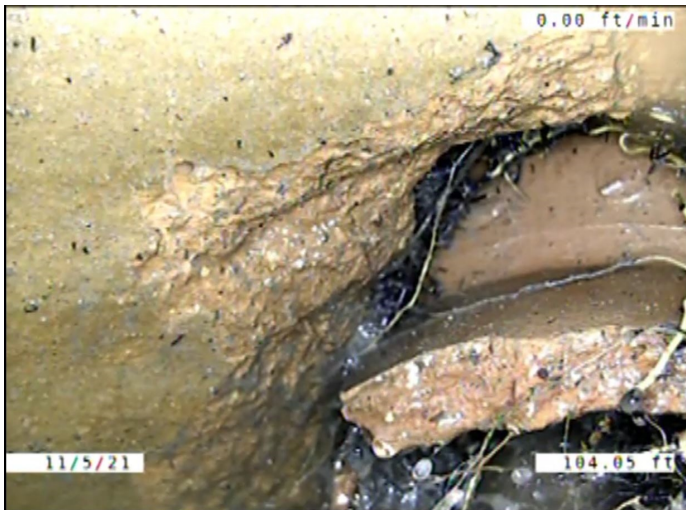


Code: **SSS**
 Description: **Surface Damage Surface Spalling**

Distance (ft): **104.1**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **10**
 Clock To: **12**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

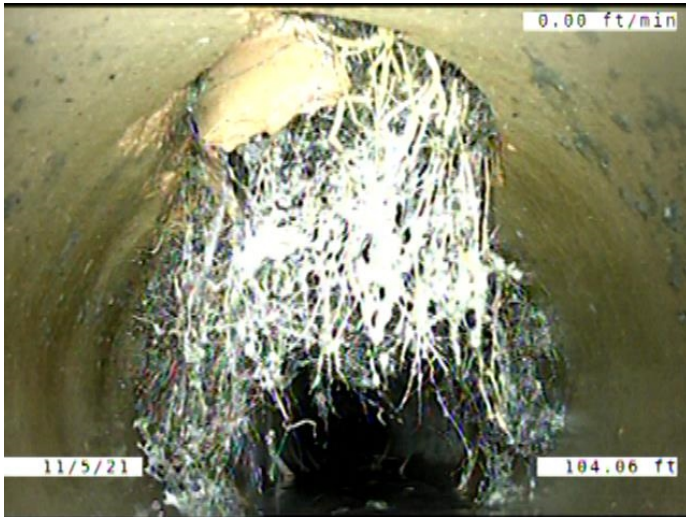

Code: **RMC**
Description: **Roots Medium Connection**

Distance (ft): **104.1**
Structural Grade: **0**
O&M Grade: **3**
Clock Start/From: **8**
Clock To: **4**
1st Value:
2nd Value:
Value Percent: **50.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:

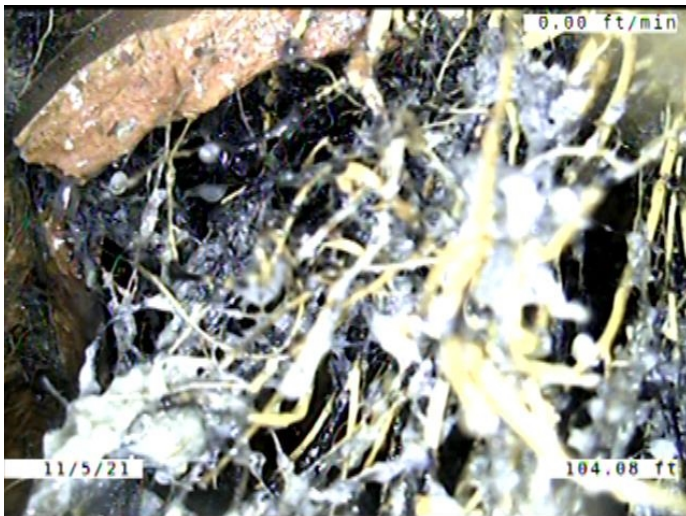

Code: **TBI**
Description: **Tap Break-in Intruding**

Distance (ft): **104.1**
Structural Grade: **0**
O&M Grade: **2**
Clock Start/From: **12**
Clock To:
1st Value: **4.000**
2nd Value: **1.000**
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:




Code: **DSF**
 Description: **Deposits Settled Fine**

Distance (ft): **105.2**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **S03**
 Within 8" of Joint: **YES**
 Remarks:




Code: **RFJ**
 Description: **Roots Fine Joint**


Distance (ft): **109.6**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **9**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index: **S04**
 Within 8" of Joint: **YES**
 Remarks:

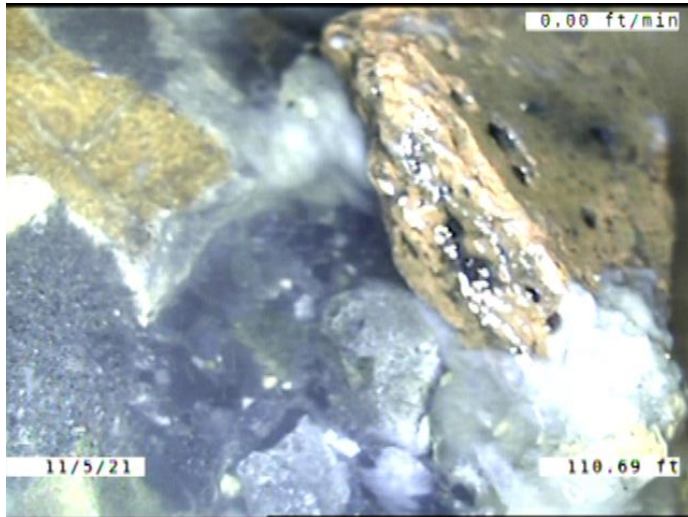

Code:	OBM
Description:	Obstruction Pipe Material in Invert
Distance (ft):	110.7
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	5
Clock To:	6
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

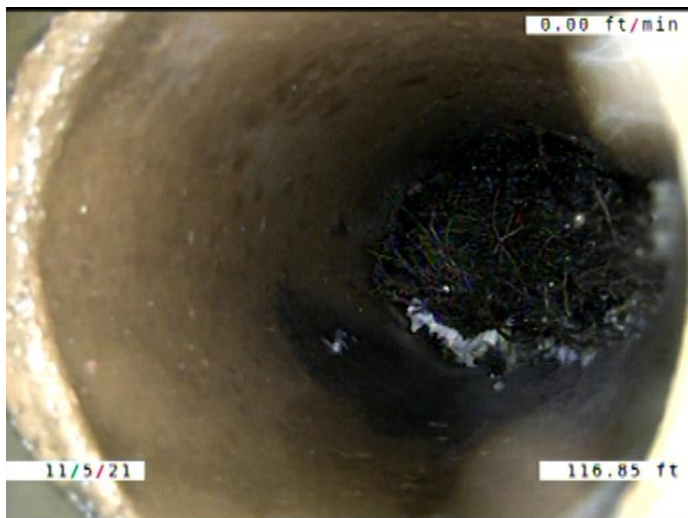


Code:	TBI
Description:	Tap Break-in Intruding
Distance (ft):	116.8
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	1
Clock To:	
1st Value:	4.000
2nd Value:	1.000
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	CONSTANTLY RUNNING WATER. LOOKS TO BE 100% PLUGGED WITH

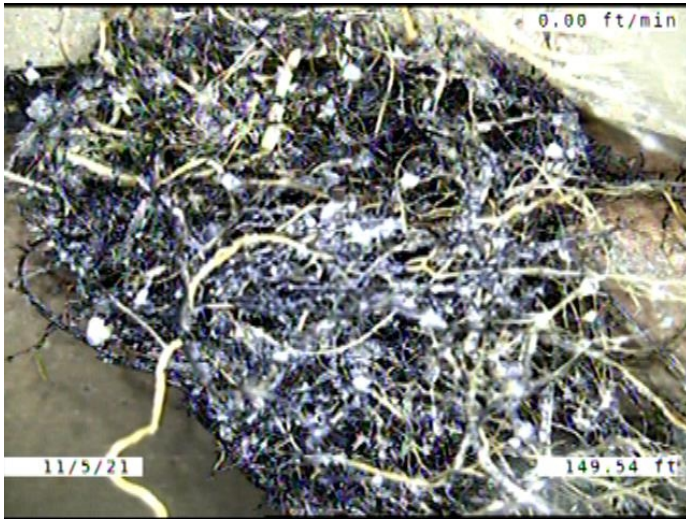


Code: **RMJ**
 Description: **Roots Medium Joint**

Distance (ft): **149.5**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **8**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

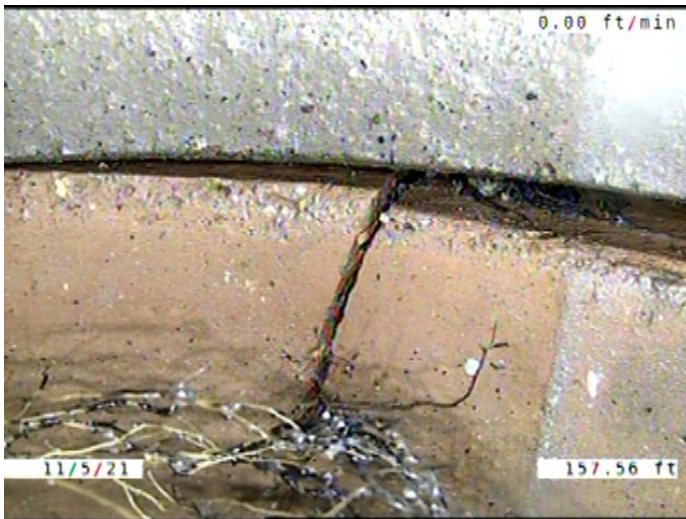


Code: **B**
 Description: **Broken**

Distance (ft): **157.6**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **8**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

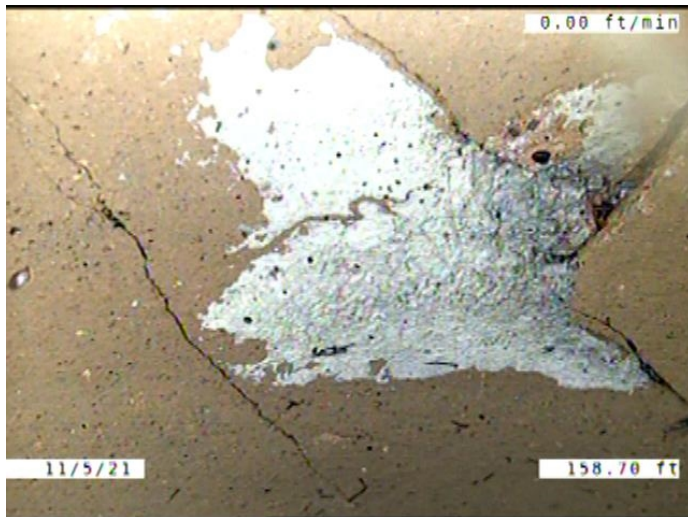


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **158.7**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **9**
 Clock To: **11**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

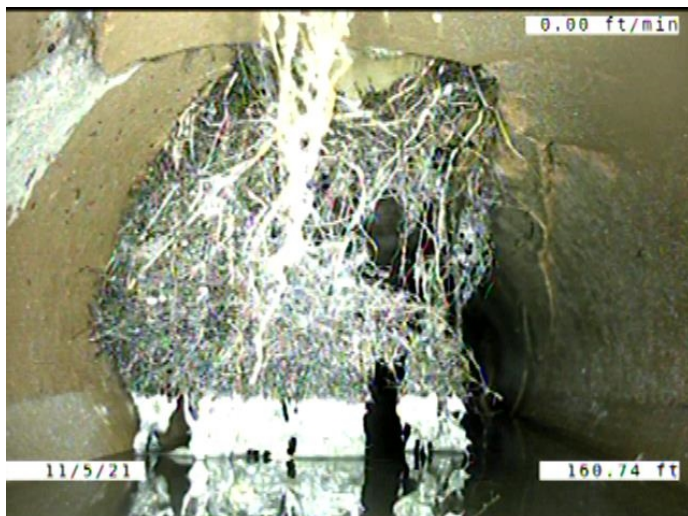

Code: **RMC**
 Description: **Roots Medium Connection**

Distance (ft): **160.7**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **10**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent: **50.000**
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

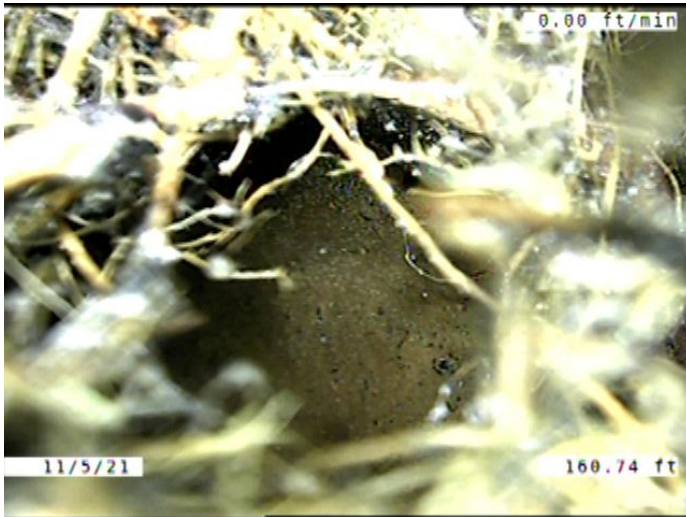


Code: **TBI**
 Description: **Tap Break-in Intruding**

Distance (ft): **160.7**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **12**
 Clock To:
 1st Value: **4.000**
 2nd Value: **1.000**
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **160.8**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **8**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

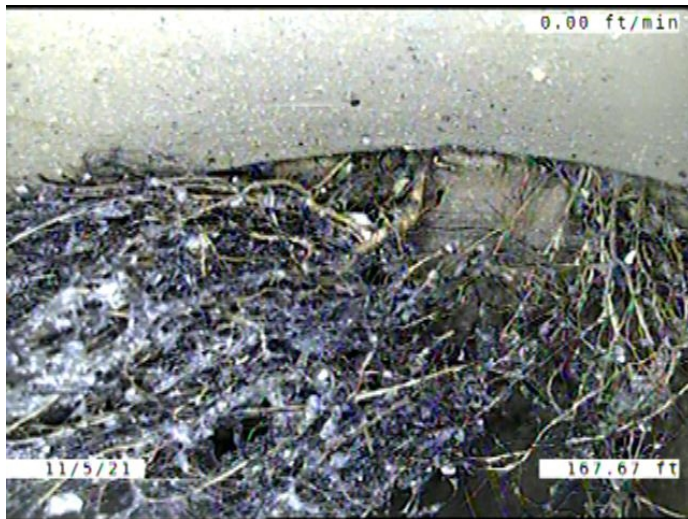


Code: **RMJ**
 Description: **Roots Medium Joint**

Distance (ft): **167.7**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **9**
 Clock To: **2**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

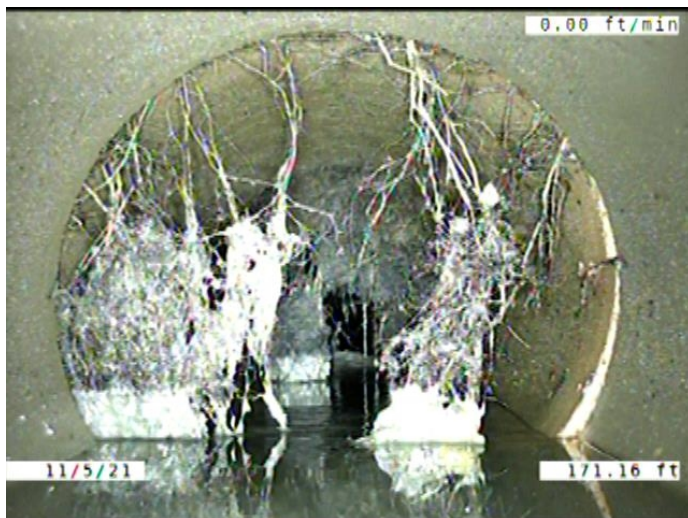


Code: **RMJ**
 Description: **Roots Medium Joint**

Distance (ft): **171.2**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **8**
 Clock To: **2**
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

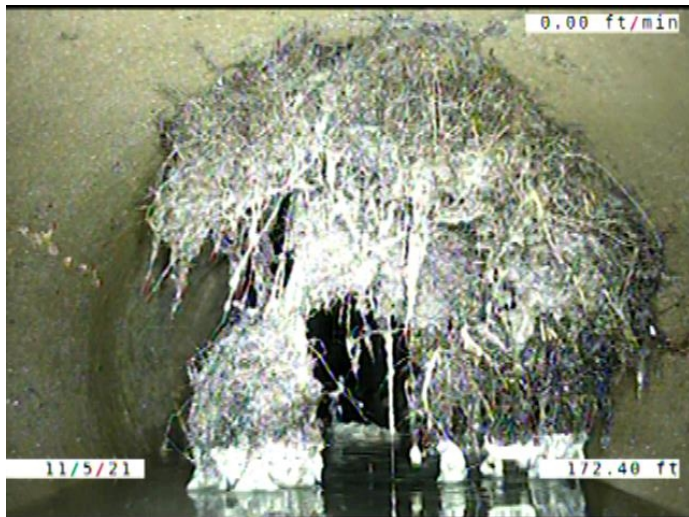


Code: **RMC**
 Description: **Roots Medium Connection**

Distance (ft): **172.4**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **10**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent: **50.000**
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

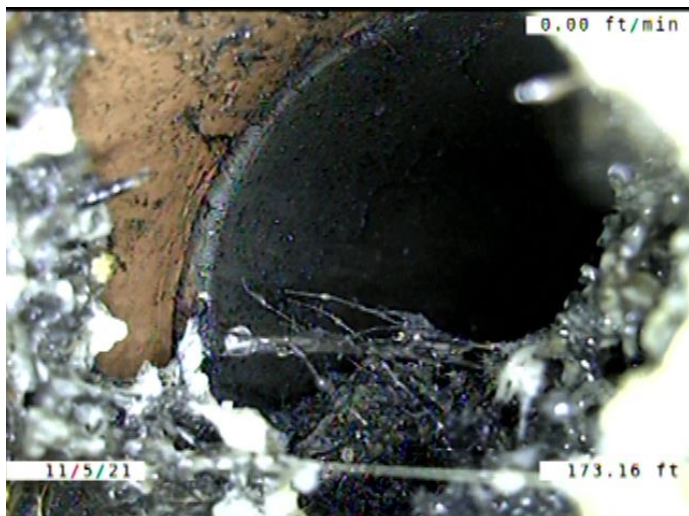


Code: **TBD**
 Description: **Tap Break-in/Hammer Defective**

Distance (ft): **173.2**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **12**
 Clock To:
 1st Value: **4.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **ROOTS GROWING OUT OF THE TAP AND INTO THE MAIN. ROOTS ALSO**

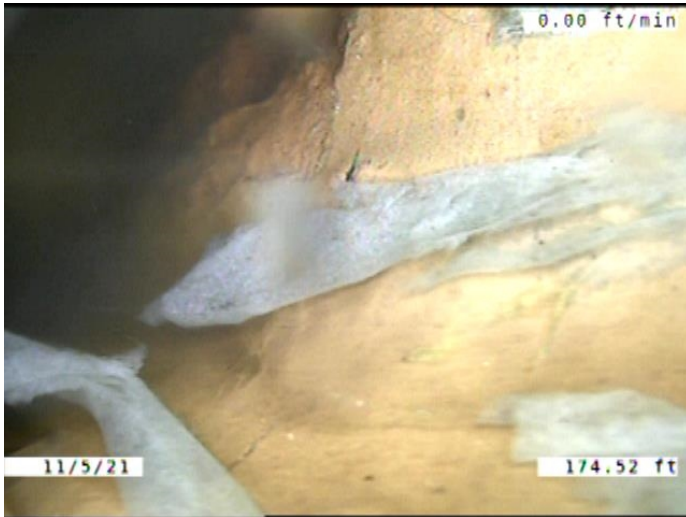


Code: **OBM**
 Description: **Obstruction Pipe Material in Invert**

Distance (ft): **174.5**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **4**
 Clock To: **8**
 1st Value:
 2nd Value:
 Value Percent: **10.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

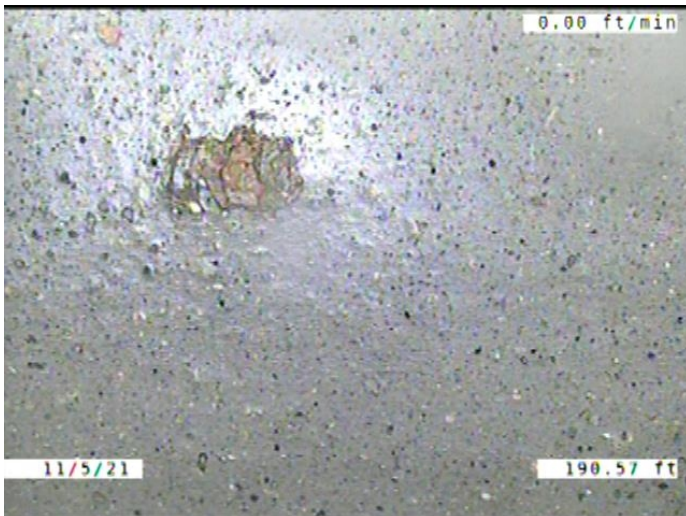

Code: **SSS**
 Description: **Surface Damage Surface Spalling**

Distance (ft): **190.6**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

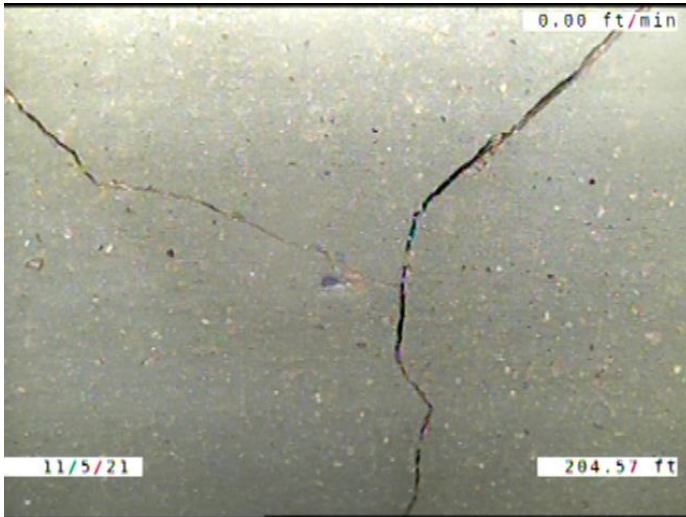


Code: **FM**
 Description: **Fracture Multiple**

Distance (ft): **204.6**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **11**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **B**
 Description: **Broken**

Distance (ft): **207.1**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **12**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

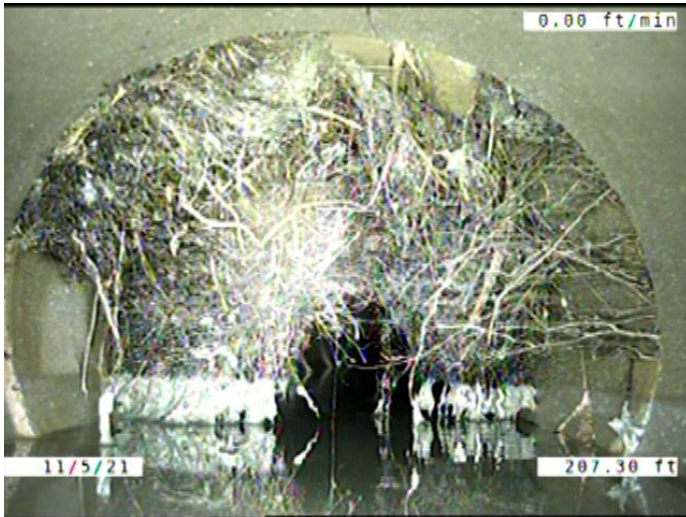

Code: **RBB**
 Description: **Roots Ball Barrel**

Distance (ft): **207.3**
 Structural Grade: **0**
 O&M Grade: **5**
 Clock Start/From: **9**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent: **75.000**
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:




Code: **TBD**
 Description: **Tap Break-in/Hammer Defective**

Distance (ft): **209.3**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **11**
 Clock To:
 1st Value: **4.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **ROOTS GROWING AROUND IT AND INTO THE MAIN**




Code: **RMJ**
 Description: **Roots Medium Joint**

Distance (ft): **222.4**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **9**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

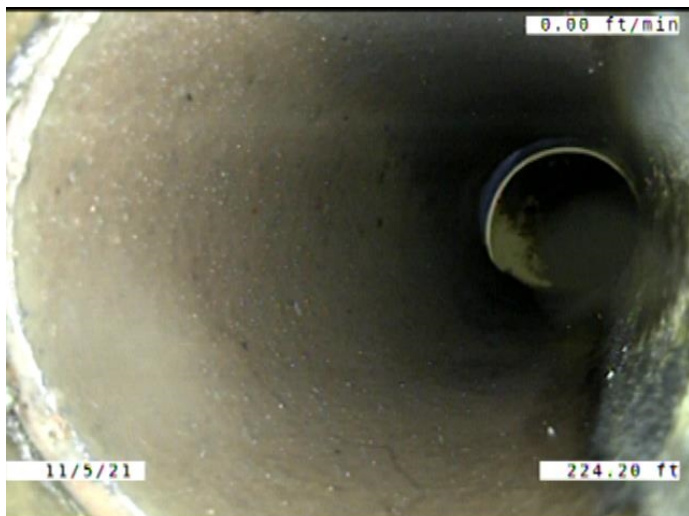


Code: **TBI**
 Description: **Tap Break-in Intruding**

Distance (ft): **224.2**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **12**
 Clock To:
 1st Value: **4.000**
 2nd Value: **2.000**
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **CONSTANTLY RUNNING WATER**

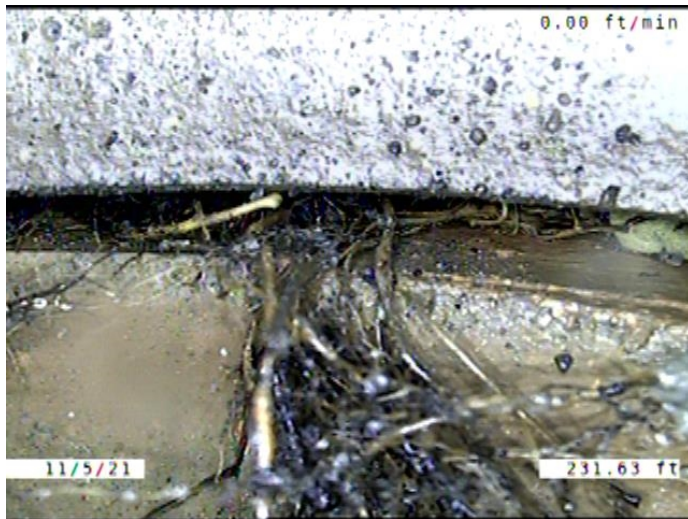

Code: **RMJ**
 Description: **Roots Medium Joint**

Distance (ft): **231.6**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **2**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

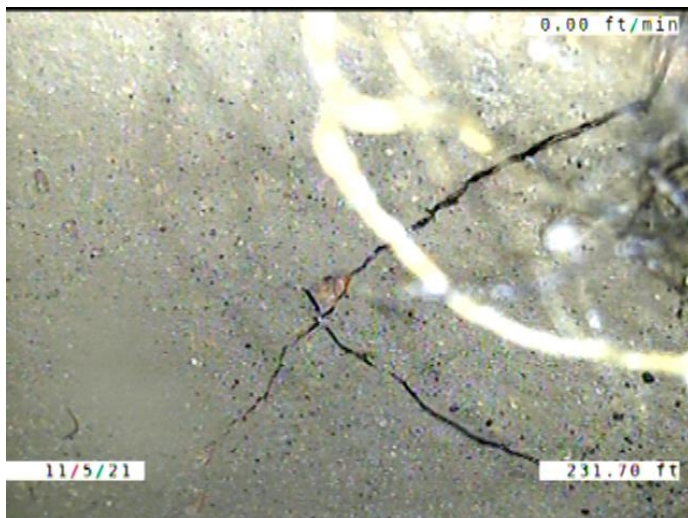


Code: **FS**
 Description: **Fracture Spiral**

Distance (ft): **231.7**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **2**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **RFJ**
Description: **Roots Fine Joint**

Distance (ft): **232.9**
Structural Grade: **0**
O&M Grade: **1**
Clock Start/From: **9**
Clock To: **3**
1st Value:
2nd Value:
Value Percent:
Continuous Index: **F04**
Within 8" of Joint: **YES**
Remarks:

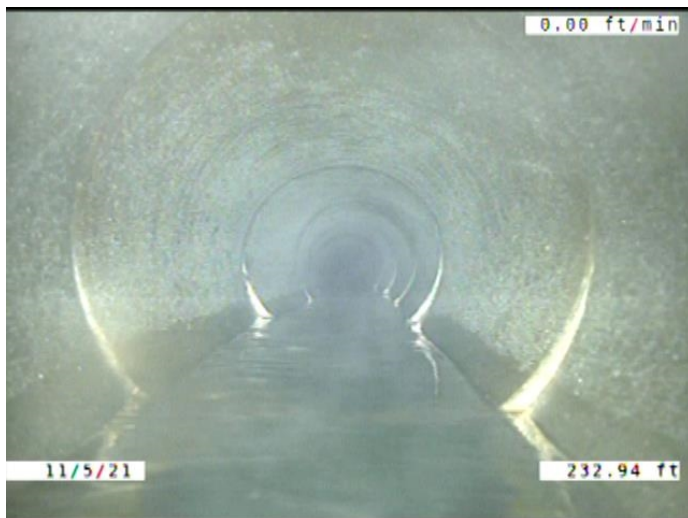

Code: **DSF**
Description: **Deposits Settled Fine**

Distance (ft): **232.9**
Structural Grade: **0**
O&M Grade: **2**
Clock Start/From: **5**
Clock To: **7**
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index: **F03**
Within 8" of Joint: **YES**
Remarks:



Code:	MSA
Description:	Miscellaneous Survey Abandoned
Distance (ft):	233.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	MADE IT TO THE POINT OF OVERLAP. REVERSAL COMPLETE.