Profile/Ph	oto Observation	n Report			RedZone
Date: Pipe Length (ft P.O.#: Customer:	04/13/2018): 235.6	Weather: Owner: Surveyor: Clean Date:	NA Jen Costello 01/01/1900	Coding: Pre Clean: PSR: Shape:	PACP 6.0 No Pre-Cleaning P-505-012-011 C
Street:	FOXCROFT STREET	т	Flow Control:	Not Controlle	d
City:	Hobart, IN		Year Renewed:		
Location:	Yard		Tape/Media #:		
Purpose:	Routine Assessme	ent	Dia/Height:	10"	
Use:	Sanitary		Material:	VCP	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:	Flow direction is r	narked wrong.			
Location Detai	ls:		Direction of Surv	/ey: Downstream	
US MH:	M-505-011	DS MH:	M-505-012	Total Length Surveyed (f	t): 191.4
D&M Index:	2.00	O&M Quick:	2C0	O O&M Rating:	42.00
Structural Index:	0.00	Structural Qu	uick: 000	O Structural Rating	.000
Overall Index:	2.00	Overall Quicl	k: 2C0	Overall Rating:	42.00

Position	Code	Observation	Video (sec)	Grade
M(505-011				
.0	AMH	Manhole	10	NA
\ \0	MWL	Water Level	21	NA
7.4	TF	Tap Factory	48	NA
67.5	TF	Tap Factory	180	NA
88.9	DAE	Deposits Attached Encrustation	234	M 2
92.1	DAE	Deposits Attached Encrustation	252	M 2
94.7	TF	Tap Factory	269	NA
107.2	DAE(S01)	Deposits Attached Encrustation	306	M 2
139.5	TF	Tap Factory	382	NA
153.2	TF	Tap Factory	422	NA
182.3	IW(S02)	Infil Weeper	494	M 2
191.4	IW(F02)	Infil Weeper	526	M 2
191.4	DAE(F01)	Deposits Attached Encrustation	537	M 2
191.4	MSA	Abandoned Survey	548	NA
	.0 .0 7.4 67.5 88.9 92.1 94.7 107.2 139.5 153.2 182.3 191.4 191.4	L1 .0 AMH .0 MWL 7.4 TF 67.5 TF 88.9 DAE 92.1 DAE 94.7 TF 107.2 DAE(S01) 139.5 TF 153.2 TF 182.3 IW(S02) 191.4 IW(F02) 191.4 DAE(F01)	1.0AMHManhole.0MWLWater Level7.4TFTap Factory67.5TFTap Factory88.9DAEDeposits Attached Encrustation92.1DAEDeposits Attached Encrustation94.7TFTap Factory107.2DAE(S01)Deposits Attached Encrustation139.5TFTap Factory153.2TFTap Factory182.3IW(S02)Infil Weeper191.4IW(F02)Infil Weeper191.4DAE(F01)Deposits Attached Encrustation	1.0AMHManhole10.0MWLWater Level217.4TFTap Factory4867.5TFTap Factory18088.9DAEDeposits Attached Encrustation23492.1DAEDeposits Attached Encrustation25294.7TFTap Factory269107.2DAE(S01)Deposits Attached Encrustation306139.5TFTap Factory382153.2TFTap Factory422182.3IW(S02)Infil Weeper494191.4IW(F02)Infil Weeper526191.4DAE(F01)Deposits Attached Encrustation537



Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-505-011

M-505-012



Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	TF Tap Factory
Distance (ft):	7.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

Tuesday, December 8, 2020



Code:	TF
Description:	Tap Factory

Distance (ft):	67.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




Code:	DAE
Description:	Deposits Attached Encrustation

Distance (ft):	88.9	
Structural Grade:	0	
O&M Grade:	2	
Clock Start/From:	8	
Clock To:	4	
1st Value:		
2nd Value:		
Value Percent:	5.000	
Continuous Index:		
Within 8" of Joint:	YES	
Remarks:		



Code:DAEDescription:Deposits Attached Encrustation

Distance (ft):	92.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

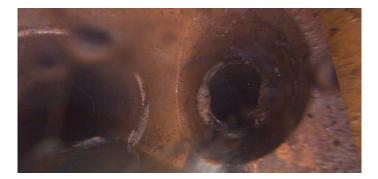


Code: Description:	TF Tap Factory
Distance (ft):	94.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




Code:DAEDescription:Deposits Attached Encrustation

Distance (ft):	107.2
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S01
Within 8" of Joint:	YES
Remarks:	

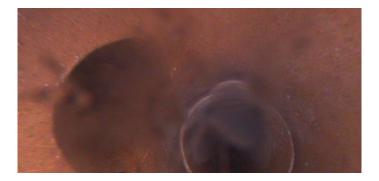


Code: Description:	TF Tap Factory
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	139.5 0 0 9 4.000
Nerrianio.	

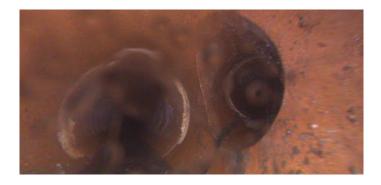

Code:	TF
Description:	Tap Factory

Distance (ft):	153.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

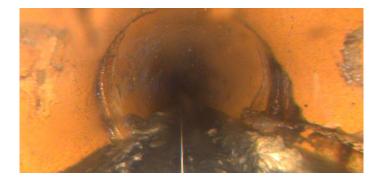

Code:	IW
Description:	Infil Weeper
Distance (ft):	182.3
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	S02
Within 8" of Joint:	YES
Remarks:	



Code:	IW
Description:	Infil Weeper

Distance (ft):	191.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	F02
Within 8" of Joint:	YES
Remarks:	

Code:



Description:	Deposits Attached Encrustation
Distance (ft):	191.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2 nd Values	

DAE

2nd Value:Value Percent:**5.000**Continuous Index:**F01**Within 8" of Joint:**YES**Remarks:



Code: Description: MSA Abandoned Survey

Distance (ft):	191.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	debris

NO debris under water