
Profile/Ph	oto Observation	Report			RedZor
Date:	04/14/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft	z): <b>247.2</b>	Owner:	NA	Pre Clean:	No Pre-Cleaning
P.O.#:		Surveyor:	Jen Costello	PSR:	P-505-097-079
Customer:		Clean Date:	01/01/1900	Shape:	С
Street:	W 4TH PL		Flow Control:	Not Controlled	
City:	Hobart, IN		Year Renewed:		
Location:	Yard		Tape/Media #:		
Purpose:	<b>Routine Assessmer</b>	nt	Dia/Height:	10"	
Use:	Sanitary		Material:	VCP	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:					
Location Detai	ls:		Direction of Sur	rvey: Downstream	
US MH:	M-505-097	DS MH:	M-505-079	Total Length Surveyed (ft)	): <b>141.7</b>
D&M Index:	2.20	O&M Quick:	32	28 O&M Rating:	22.00
Structural Index	0.00	Structural Qu	uick: 00		0.00
Overall Index:	2.20	Overall Quick			22.00

	Position	Code	Observation	Video (sec)	Grade
M(505-)0	97				
	.0	AMH	Manhole	10	NA
	.0	MWL	Water Level	21	NA
	16.9	MMC	Material Change	66	NA
	21.4	TFA	Tap Factory Active	89	NA
	22.4	MMC	Material Change	104	NA
	27.1	DAE	Deposits Attached Encrustation	125	M 2
	37.0	DAE	Deposits Attached Encrustation	156	M 2
	38.2	TFA	Tap Factory Active	171	NA
	40.2	TFA	Tap Factory Active	189	NA
_ <del></del> /`	40.9	IS	Infil Stain	203	NA
	45.8	RMJ	Roots Medium Joint	224	M 3
	10.8	DAE	Deposits Attached Encrustation	246	M 2
	55.8	DAE	Deposits Attached Encrustation	267	M 2
5	70.5	DAE	Deposits Attached Encrustation	307	M 2
	140.2	IW	Infil Weeper	458	M 2
	140.2	DAE	Deposits Attached Encrustation	468	M 2
	140.9	TBD	Tap Break-in Defective	481	M 3
	140.9	DAE	Deposits Attached Encrustation	491	M 2
	141.7	MSA	Abandoned Survey	504	NA



Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-505-097

M(505)079

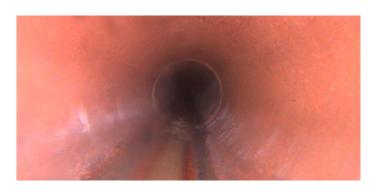

Code: MWL Description: Water Level

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: 5.000 Continuous Index: Within 8" of Joint: NO Remarks:

Code:

Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Description:	Material Change	
Distance (ft):	16.9	
Structural Grade:	0	
O&M Grade:	0	
Clock Start/From:		
Clock To:		
1st Value:		
2nd Value:		

NO

pvc

MMC



Code:TFADescription:Tap Factory Active


Distance (ft):	21.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

Remarks:



Code: Description:	MMC Material Change
Distance (ft):	22.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO


VCP

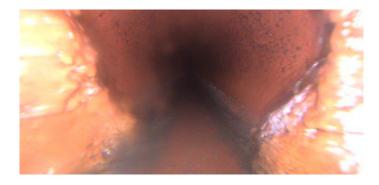

Distance (ft):	27.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

Code: DAE Description: Deposits At

Deposits Attached Encrustation

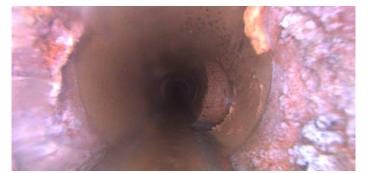

Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value:	37.0 0 2 8 4
Value Percent: Continuous Index: Within 8" of Joint: Remarks:	10.000 YES



Code:TFADescription:Tap Factory Active

Distance (ft):	38.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




Code:	TFA
Description:	Tap Factory Active
Distance (ft):	40.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




Code:	IS
Description:	Infil Stain

Distance (ft):	40.9
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	5
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

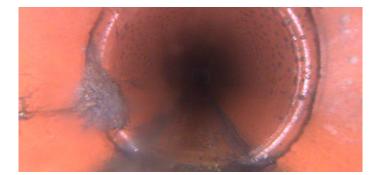

Code:	RMJ
Description:	Roots Medium Joint

Distance (ft):	45.8
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	8
Clock To:	9
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

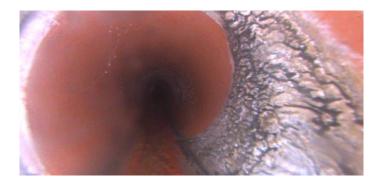

Distance (ft):	50.8
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

Code:


Description:

Remarks:

Distance (ft):	55.8
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	YES

DAE

**Deposits Attached Encrustation** 

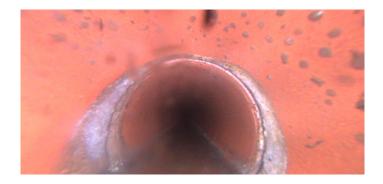

Distance (ft):	70.5
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



IW Infil Weeper
140.2
0
2
1
4
YES



Distance (ft):	140.2
Distance (It).	140.2
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	1
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

Code:

Remarks:



Description:	Tap Break-in Defective
Distance (ft): Structural Grade:	140.9 0
O&M Grade:	3
Clock Start/From: Clock To:	10
1st Value: 2nd Value:	4.000
Value Percent:	
Continuous Index:	
Within 8" of Joint:	

DAE

TBD



Distance (ft):	140.9
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	9
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

Code:	
Description:	

MSA Abandoned Survey

Distance (ft):	141.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	DAE