

Profile/Photo Observation Report





Date:	02/05/2022	Weather:		Coding:	PACP 7.0
Pipe Length (ft):	278.1	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-506-006-005
Customer:	City of Hobart	Clean Date:	02/02/2022	Shape:	C

Street:	South 8th Street	Flow Control:	Not Controlled
City:	Hobart, IN	Year Renewed:	
Location:	Easement/Right of Way	Tape/Media #:	
Purpose:	Routine Assessment	Dia/Height:	12"
Use:	Sanitary Sewage Pipe	Material:	VCP
Drain Area:		Lining:	None
Category:	NA		

Comment:		Direction of Survey:	Upstream
Location Details:			
US MH:	M-506-006	DS MH:	M-506-005
		Total Length Surveyed (ft):	278.1


O&M Index:	2.02	O&M Quick:	312I	O&M Rating:	107.00
Structural Index:	2.00	Structural Quick:	2A00	Structural Rating:	20.00
Overall Index:	2.02	Overall Quick:	312K	Overall Rating:	127.00

	Position	Code	Observation	Video (sec)	Grade
					
	.0	AMH	Manhole	3	NA
	.0	MWL	Miscellaneous Water Level	63	NA
	5.8	TFA	Tap Factory Activity	109	NA
	10.7	DAE(S01)	Deposits Attached Encrustation	173	M 2
	12.2	TFD	Tap Factory Defective	211	M 3
	61.6	MWL	Miscellaneous Water Level	383	NA
	77.4	TF	Tap Factory	442	NA
	83.4	TF	Tap Factory	482	NA
	122.5	MWLS(S02)	Miscellaneous Water Level Sag	604	S 2
	137.8	MWLS(F02)	Miscellaneous Water Level Sag	666	S 2
	153.1	MWLS(S03)	Miscellaneous Water Level Sag	722	S 2
	161.1	TF	Tap Factory	761	NA
	175.0	TF	Tap Factory	826	NA
	175.3	MWLS(F03)	Miscellaneous Water Level Sag	844	S 2
	240.3	TF	Tap Factory	1039	NA
	258.3	MWLS(S04)	Miscellaneous Water Level Sag	1112	S 2
	272.3	MWLS(F04)	Miscellaneous Water Level Sag	1170	S 2
	272.3	DAE(F01)	Deposits Attached Encrustation	1179	M 2
	278.1	AMH	Manhole	1313	NA
M-506-006					

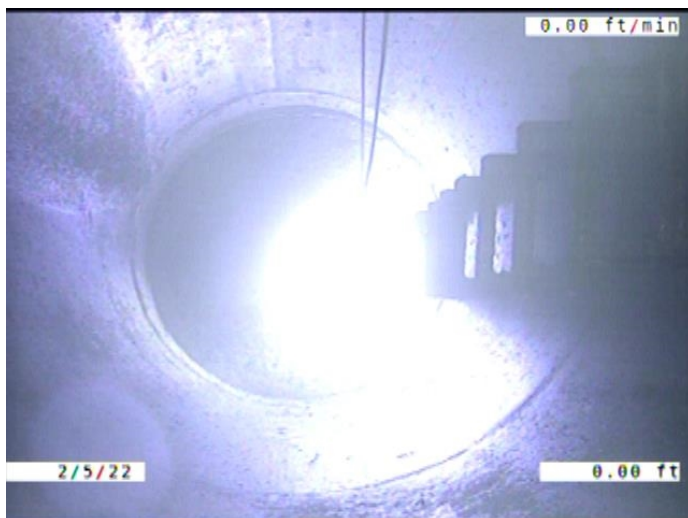


Code: **AMH**
 Description: **Manhole**

 Distance (ft): **.0**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks: **M-506-005**

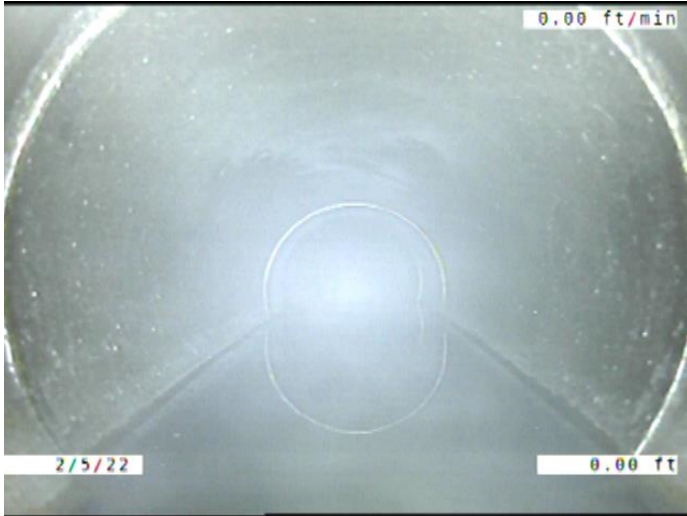


Code: **MWL**
Description: **Miscellaneous Water Level**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **15.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:

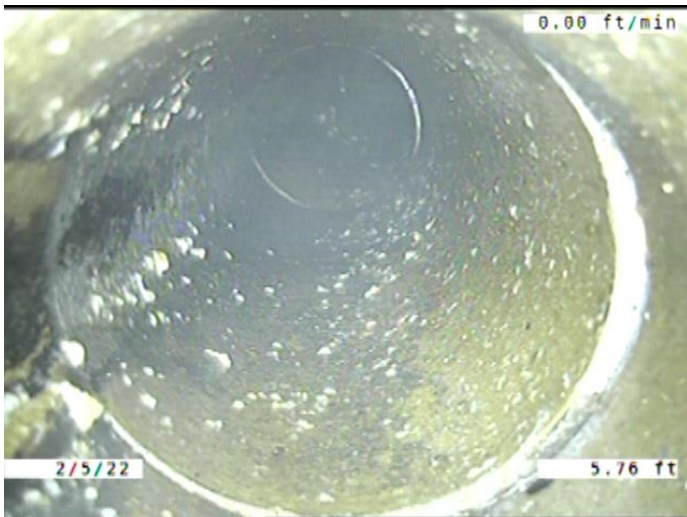


Code: **TFA**
Description: **Tap Factory Activity**

Distance (ft): **5.8**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From: **11**
Clock To:
1st Value: **6.000**
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

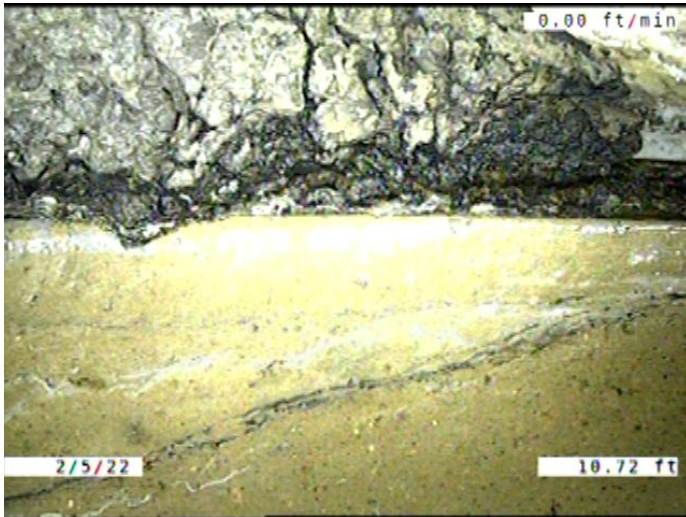


Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **10.7**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **9**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **S01**
 Within 8" of Joint: **YES**
 Remarks:

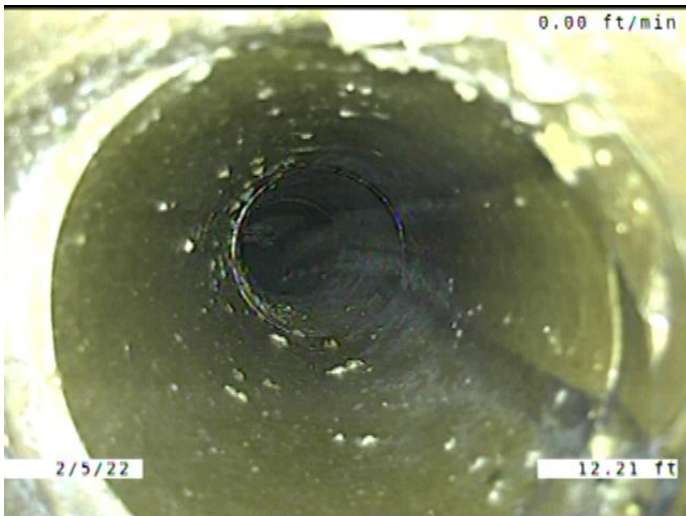


Code: **TFD**
 Description: **Tap Factory Defective**

Distance (ft): **12.2**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **1**
 Clock To:
 1st Value: **6.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **BROKEN.**

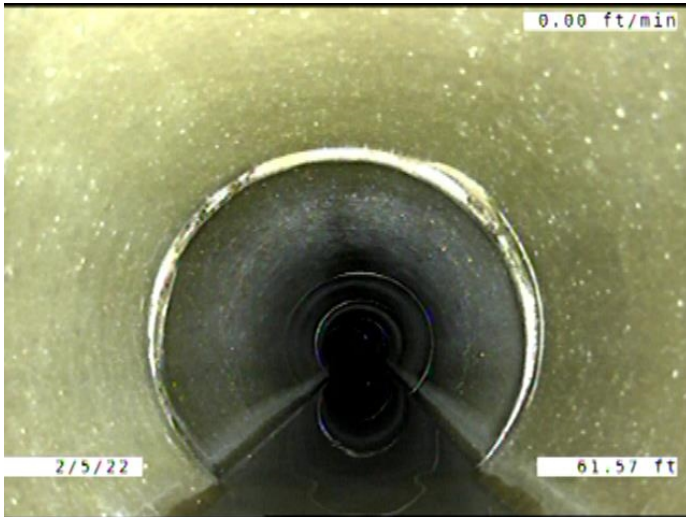


Code: **MWL**
 Description: **Miscellaneous Water Level**

Distance (ft): **61.6**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

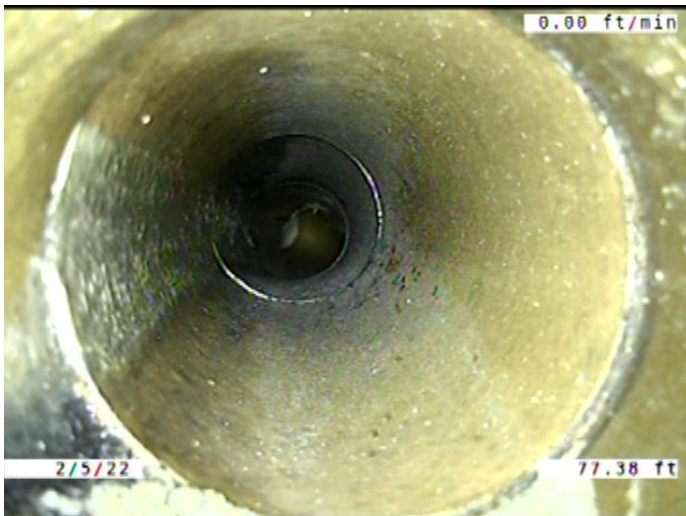


Code: **TF**
 Description: **Tap Factory**

Distance (ft): **77.4**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From: **11**
 Clock To:
 1st Value: **6.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **CONSTANTLY RUNNING WATER.**

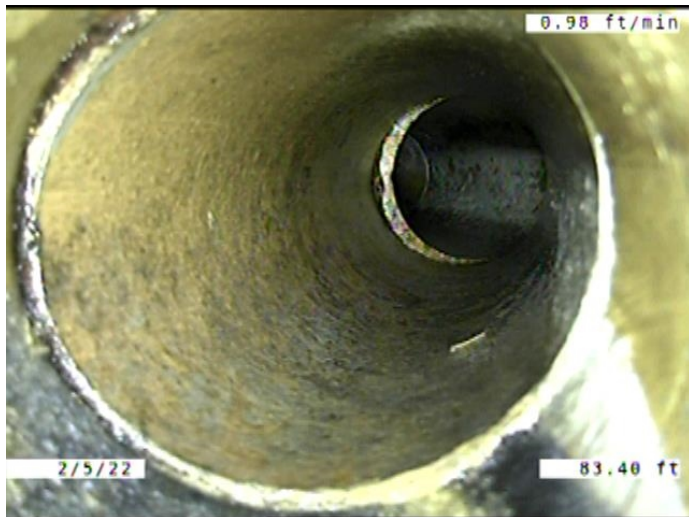


Code: **TF**
 Description: **Tap Factory**

Distance (ft): **83.4**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To:
 1st Value: **6.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **CONSTANTLY RUNNING WATER.**

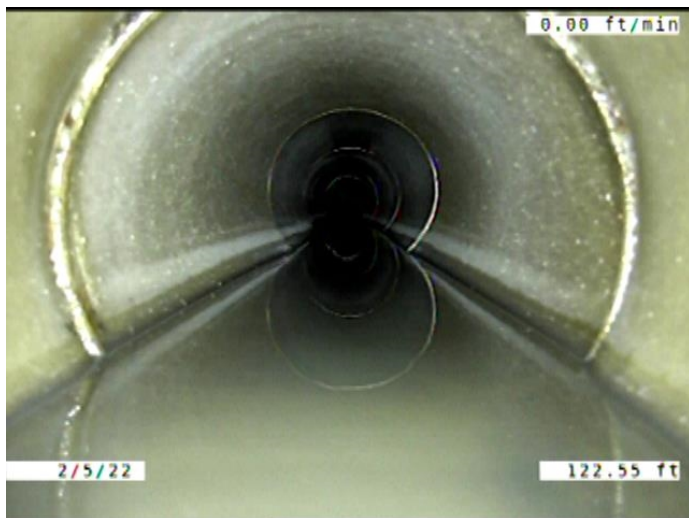


Code: **MWLS**
 Description: **Miscellaneous Water Level Sag**

Distance (ft): **122.5**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent: **10.000**
 Continuous Index: **S02**
 Within 8" of Joint: **NO**
 Remarks:

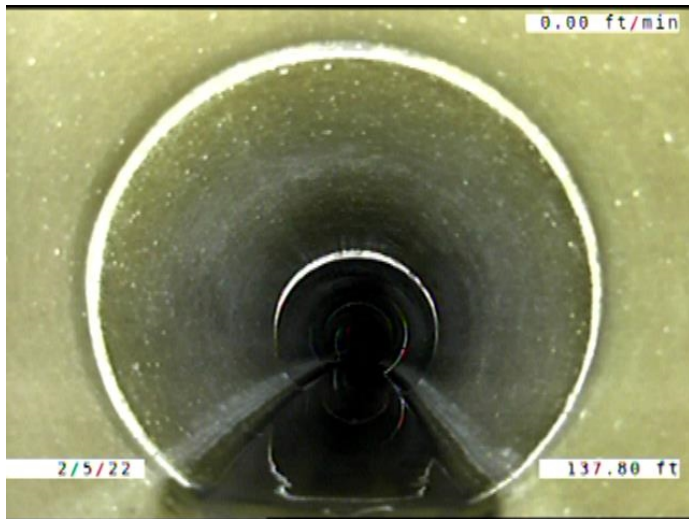

Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **137.8**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **F02**
Within 8" of Joint: **NO**
Remarks:

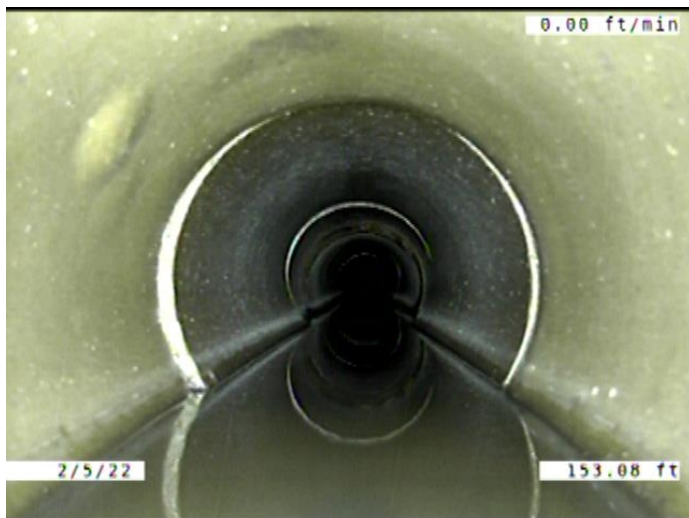


Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **153.1**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **S03**
Within 8" of Joint: **NO**
Remarks:



Code: **TF**
 Description: **Tap Factory**

Distance (ft): **161.1**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From: **1**
 Clock To:
 1st Value: **6.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **CONSTANTLY DRIPPING WATER.
 ENCRUSTATION COMING FROM THE**

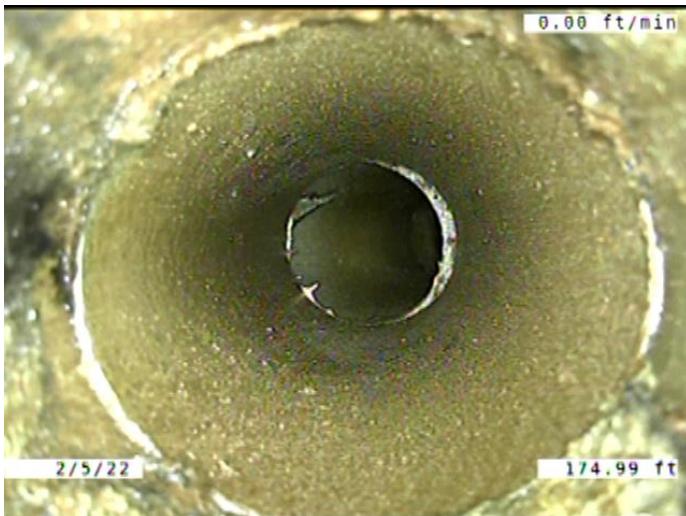

Code: **TF**
 Description: **Tap Factory**

Distance (ft): **175.0**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From: **11**
 Clock To:
 1st Value: **6.000**
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks: **ENCRUSTATION COMING FROM THE
 SERVICE TO MAIN CONNECTION.**



Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **175.3**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **10.000**
Continuous Index: **F03**
Within 8" of Joint: **NO**
Remarks:




Code: **TF**
Description: **Tap Factory**

Distance (ft): **240.3**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From: **1**
Clock To:
1st Value: **6.000**
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **ENCRUSTATION COMING FROM THE SERVICE TO MAIN CONNECTION.**




Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **258.3**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **15.000**
Continuous Index: **S04**
Within 8" of Joint: **NO**
Remarks:

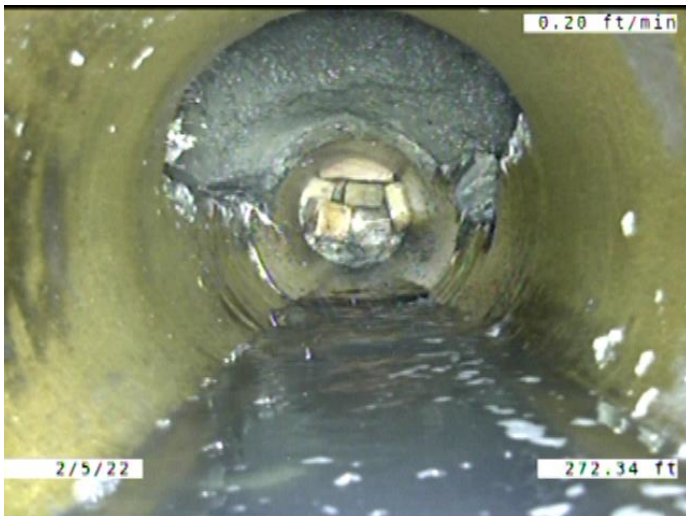


Code: **MWLS**
Description: **Miscellaneous Water Level Sag**

Distance (ft): **272.3**
Structural Grade: **2**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **15.000**
Continuous Index: **F04**
Within 8" of Joint: **NO**
Remarks:

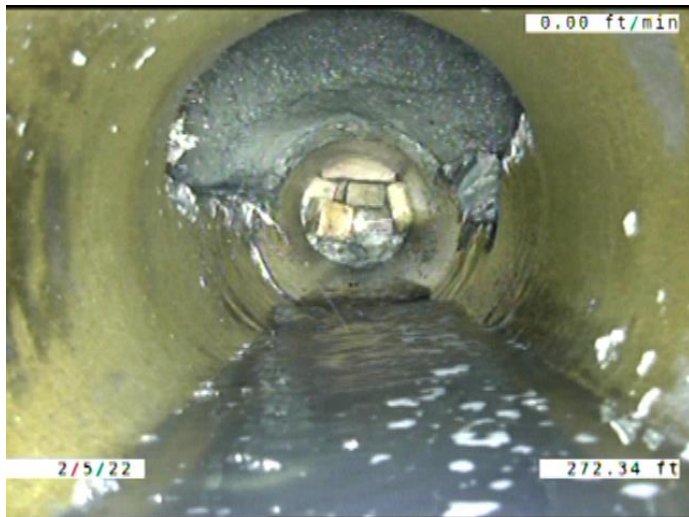

Code: **DAE**
 Description: **Deposits Attached Encrustation**

Distance (ft): **272.3**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **9**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **F01**
 Within 8" of Joint: **YES**
 Remarks:

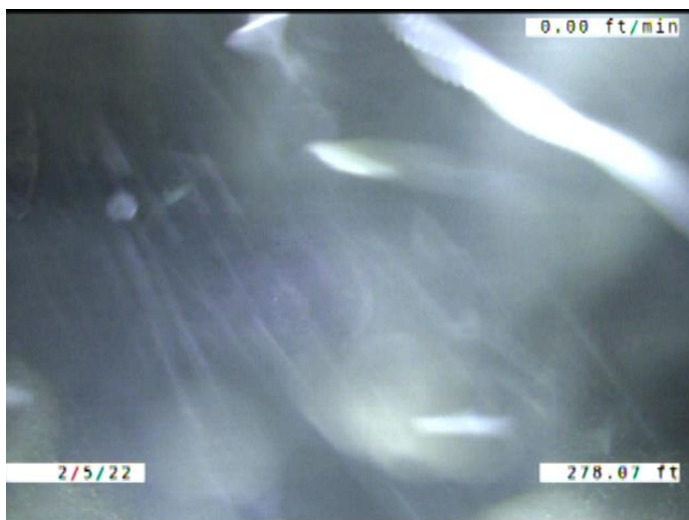

Code: **AMH**
 Description: **Manhole**

Distance (ft): **278.1**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks: **M-506-006**