
Date:	01/18/2022	Weather:		Coding:	PACP 7.0
Pipe Length (ft)	53.6	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-506-025-024
Customer:	City of Hobart	Clean Date:	01/16/2021	Shape:	С
Street:	River Terrace		Flow Control:	Not Controlled	l
City:	Hobart, IN		Year Renewed:		
Location:	Local rural streets	with light traffic	, t Tape/Media #:		
Purpose:	Routine Assessme	ent	Dia/Height:	10"	
Use:	Sanitary Sewage I	Pipe	Material:	VCP	
Drain Area:			Lining:	None	
Category:	NA				
Comment:					
Location Details	:		Direction of Surv	vey: Upstream	
US MH:	M-506-024	DS MH:	M-506-025	Total Length Surveyed (ft): 53.6
0&M Index:	2.00	O&M Quick:	2B0	0 O&M Rating:	38.00
Structural Index:	2.00	Structural Qu	uick: 240	0 Structural Rating:	8.00
Overall Index:	2.00	Overall Quic			46.00


	Position	Code	Observation	Video (sec)	Grade
M-506-0)25				
\leq	0.	AMH	Manhole	1	NA
	.0	MWL	Miscellaneous Water Level	89	NA
	.5	MWLS(S01)	Miscellaneous Water Level Sag	109	S 2
	.5	DSF(S02)	Deposits Settled Fine	117	M 2
	11.7	DAE(S03)	Deposits Attached Encrustation	210	M 2
	13.0	MWLS(F01)	Miscellaneous Water Level Sag	234	S 2
	16.8	TFC	Tap Factory Capped	259	NA
·	37.4	MWLS(S04)	Miscellaneous Water Level Sag	339	S 2
	39.0	TF	Tap Factory	358	NA
5	46.2	MWLS(F04)	Miscellaneous Water Level Sag	396	S 2
e CT	49.5	DSF(F02)	Deposits Settled Fine	419	M 2
	49.5	DSC	Deposits Settled Hard/Compacted	427	M 2
Camera Direction	52.0	DAE(F03)	Deposits Attached Encrustation	447	M 2
	53.6	AMH	Manhole	528	NA

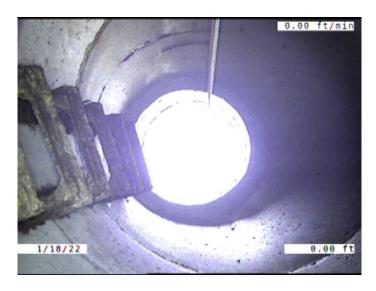

Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-506-025

Tuesday, April 25, 2023

M(506)024

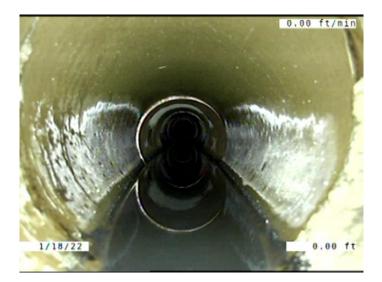


Code:	MWL
Description:	Miscellaneous Water Level
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	.5
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	S01
Within 8" of Joint:	NO
Remarks:	




Code:	DSF
Description:	Deposits Settled Fine
	-
Distance (ft):	.5
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	5
Clock To:	7
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S02
Within 8" of Joint:	YES
Remarks:	

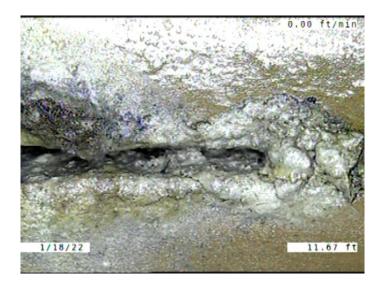


Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value:	11.7 0 2 8 4
2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	5.000 S03 YES



Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	13.0
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	F01
Within 8" of Joint:	NO
Remarks:	

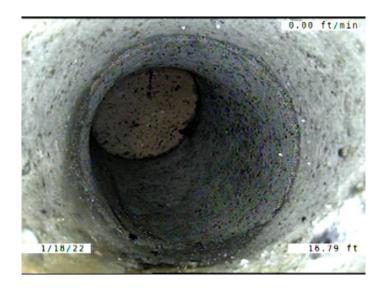

Code: Description:	TFC Tap Factory Capped
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	16.8 0 0 11 4.000 YES

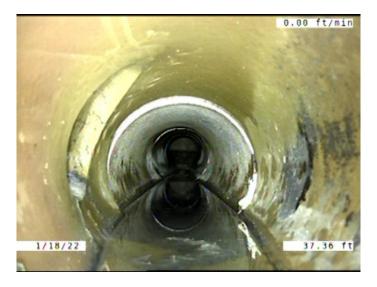


Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	37.4
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	S04
Within 8" of Joint:	NO



Distance (ft): 39.0	
Structural Grade: 0	
O&M Grade: 0	
Clock Start/From: 10	
Clock To:	
1st Value: 4.000	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint: YES	
Remarks:	


Remarks:

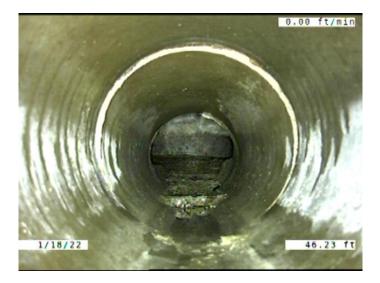

Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	46.2
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	F04
Within 8" of Joint:	NO
Remarks:	




Description: Deposits	s Settled Fine
Distance (ft):49.5Structural Grade:0O&M Grade:2Clock Start/From:5Clock To:71st Value:72nd Value:5.000Value Percent:5.000Continuous Index:F02Within 8" of Joint:YESRemarks:	

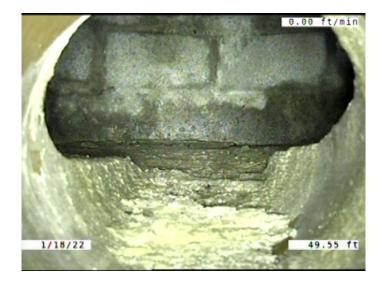

Code: Description:	DSC Deposits Settled Hard/Compacted
Distance (ft):	49.5
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	5
Clock To:	7
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES

Remarks:

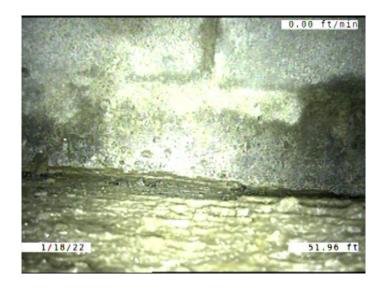

Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	52.0 0 2 8 4 5.000 F03 YES
Nethalks.	



Code: Description:	AMH Manhole
Distance (ft):	53.6
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-506-024