
Profile/Ph	noto Observation	n Report				RedZone
Date:	03/29/2018	Weather:			Coding:	PACP 6.0
Pipe Length (ft	t): 179.3	Owner:	NA		Pre Clean:	No Pre-Cleaning
P.O.#:		Surveyor:	Jen Costello		PSR:	P-507-032-031
Customer:		Clean Date	01/01/1900		Shape:	С
Street:	FOXCROFT STREE	Г	Flow Control:		Not Controlled	
City:	Hobart, IN		Year Renewed	:		
Location:	Yard		Tape/Media #			
Purpose:	Routine Assessme	ent	Dia/Height:		10"	
Use:	Sanitary		Material:		VCP	
Drain Area:	NA		Lining:			
Category:	NA					
Comment:	Flow direction wr	ong				
Location Detai	ils:		Direction of Su	irvey:	Downstream	
US MH:	M-507-031	DS MH:	M-507-032	Tot	al Length Surveyed (ft)	: 150.0
0&M Index:	1.75	O&M Quick	2	311	O&M Rating:	7.00
tructural Index	. 0.00	Structural Q	uick: 0	000	Structural Rating:	0.00
Overall Index:	1.75	Overall Quid	:k: 2 :	311	Overall Rating:	7.00

	Position	Code	Observation	Video (sec)	Grade
M(50)	7-031				
	.0	AMH	Manhole	10	NA
	0.	MWL	Water Level	21	NA
	43.2	TBI	Tap Break-in Intruding	119	M 2
	43.2	RFC	Roots Fine Connection	130	M 1
	45.7	TFA	Tap Factory Active	147	NA
	88.1	TFA	Tap Factory Active	244	NA
	140.5	TF	Tap Factory	361	NA
- H	142.6	TFA	Tap Factory Active	377	NA
	143.0	DAE	Deposits Attached Encrustation	390	M 2
5	143.0	IW	Infil Weeper	401	M 2
fecti	150.0	AMH	Manhole	426	NA
Camera Direction	7-032				
M(50)	7-032				



Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-507-031

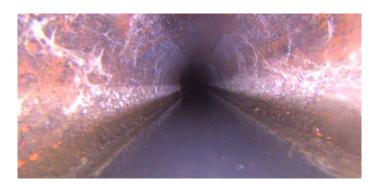

Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	20.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Code:	ТВІ
Description:	Tap Break-in Intruding
Distance (ft)	42.2

Distance (ft):	43.2
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	3.000
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	ROOTS




Code:RFCDescription:Roots Fine Connection

Distance (ft):	43.2	
Structural Grade:	0	
O&M Grade:	1	
Clock Start/From:	1	
Clock To:	2	
1st Value:		
2nd Value:		
Value Percent:		
Continuous Index:		
Within 8" of Joint:	NO	
Remarks:		

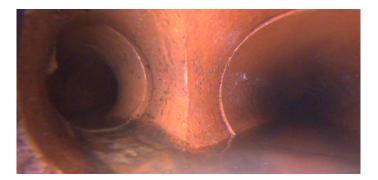


Code: Description:	TFA Tap Factory Active	
Distance (ft):	45.7	
Structural Grade:	0	
O&M Grade:	0	
Clock Start/From:	9	
Clock To:		
1st Value:	4.000	
2nd Value:		
Value Percent:		
Continuous Index:		
Within 8" of Joint:		
Remarks:		

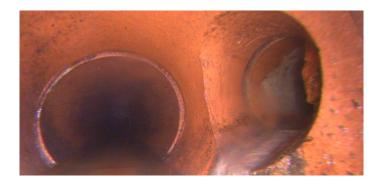

Code:TFADescription:Tap Factory Active

Distance (ft):	88.1
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

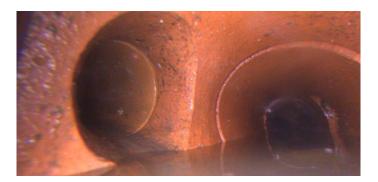

Code: Description:	TF Tap Factory
Distance (ft):	140.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




Code:TFADescription:Tap Factory Active

Distance (ft): 142.6 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 3 Clock To: 1st Value: 4.000 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:

Code:	DAE
Description:	Deposits Attached Encrustation

Distance (ft):	143.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	9
Clock To:	10
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

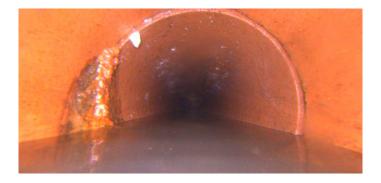

Code: IW Description: Infil Weeper

Distance (ft):	143.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	9
Clock To:	10
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code:	AMH
Description:	Manhole

Distance (ft):	150.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-507-032