•		Report				ROBOTIO
Date:	04/02/2018	Weather:			Coding:	PACP 6.0
Pipe Length (ft)	: 250.0	Owner:	NA		Pre Clean:	No Pre-Cleaning
P.O.#:		Surveyor:	Jen Coste	llo	PSR:	P-507-073-070
Customer:		Clean Date:	01/01/19	00	Shape:	С
Street:	CSOKASY CT		Flow Contr	ol:	Not Controlled	
City:	Hobart, IN		Year Renev	ved:		
Location:	Yard		Tape/Medi	a #:		
Purpose:	Routine Assessmen	t	Dia/Height	:	8"	
Use:	Sanitary		Material:		VCP	
Drain Area:	NA		Lining:			
Category:	NA					
Comment:						
Location Details	5:		Direction o	f Survey:	Upstream	
US MH:	M-507-070	DS MH:	M-507-073		Total Length Surveyed (ft)	247.8
D&M Index:	2.50	O&M Quick:		3222	O&M Rating:	10.00
Structural Index:	0.00	Structural Qu	uick:	0000	Structural Rating:	0.00
Overall Index:	2.50	Overall Quic		3222	Overall Rating:	10.00

	Position	Code	Observation	Video (sec)	Grade
M(507-)	073				
\mathbf{H}	0. //	AMH	Manhole	10	NA
	.0	MWL	Water Level	21	NA
	4.8	TFC	Tap Factory Capped	43	NA
	24.4	TBD	Tap Break-in Defective	94	M 3
	24.4	DAR	Deposits Attached Ragging	106	M 2
	\\\	TFC	Tap Factory Capped	148	NA
	\\48.9	TBA	Tap Break-in Active	179	NA
	68.7	TFC	Tap Factory Capped	231	NA
	104.5	TFC	Tap Factory Capped	315	NA
5	/ 117.6	TBD	Tap Break-in Defective	354	M 3
Camera Direction	/ 117.6	DAE	Deposits Attached Encrustation	365	M 2
ă 🗕 –	135.2	ТВ	Tap Break-in	414	NA
nera	135.2	MWL	Water Level	427	NA
E E	138.8	TFC	Tap Factory Capped	446	NA
	147.7	MWL	Water Level	475	NA
	247.8	AMH	Manhole	687	NA




Code: Description:	AMH Manhole
Distance (ft):	0
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-507-073

M(507)070



Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

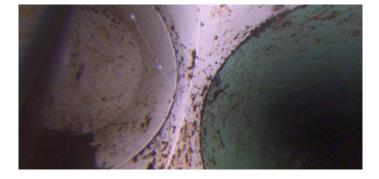


Code:	TFC
Description:	Tap Factory Capped
	4.0
Distance (ft):	4.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




Code: Description:	TBD Tap Break-in Defective
Distance (ft):	24.4
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	12
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	offset from connection



Code: Description:	DAR Deposits Attached Ragging
Distance (ft):	24.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	1
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

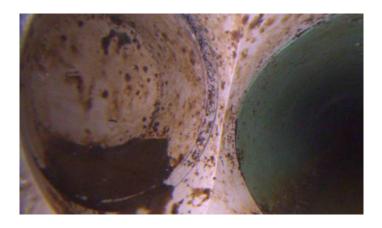

Code: Description:	TFC Tap Factory Capped
Distance (ft):	39.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

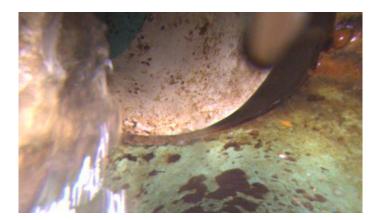

Code: Description:	TBA Tap Break-in Active
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:	48.9 0 0 12 4.000
Within 8" of Joint: Remarks:	




Code:	TFC
Description:	Tap Factory Capped
Distance (ft):	68.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




Code:	TFC
Description:	Tap Factory Capped
Distance (ft):	104.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code: Description:	TBD Tap Break-in Defective
Distance (ft):	117.6
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	dae

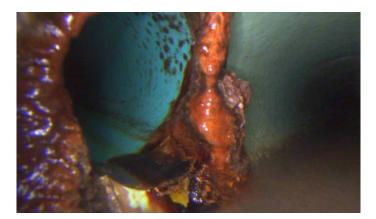

Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value:	117.6 0 2 8 10
2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	5.000 NO

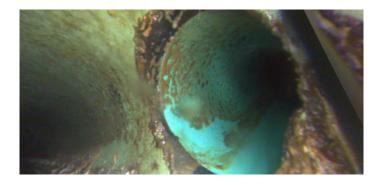

Code:	ТВ
Description:	Tap Break-in

Distance (ft):	135.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code: Description:	MWL Water Level
Distance (ft):	135.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	30.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code:TFCDescription:Tap Factory Capped

Distance (ft):	138.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code:	MWL
Description:	Water Level
Distance (ft):	147.7
Distance (ft):	14/./
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code:	AMH
Description:	Manhole

Distance (ft):	247.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-507-070