


Profile/Photo Observation Report



Date:	11/11/2021	Weather:		Coding:	PACP 7.0
Pipe Length (ft):	141.6	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	Steven Bucklin	PSR:	P-605-022-023
Customer:	City of Hobart, IN (Red	Clean Date:	11/10/2021	Shape:	C

Street:	West 2nd Street	Flow Control:	Not Controlled
City:	City of Hobart	Year Renewed:	
Location:	Local rural streets with light traffic, t	Tape/Media #:	
Purpose:	Routine Assessment	Dia/Height:	10"
Use:	Sanitary Sewage Pipe	Material:	VCP
Drain Area:		Lining:	None
Category:	NA		
Comment:			
Location Details:		Direction of Survey:	Upstream
US MH:	M-605-023	DS MH:	M-605-022
		Total Length Surveyed (ft):	141.5

O&M Index:	1.93	O&M Quick:	342E	O&M Rating:	83.00
Structural Index:	3.20	Structural Quick:	4532	Structural Rating:	32.00
Overall Index:	2.17	Overall Quick:	4536	Overall Rating:	115.00

	Position	Code	Observation	Video (sec)	Grade
	.0	AMH	Manhole	1	NA
	.0	MWL	Miscellaneous Water Level	69	NA
	.0	DSF(S01)	Deposits Settled Fine	82	M 2
	1.5	B	Broken	139	S 4
	13.9	CL	Crack Longitudinal	264	S 2
	13.9	SSS	Surface Damage Surface Spalling	265	S 2
	14.8	TBI	Tap Break-in Intruding	285	M 2
	24.2	TFD	Tap Factory Defective	359	M 3
	45.1	OBM	Obstruction Pipe Material in Invert	477	M 2
	45.1	DAR	Deposits Attached Ragging	490	M 2
	45.1	CM	Crack Multiple	537	S 3
	45.5	TFD	Tap Factory Defective	638	M 3
	45.5	ISB	Infiltration Stain Barrel	688	M 1
	80.1	TF	Tap Factory	879	NA
	83.1	FM	Fracture Multiple	956	S 4
	85.4	TF	Tap Factory	998	NA
	93.7	FM	Fracture Multiple	1061	S 4
	105.9	RFJ	Roots Fine Joint	1143	M 1
	107.7	RFJ	Roots Fine Joint	1213	M 1
	109.9	RFJ	Roots Fine Joint	1246	M 1
	109.9	FM	Fracture Multiple	1289	S 4
	113.9	RFJ	Roots Fine Joint	1328	M 1
	113.9	CM	Crack Multiple	1370	S 3
	116.0	RFJ	Roots Fine Joint	1404	M 1
	117.7	RMJ	Roots Medium Joint	1437	M 3
	119.7	RFJ	Roots Fine Joint	1471	M 1
	121.0	SSS	Surface Damage Surface Spalling	1537	S 2
	121.3	TBI	Tap Break-in Intruding	1558	M 2
	131.9	TFD	Tap Factory Defective	1630	M 3
	136.8	B	Broken	1739	S 4
	140.3	DSF(F01)	Deposits Settled Fine	1787	M 2
	141.5	AMH	Manhole	1901	NA
M-605-023					



Code: **AMH**
Description: **Manhole**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **NO**
Remarks: **M-605-022**



Code: **MWL**
Description: **Miscellaneous Water Level**

Distance (ft): **.0**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent: **5.000**
Continuous Index:
Within 8" of Joint: **NO**
Remarks:




Code: **DSF**
 Description: **Deposits Settled Fine**

Distance (ft): **.0**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **S01**
 Within 8" of Joint: **YES**
 Remarks:




Code: **B**
 Description: **Broken**

Distance (ft): **1.5**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **3**
 Clock To: **9**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

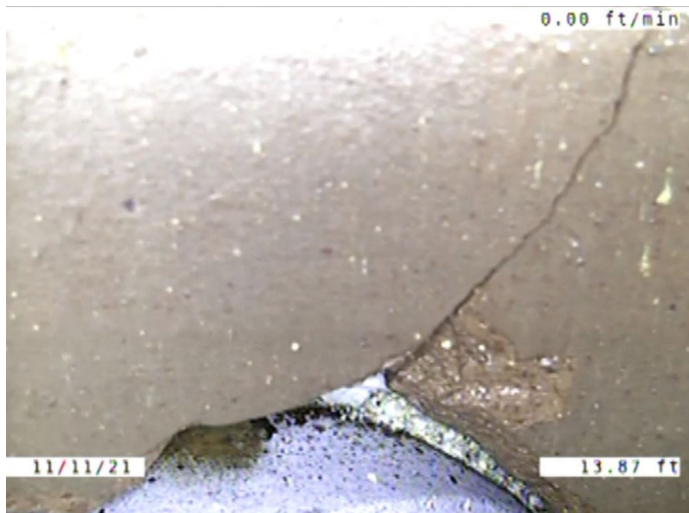


Code: **CL**
 Description: **Crack Longitudinal**

Distance (ft): **13.9**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **12**
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks:

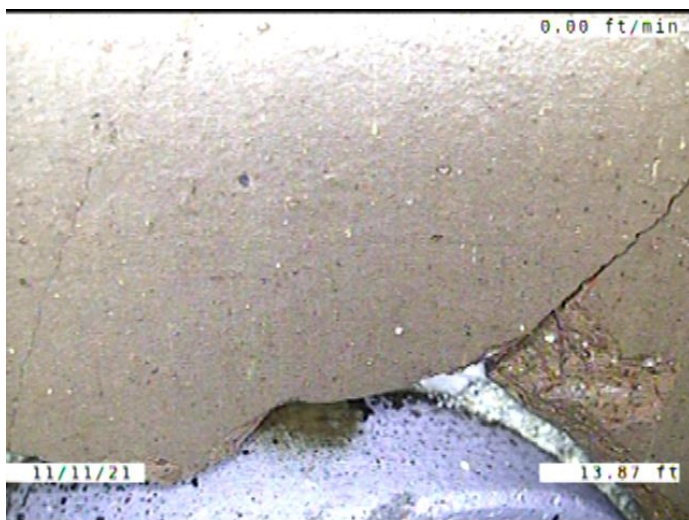


Code: **SSS**
 Description: **Surface Damage Surface Spalling**

Distance (ft): **13.9**
 Structural Grade: **2**
 O&M Grade: **0**
 Clock Start/From: **10**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

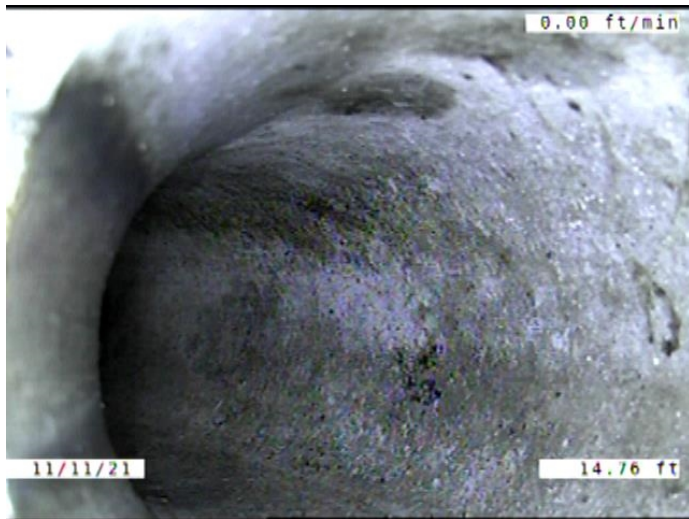


Code: **TBI**
Description: **Tap Break-in Intruding**

Distance (ft): **14.8**
Structural Grade: **0**
O&M Grade: **2**
Clock Start/From: **11**
Clock To:
1st Value: **4.000**
2nd Value: **1.000**
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

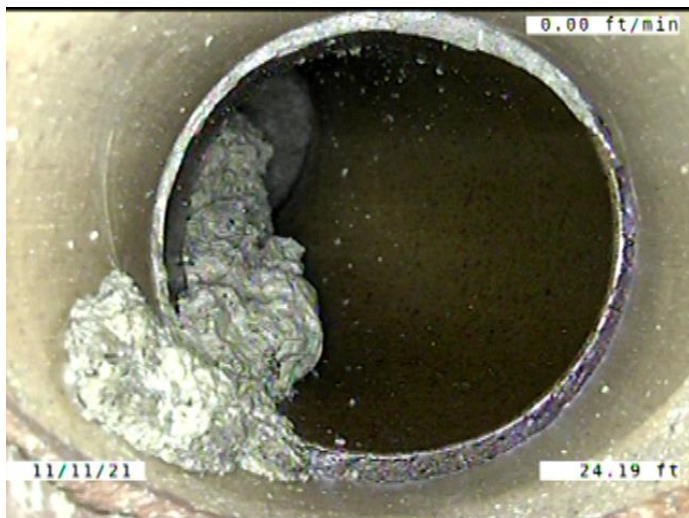


Code: **TFD**
Description: **Tap Factory Defective**

Distance (ft): **24.2**
Structural Grade: **0**
O&M Grade: **3**
Clock Start/From: **11**
Clock To:
1st Value: **4.000**
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **SOIL VISIBLE. LOOKS LIKE IT COULD BE PLUGGED**

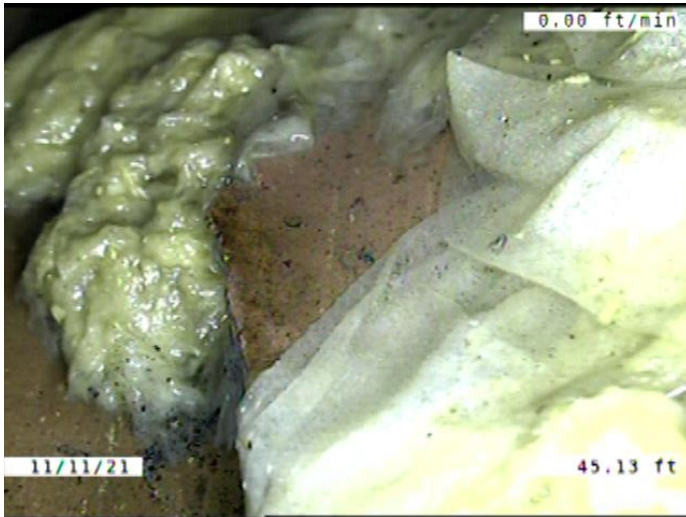

Code:	OBM
Description:	Obstruction Pipe Material in Invert
Distance (ft):	45.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	5
Clock To:	7
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

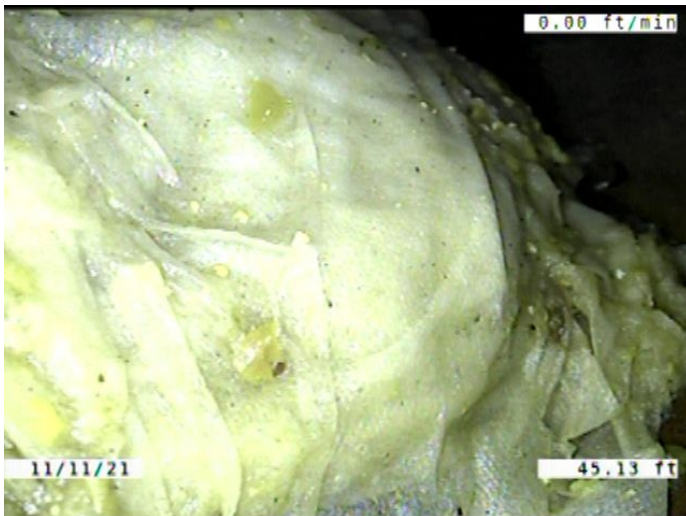


Code:	DAR
Description:	Deposits Attached Ragging
Distance (ft):	45.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	5
Clock To:	7
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	




Code: **CM**
Description: **Crack Multiple**

Distance (ft): **45.1**
Structural Grade: **3**
O&M Grade: **0**
Clock Start/From: **8**
Clock To: **1**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

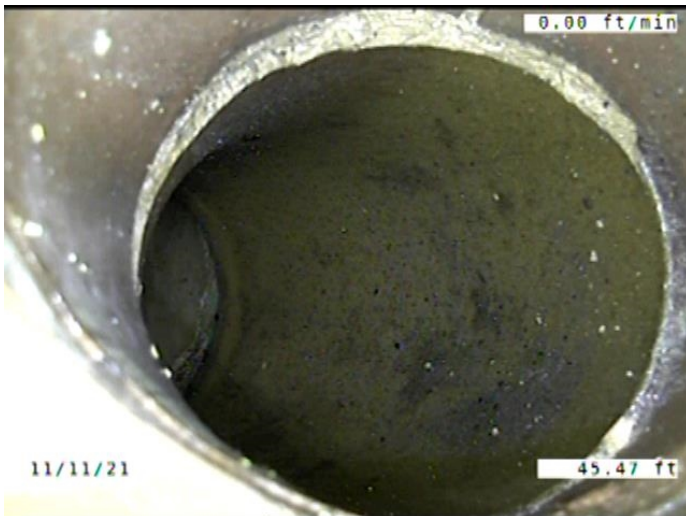


Code: **TFD**
Description: **Tap Factory Defective**

Distance (ft): **45.5**
Structural Grade: **0**
O&M Grade: **3**
Clock Start/From: **11**
Clock To:
1st Value: **4.000**
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **BROKEN. SOIL VISIBLE**

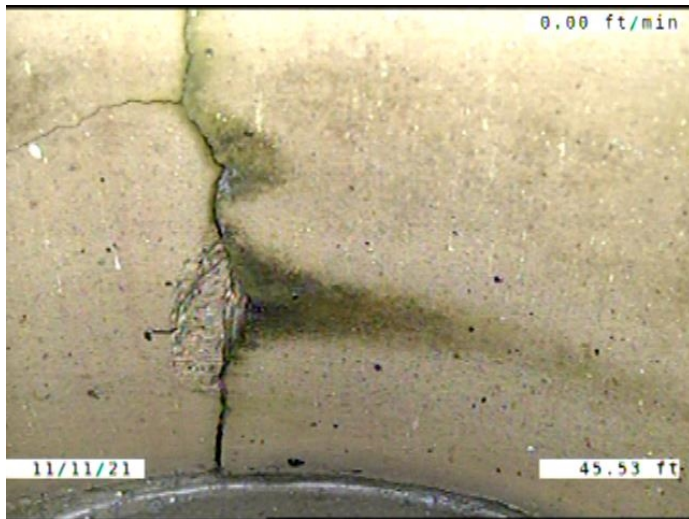


Code: **ISB**
Description: **Infiltration Stain Barrel**

Distance (ft): **45.5**
Structural Grade: **0**
O&M Grade: **1**
Clock Start/From: **1**
Clock To: **2**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

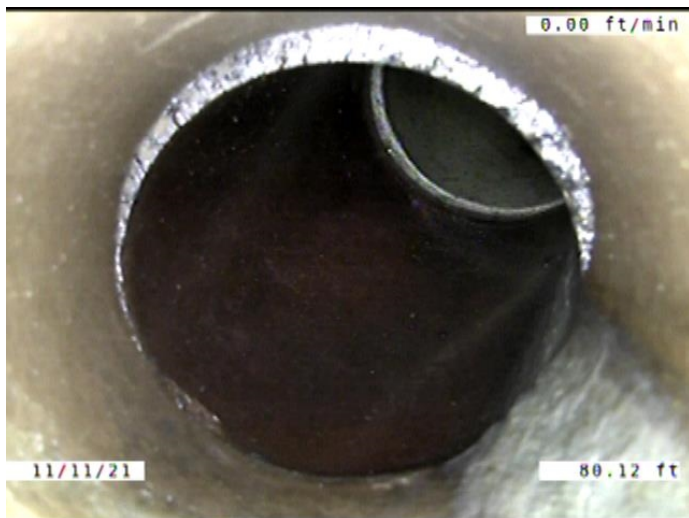


Code: **TF**
Description: **Tap Factory**

Distance (ft): **80.1**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From: **1**
Clock To:
1st Value: **4.000**
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **CONSTANTLY RUNNING WATER**

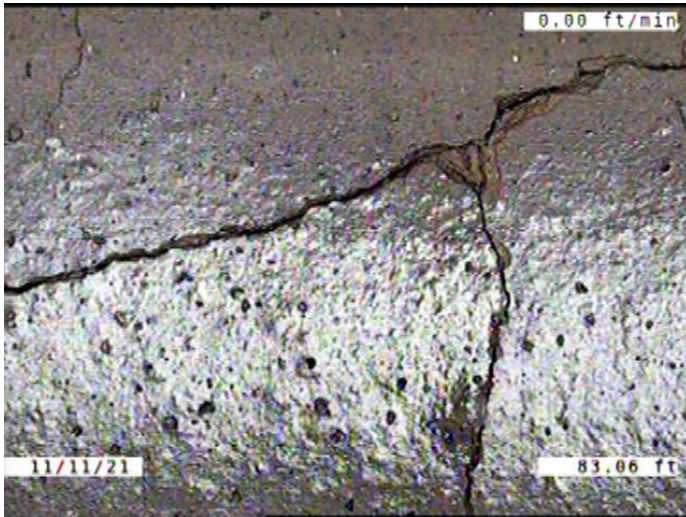


Code: **FM**
Description: **Fracture Multiple**

Distance (ft): **83.1**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **11**
Clock To: **5**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

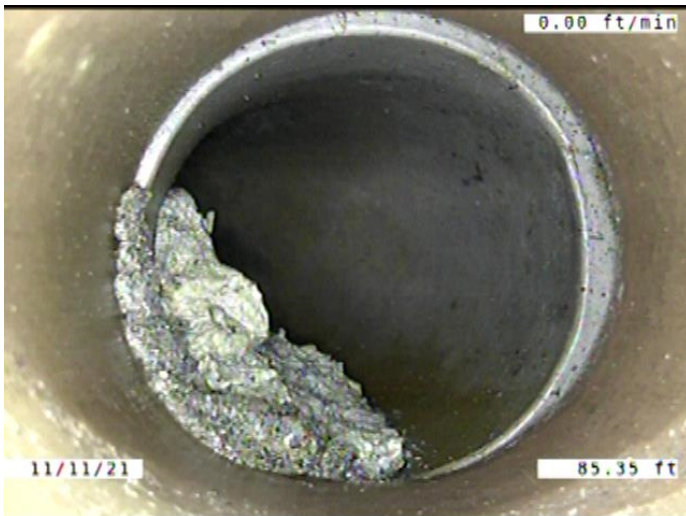

Code: **TF**
Description: **Tap Factory**

Distance (ft): **85.4**
Structural Grade: **0**
O&M Grade: **0**
Clock Start/From: **11**
Clock To:
1st Value: **4.000**
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **LOOKS TO HAVE SOIL IN THE TAP**

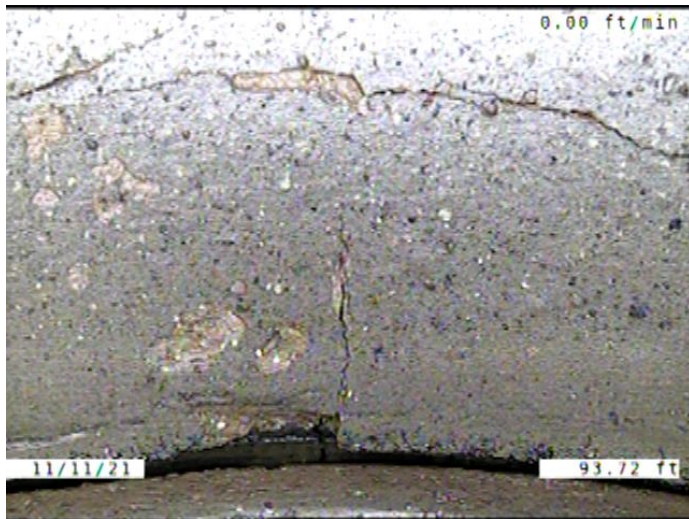

Code: **FM**
 Description: **Fracture Multiple**

Distance (ft): **93.7**
 Structural Grade: **4**
 O&M Grade: **0**
 Clock Start/From: **10**
 Clock To: **1**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:



Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **105.9**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **2**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:




Code: **RFJ**
Description: **Roots Fine Joint**

Distance (ft): **107.7**
Structural Grade: **0**
O&M Grade: **1**
Clock Start/From: **8**
Clock To: **3**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:




Code: **RFJ**
Description: **Roots Fine Joint**

Distance (ft): **109.9**
Structural Grade: **0**
O&M Grade: **1**
Clock Start/From: **3**
Clock To: **4**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

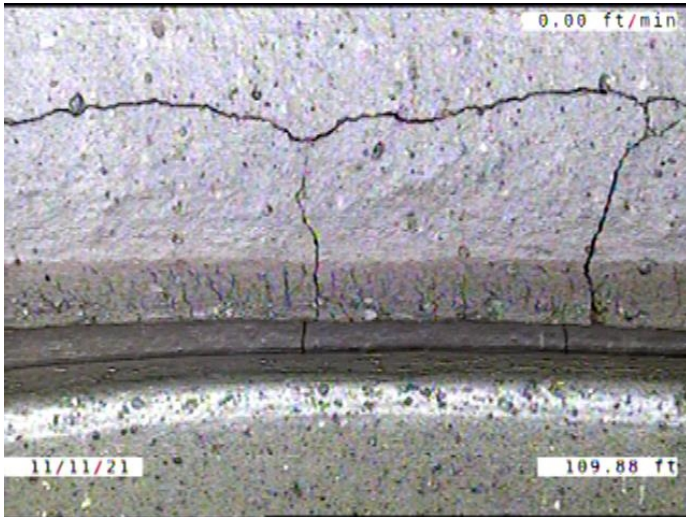


Code: **FM**
Description: **Fracture Multiple**

Distance (ft): **109.9**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **10**
Clock To: **3**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

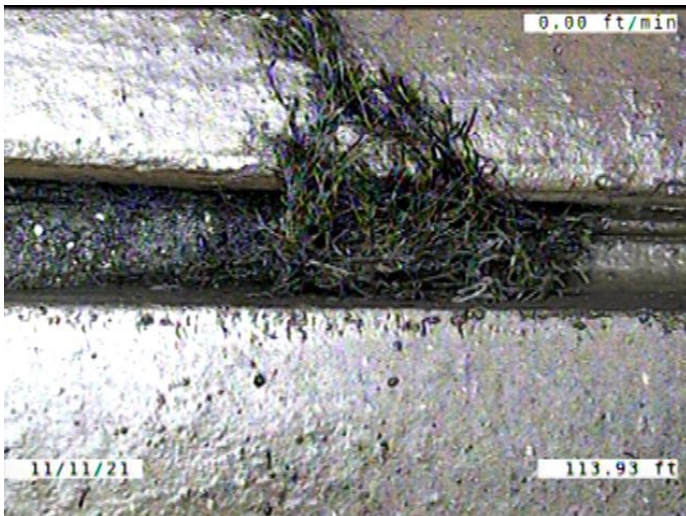


Code: **RFJ**
Description: **Roots Fine Joint**

Distance (ft): **113.9**
Structural Grade: **0**
O&M Grade: **1**
Clock Start/From: **3**
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

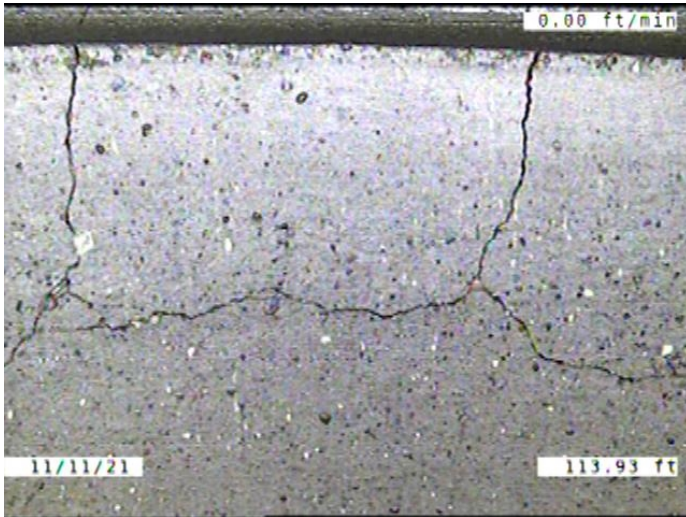


Code: **CM**
 Description: **Crack Multiple**

Distance (ft): **113.9**
 Structural Grade: **3**
 O&M Grade: **0**
 Clock Start/From: **9**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

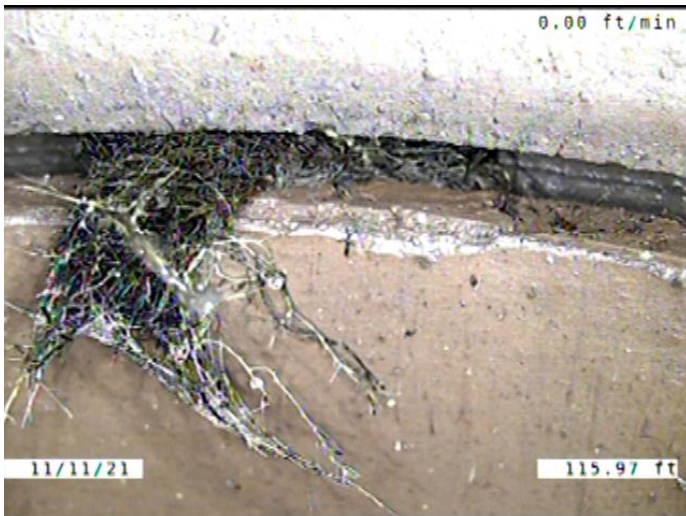


Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **116.0**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **2**
 Clock To: **3**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

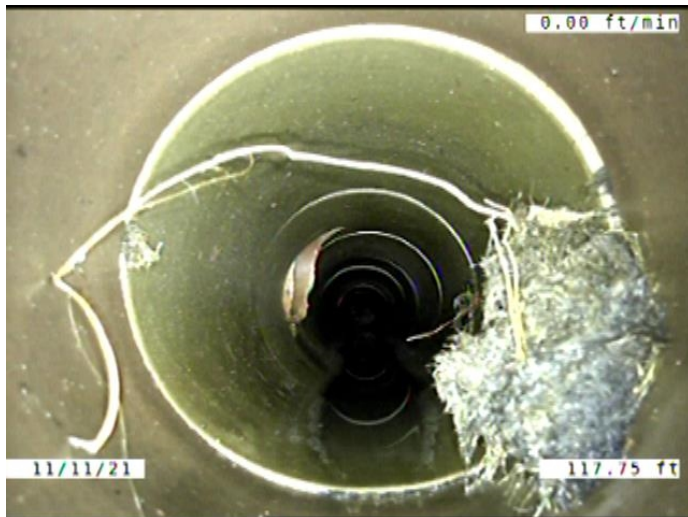


Code: **RMJ**
 Description: **Roots Medium Joint**

Distance (ft): **117.7**
 Structural Grade: **0**
 O&M Grade: **3**
 Clock Start/From: **10**
 Clock To: **5**
 1st Value:
 2nd Value:
 Value Percent: **15.000**
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

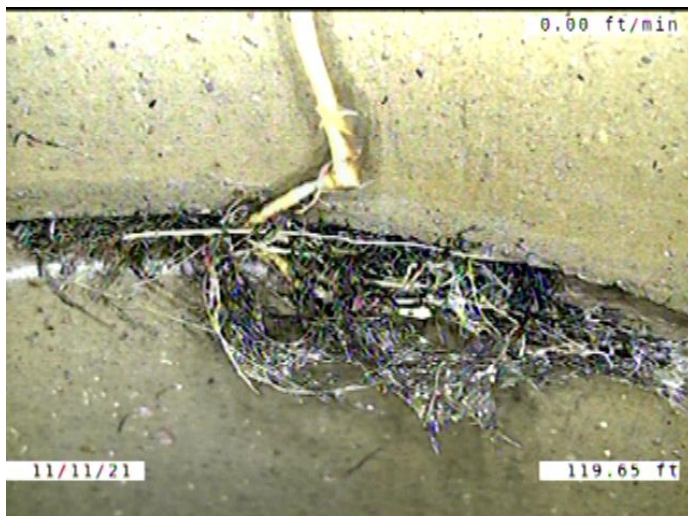


Code: **RFJ**
 Description: **Roots Fine Joint**

Distance (ft): **119.7**
 Structural Grade: **0**
 O&M Grade: **1**
 Clock Start/From: **2**
 Clock To: **4**
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **YES**
 Remarks:

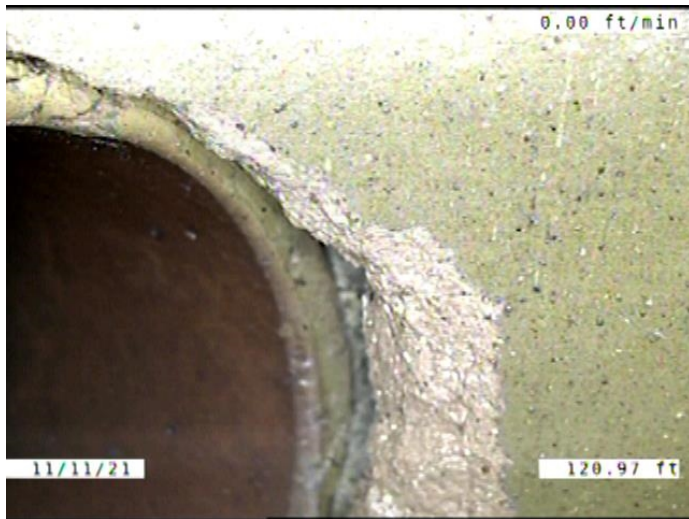

Code:	SSS
Description:	Surface Damage Surface Spalling
Distance (ft):	121.0
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	9
Clock To:	1
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

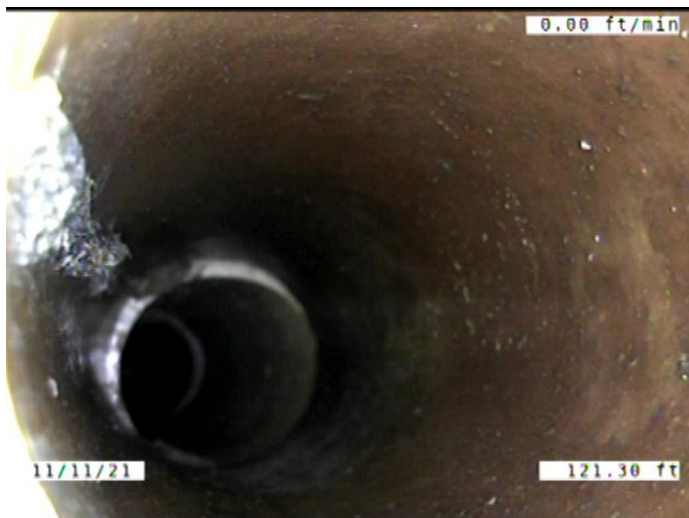


Code:	TBI
Description:	Tap Break-in Intruding
Distance (ft):	121.3
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	1.000
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	ROOTS GROWING FROM THE JOINTS




Code: **TFD**
Description: **Tap Factory Defective**

Distance (ft): **131.9**
Structural Grade: **0**
O&M Grade: **3**
Clock Start/From: **11**
Clock To:
1st Value: **4.000**
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks: **LOOKS TO BE 50% PLUGGED WITH SOIL.**

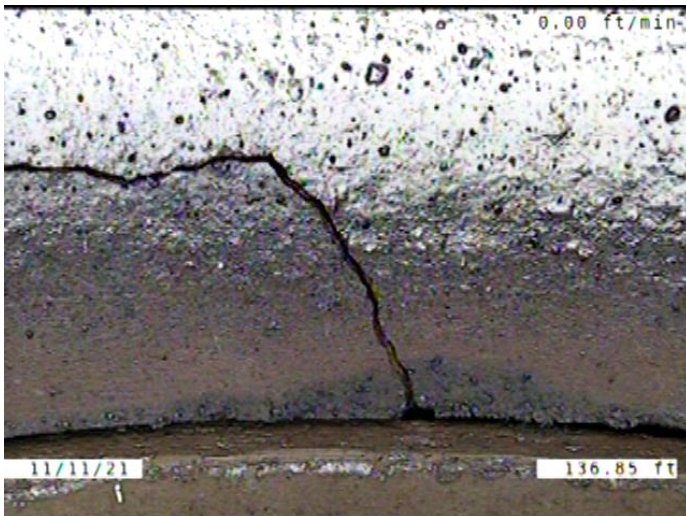

Code: **B**
Description: **Broken**

Distance (ft): **136.8**
Structural Grade: **4**
O&M Grade: **0**
Clock Start/From: **10**
Clock To: **12**
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: **YES**
Remarks:

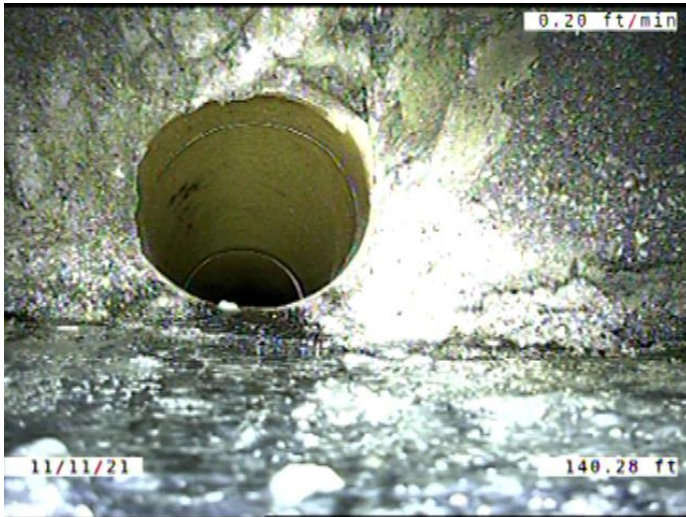

Code: **DSF**
 Description: **Deposits Settled Fine**

Distance (ft): **140.3**
 Structural Grade: **0**
 O&M Grade: **2**
 Clock Start/From: **5**
 Clock To: **7**
 1st Value:
 2nd Value:
 Value Percent: **5.000**
 Continuous Index: **F01**
 Within 8" of Joint: **YES**
 Remarks:



Code: **AMH**
 Description: **Manhole**

Distance (ft): **141.5**
 Structural Grade: **0**
 O&M Grade: **0**
 Clock Start/From:
 Clock To:
 1st Value:
 2nd Value:
 Value Percent:
 Continuous Index:
 Within 8" of Joint: **NO**
 Remarks: **M-605-023**