## **Profile/Photo Observation Report**



Date: 04/23/2018 Weather: **PACP 6.0** Coding: Pipe Length (ft): 364.4 Owner: NA Pre Clean: **Not Known** P.O.#: Surveyor: Jen Costello PSR: P-605-067-066 Customer: Clean Date: 01/01/1900 Shape:

Street: BEVERLY BLVD Flow Control: Not Controlled

City: Hobart, IN Year Renewed:

Location: Other Tape/Media #:
Purpose: Not Known Dia/Height:

Purpose: Not Known Dia/Height: 12"
Use: Sanitary Material: CP

Drain Area: NA Lining: Category: NA

Comment:

Location Details: Direction of Survey: Upstream

US MH: M-605-067 DS MH: M-605-066 Total Length Surveyed (ft): 359.5

 O&M Index:
 1.99
 O&M Quick:
 322X
 O&M Rating:
 261.00

 Structural Index:
 3.11
 Structural Quick:
 4A3M
 Structural Rating:
 271.00

Structural Index: 3.11 Structural Quick: 4A3M Structural Rating: 271.00

Overall Index: 0.44 Overall Quick: 4A3N Overall Rating: 532.00

	Position	Code	Observation	Video (sec)	Grade
605-0	066				
	0.	AMH	Manhole	10	NA
	.0	MWL	Water Level	22	NA
	.5	FC	Fracture Circumferential	34	S 2
	2.2	FC	Fracture Circumferential	49	S 2
	2.2	DAE	Deposits Attached Encrustation	61	M 2
	2.2	SAV(S01)	Surface Aggregate Visible	72	S 3
	4.6	DAE(S02)	Deposits Attached Encrustation	89	M 2
	4.6	IW(S03)	Infil Weeper	100	M 2
	26.2	FM	Fracture Multiple	155	S 4
	29.1	FM(S04)	Fracture Multiple	172	S 4
	64.7	DAE	Deposits Attached Encrustation	255	M 3
	73.0	TF	Tap Factory	283	NA
	76.0	TF	Tap Factory	302	NA
	76.0	FM(F04)	Fracture Multiple	313	S 4
	95.6	RFJ	Roots Fine Joint	364	M 1
	98.8	FL	Fracture Longitudinal	383	S 3
	115.9	TFD	Tap Factory Defective	430	M 2
	115.9	RML	Roots Medium Lateral	441	M 3
	119.1	TF	Tap Factory	460	NA

√\ \144.6	FL	Fracture Longitudinal	523	S 3
167.9	TF	Tap Factory	581	NA
170.9	TF	Tap Factory	599	NA
220.0	TFA	Tap Factory Active	709	NA
/223.2	TF	Tap Factory	728	NA
// 230.1	FM	Fracture Multiple	754	S 4
	TF	Tap Factory	843	NA
	TF	Tap Factory	862	NA
306.1	IW(F03)	Infil Weeper	942	M 2
306.1	DAE(F02)	Deposits Attached Encrustation	953	M 2
315.4	FM	Fracture Multiple	983	S 4
315.4	DAE	Deposits Attached Encrustation	994	M 2
315.4	IW	Infil Weeper	1005	M
321.1	TFA	Tap Factory Active	1028	NA
321.1	DAE	Deposits Attached Encrustation	1040	M 2
324.1	TF	Tap Factory	1058	NA
328.0	IW	Infil Weeper	1077	M 2
/// 340.1	RFJ	Roots Fine Joint	1113	M :
	TF	Tap Factory	1141	NA
//355.7	RFJ	Roots Fine Joint	1168	M :
_// 357.2	SAV(F01)	Surface Aggregate Visible	1183	S 3
359.5	AMH	Manhole	1199	NA



Code: AMH
Description: Manhole

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: M-605-066



Code: MWL

Description: Water Level

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0
Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:

10.000

NO



Code: FC

Description: Fracture Circumferential

Distance (ft): .5
Structural Grade: 2
O&M Grade: 0
Clock Start/From: 3
Clock To: 4
1st Value:
2nd Value:

Value Percent: Continuous Index: Within 8" of Joint:



Code: FC

Description: Fracture Circumferential

Distance (ft): 2.2
Structural Grade: 2
O&M Grade: 0
Clock Start/From: 3
Clock To: 4
1st Value:
2nd Value:
Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: DAE


Description: Deposits Attached Encrustation

Distance (ft): 2.2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 9
1st Value:
2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: YES

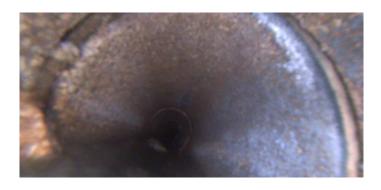

Code: SAV

Description: Surface Aggregate Visible

Distance (ft): 2.2
Structural Grade: 3
O&M Grade: 0
Clock Start/From: 7
Clock To: 5
1st Value:

1st Value: 2nd Value: Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:

Code: DAE

Description: Deposits Attached Encrustation

**S01** 



Distance (ft): 4.6
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 8

Clock To: 4

1st Value:

Value Percent: 5.000
Continuous Index: S02
Within 8" of Joint: YES

Remarks:

2nd Value:



Code: IW

Description: Infil Weeper

Distance (ft): 4.6
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4
1st Value:
2nd Value:

Value Percent: Continuous Index:

Continuous Index: S03
Within 8" of Joint: YES

Remarks:

Code: FM

Description: Fracture Multiple



Distance (ft): 26.2
Structural Grade: 4

O&M Grade: 0

Clock Start/From: 10

Clock To: 11

1st Value:

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES



Code: FM

Description: Fracture Multiple

Distance (ft): 29.1
Structural Grade: 4

O&M Grade: 0

Clock Start/From: 8

Clock To: 4

1st Value:

1st Value: 2nd Value: Value Percent:

Continuous Index: **S04**Within 8" of Joint: **YES** 

Remarks:

Code: DAE

Description: Deposits Attached Encrustation




Distance (ft): 64.7
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 8
Clock To: 4

1st Value: 2nd Value:

Value Percent: 20.000

Continuous Index:

Within 8" of Joint: YES

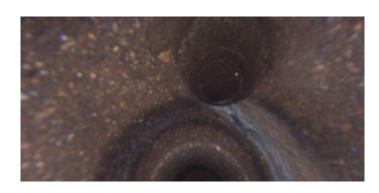

Description: Tap Factory

Distance (ft): 73.0
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 1

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: **TF** 

Description: Tap Factory

Distance (ft): 76.0
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: FM

Description: Fracture Multiple

Distance (ft): 76.0
Structural Grade: 4

O&M Grade: 0

Clock Start/From: 8

Clock To: 4

1st Value:

2nd Value:

Continuous Index: F04
Within 8" of Joint: YES

Remarks:

Value Percent:

Code: RFJ

Description: Roots Fine Joint



Distance (ft): 95.6
Structural Grade: 0

O&M Grade: 1

Clock Start/From: 12

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES



Code: FL

Description: Fracture Longitudinal

Distance (ft): 98.8
Structural Grade: 3
O&M Grade: 0
Clock Start/From: 1

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: **TFD** 

Description: Tap Factory Defective

Distance (ft): 115.9
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 12

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks: rml



Code: RML

Description: Roots Medium Lateral

Distance (ft): 115.9
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 12

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: **TF** 

Description: Tap Factory

Distance (ft): 119.1
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 12

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: FL

Description: Fracture Longitudinal

Distance (ft): 144.6
Structural Grade: 3
O&M Grade: 0
Clock Start/From: 3

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: **TF** 


Description: Tap Factory

Distance (ft): 167.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 1

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

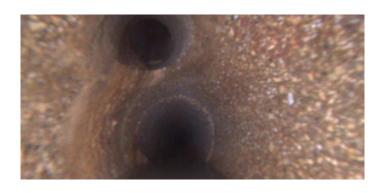

Description: Tap Factory


Distance (ft): 170.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

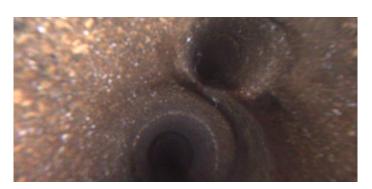

Code: TFA

Description: Tap Factory Active


Distance (ft): 220.0
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 1

Clock To:

1st Value: **4.000** 

2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint:

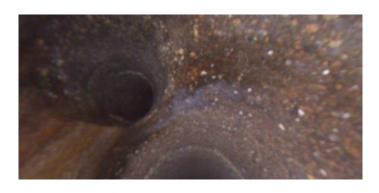

Description: Tap Factory


Distance (ft): 223.2
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

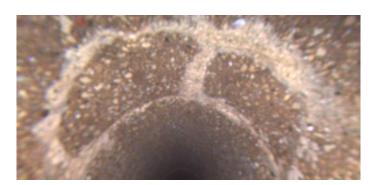

Code: **FM** 

Description: Fracture Multiple

Distance (ft): 230.1

Structural Grade: 4

O&M Grade: 0

Clock Start/From: 9

Clock To: 3

1st Value: 2

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES



Description: Tap Factory

Distance (ft): 268.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 1

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: **TF** 

Description: **Tap Factory** 

Distance (ft): 271.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO



Code: IW

Description: Infil Weeper

Distance (ft): 306.1
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4

1st Value: 2nd Value: Value Percent:

Continuous Index: F03
Within 8" of Joint: YES

Remarks:

Code: DAE

Description: Deposits Attached Encrustation



Distance (ft): 306.1
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4

Clock To: 1st Value: 2nd Value: Value Percent:

Value Percent: 5.000
Continuous Index: F02
Within 8" of Joint: YES



Code: FM

Description: Fracture Multiple

Distance (ft): 315.4
Structural Grade: 4
O&M Grade: 0
Clock Start/From: 8
Clock To: 4
1st Value:
2nd Value:

Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 315.4
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4
1st Value:
2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: YES



Code: IW

Description: Infil Weeper


Distance (ft): 315.4
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4

1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Description: Tap Factory Active

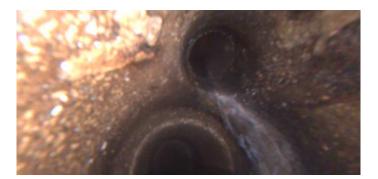

Distance (ft): 321.1
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 1

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 321.1
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 11
Clock To: 12
1st Value:

1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: TF

Description: Tap Factory

Distance (ft): 324.1
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: IW

Description: Infil Weeper

Distance (ft): 328.0
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4


1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

YES

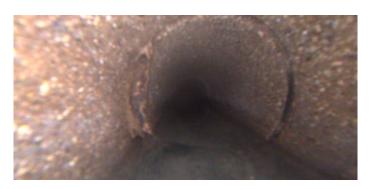


Code: RFJ

Description: Roots Fine Joint

Distance (ft): 340.1
Structural Grade: 0
O&M Grade: 1
Clock Start/From: 8
Clock To: 10
1st Value:
2nd Value:
Value Percent:

Within 8" of Joint:

Continuous Index:

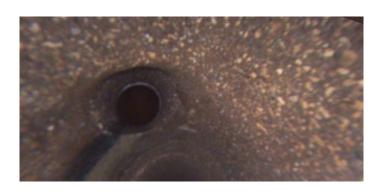

Description: Tap Factory

Distance (ft): 348.3
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: RFJ

Description: Roots Fine Joint

Distance (ft): 355.7 Structural Grade: 0 O&M Grade: 1 Clock Start/From: 8 Clock To: 4 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: YES



Code: SAV

Description: Surface Aggregate Visible

F01

Distance (ft): 357.2
Structural Grade: 3
O&M Grade: 0
Clock Start/From: 7
Clock To: 5

1st Value: 2nd Value: Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:



Code: AMH
Description: Manhole

Distance (ft): 359.5
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: M-605-067