Date:	02/18/2022	Weather:			Coding:	PACP 7.0
Pipe Length (ft)	51.0	Owner:	City of Hoba	art	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin		PSR:	P-606-014-013
Customer:	City of Hobart	Clean Date:	01/27/2022		Shape:	С
Street:	West 8th Place		Flow Control:		Not Controlled	
City:	Hobart, IN		Year Renewe	d:		
Location:	Other		Tape/Media #	# :		
Purpose:	Routine Assessment		Dia/Height:		10"	
Use:	Sanitary Sewage Pipe	2	Material:		VCP	
Drain Area:			Lining:		None	
Category:	NA					
Comment:						
Location Details	: DRIVEWAY		Direction of S	urvey:	Upstream	
US MH:	M-606-013	DS MH:	M-606-014		Total Length Surveyed (ft)	: 51.0
0&M Index:	2.00	O&M Quick:	2	2800	O&M Rating:	16.00
Structural Index:	0.00	 Structural Qu	uick:	0000	Structural Rating:	0.00
Overall Index:	2.00	Overall Quicl		2800	Overall Rating:	16.00


	Position	Code	Observation	Video (sec)	Grad
A 606-	014				
\mathbf{H}	0. //	AMH	Manhole	1	NA
	.0	MWL	Miscellaneous Water Level	14	NA
	$\sqrt{1.5}$	MGO	Miscellaneous General Observation	34	NA
	5.0	DAE	Deposits Attached Encrustation	80	M 2
	10.1	DAE	Deposits Attached Encrustation	179	M 2
	15.1	DAE	Deposits Attached Encrustation	264	M 2
	16.5	TF	Tap Factory	314	NA
	17.2	DAE	Deposits Attached Encrustation	348	M 2
	22.0	DAE	Deposits Attached Encrustation	444	M 2
	27.4	DAE	Deposits Attached Encrustation	526	M 2
	/ 28.5	MWL	Miscellaneous Water Level	562	NA
	// 32.3	DAE	Deposits Attached Encrustation	601	M 2
	///38.1	MWL	Miscellaneous Water Level	663	NA
3	//42.4	DAE	Deposits Attached Encrustation	732	M 2
	///43.9	MWL	Miscellaneous Water Level	763	NA
	['] 51.0	AMH	Manhole	901	NA




Code: Description:	AMH Manhole
2 :	
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-606-014


Tuesday, April 25, 2023

M(606)013

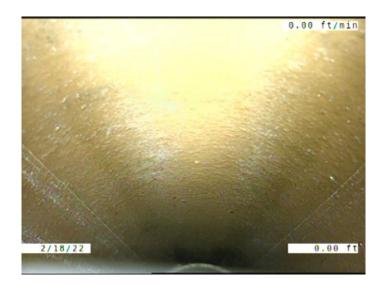


Code:	MWL
Description:	Miscellaneous Water Level
	0
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	35.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

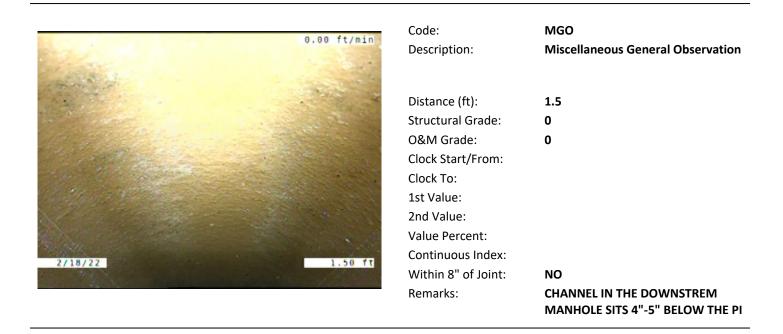


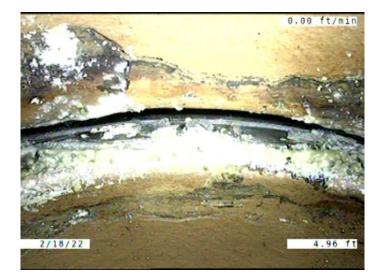


Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	5.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	11
Clock To:	1
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

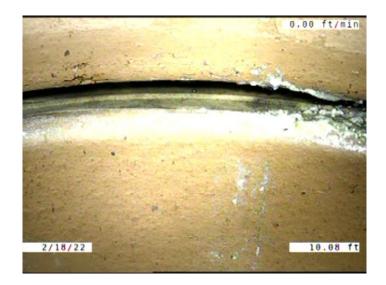


Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:	10.1 0 2 11 1 5.000 YES
Remarks:	

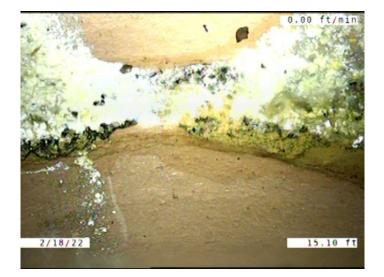


Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	15.1
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	11
Clock To:	1
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

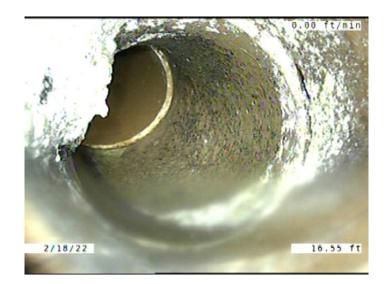

Code:	TF
Description:	Tap Factory
Distance (ft):	16.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	11
Clock To: 1st Value: 2nd Value:	4.000
Value Percent: Continuous Index: Within 8" of Joint: Remarks:	YES CONSTANTLY RUNNING WATER FROM THE MAIN TO SERVICE JOINT.

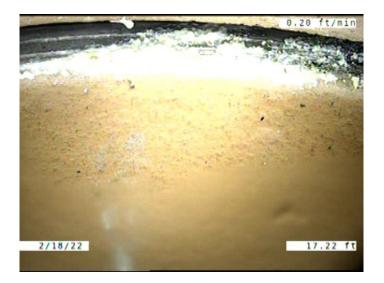


Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	17.2
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	11
Clock To:	1
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

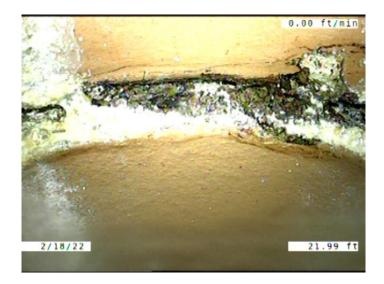

Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:	22.0 0 2 11 1 5.000 YES
Remarks:	




Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	27.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	10
Clock To:	11
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

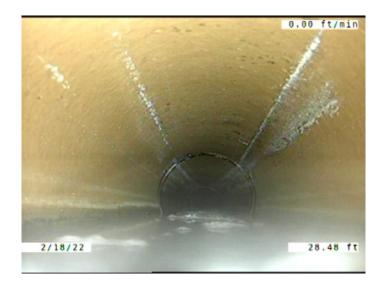

Code: Description:	MWL Miscellaneous Water Level
Distance (ft):	28.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	20.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Code: Description:	DAE Deposits Attached Encrustation
Distance (ft):	32.3
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

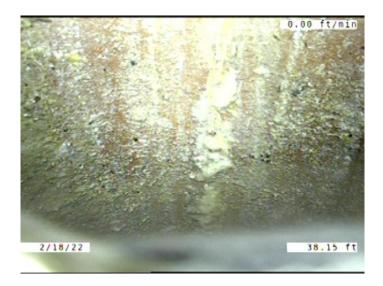

Code: Description:	MWL Miscellaneous Water Level
Distance (ft): Structural Grade: O&M Grade:	38.1 0 0
Clock Start/From: Clock To: 1st Value: 2nd Value:	
Value Percent: Continuous Index:	30.000
Within 8" of Joint: Remarks:	NO



Code: Description:	DAE Deposits Attached Encrustation
	13 A
Distance (ft):	42.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	10
Clock To:	2
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

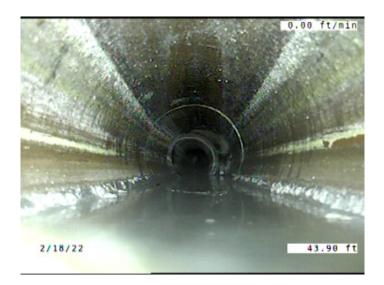

Code: Description:	MWL Miscellaneous Water Level
Distance (ft):	43.9
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	15.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	AMH Manhole
Distance (ft):	51.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-606-013