
Profile/Ph	oto Observatio	n Report				RedZone R 0 B 0 T I C S
Date: Pipe Length (ft P.O.#:	04/03/2018 ): 158.9	Weather: Owner:	NA Jan Costa	<b>U</b> e	Coding: Pre Clean: PSR:	PACP 6.0 No Pre-Cleaning P-607-037-034
Customer:		Surveyor: Clean Date	Jen Coste e: 01/01/19		Shape:	C
Street:	W 14TH ST & MEE	DLEE DR	Flow Contr	Flow Control:		
City:	Hobart, IN		Year Renew	ved:		
Location:	Yard		Tape/Medi	a #:		
Purpose:	Routine Assessme	ent	Dia/Height	:	8"	
Use:	Sanitary		Material:		PVC	
Drain Area:	NA		Lining:			
Category:	NA					
Comment:						
Location Detail	s:		Direction o	f Survey:	Downstream	
US MH:	M-607-037	DS MH:	M-607-034	Te	otal Length Surveyed (ft)	: <b>159.4</b>
0&M Index:	2.00	O&M Quicl	<:	2100	O&M Rating:	2.00
Structural Index:	0.00	Structural (	Quick:	0000	Structural Rating:	0.00
Overall Index:	2.00	Overall Qui	ick:	2100	Overall Rating:	2.00





Code:	АМН
Description:	Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-607-037

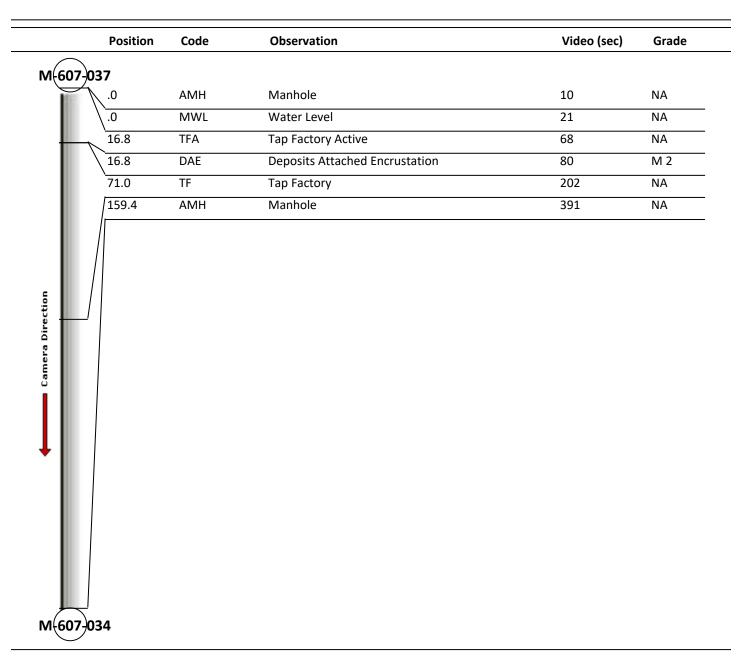


Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

Code:


Description:

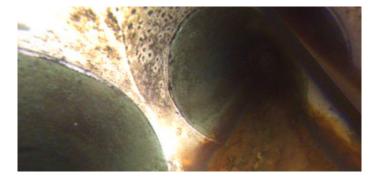

Distance (ft):	16.8	
Structural Grade:	0	
O&M Grade:	0	
Clock Start/From:	10	
Clock To:		
1st Value:	4.000	
2nd Value:		
2nd Value: Value Percent:		
Value Percent:		


TFA

**Tap Factory Active** 

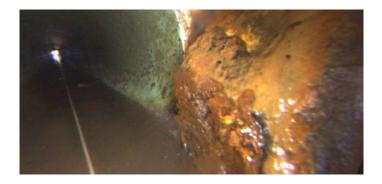

Code:DAEDescription:Deposits Attached Encrustation

Distance (ft):	16.8
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	9
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

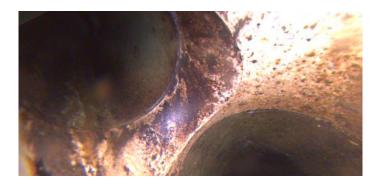

Code: Description:	TF Tap Factory
Distance (ft):	71.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	11
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code:AMHDescription:Manhole

Distance (ft):	159.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-607-034