Profile/Photo Observation Report



Date: **04/11/2018** Weather: Coding: **PACP 6.0**

Pipe Length (ft): 89.9 Owner: NA Pre Clean: No Pre-Cleaning P.O.#: Surveyor: Jen Costello PSR: P-607-050-051

Customer: Clean Date: 01/01/1900 Shape: C

Street: MEDLEE DR Flow Control: Not Controlled

City: Hobart, IN Year Renewed: Location: Yard Tape/Media #:

Purpose: Routine Assessment Dia/Height: 10"
Use: Sanitary Material: PVC

Drain Area: **NA** Lining:

Category: NA
Comment: Flow direction is marked wrong.

Location Details: Direction of Survey: Upstream

US MH: M-607-051 DS MH: M-607-050 Total Length Surveyed (ft): 88.7

2.00 2200 4.00 O&M Index: O&M Quick: O&M Rating: 0.00 0000 0.00 Structural Quick: Structural Rating: Structural Index: 2.00 2200 4.00 Overall Index: Overall Quick: Overall Rating:

Position	Code	Observation	Video (sec)	Grade
607-050				
.0	AMH	Manhole	10	NA
0.	MWL	Water Level	22	NA
58.7	TFD	Tap Factory Defective	152	M 2
58.7	DAE	Deposits Attached Encrustation	164	M 2
60.6	TF	Tap Factory	181	NA
88.7	AMH	Manhole	249	NA

Code:



Description:	Manhole		
Distance (ft):	.0		
Structural Grade:	0		
O&M Grade:	0		
Clock Start/From:			
Clock To:			
1st Value:			
2nd Value:			
Value Percent:			
Continuous Index:			
Within 8" of Joint:	NO		
Remarks:	M-607-050		

AMH



Code: MWL

Description: **Water Level**

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:


Within 8" of Joint: NO

Remarks:

5.000

Code: **TFD**

Description: **Tap Factory Defective**

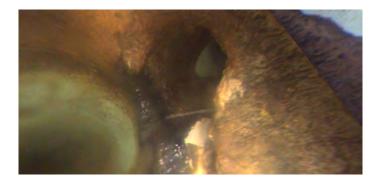

Distance (ft): 58.7 Structural Grade: 0


O&M Grade: 2 Clock Start/From: 10

Clock To:

1st Value: 4.000

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks: dae

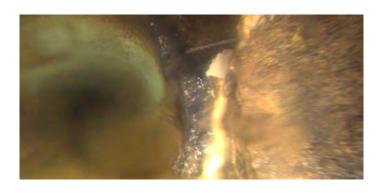

Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 58.7
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 7

Clock To: 11

1st Value: 2nd Value:

Value Percent: 10.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: **TF**

Description: Tap Factory

Distance (ft): 60.6
Structural Grade: 0

O&M Grade: 0

Clock Start/From: 1

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: AMH
Description: Manhole

Distance (ft): 88.7
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-607-051