						ROBOTI
Date:	03/26/2018	Weather:			Coding:	PACP 6.0
Pipe Length (ft)	: <b>320.8</b>	Owner:	NA		Pre Clean:	Not Known
P.O.#:		Surveyor:	JUSTIN GONZ	ALES	PSR:	P-703-004-006
Customer:		Clean Date:	01/01/1900		Shape:	С
Street:	PHEASANT RUN [	R & EDGEWATER	Flow Control:		Not Controlled	
City:	Hobart, IN		Year Renewed:			
Location:	Other		Tape/Media #:			
Purpose:	Not Known		Dia/Height:		10"	
Use:	Sanitary		Material:		PVC	
Drain Area:	NA		Lining:			
Category:	NA					
Comment:						
Location Details	5:		Direction of Sur	vey:	Downstream	
US MH:	M-703-004	DS MH:	M-703-006	Total Le	ngth Surveyed (ft)	311.4
D&M Index:	0.00	O&M Quick:	000	00	O&M Rating:	0.00
Structural Index:	0.00	Structural Qu			Structural Rating:	0.00
Overall Index:	0.00	Overall Quic			Overall Rating:	0.00

	Position	Code	Observation	Video (sec)	Grade
1(703-)0	04				
<u> </u>	.0	AMH	Manhole	10	NA
	.0	MWL	Water Level	21	NA
	20.5	TF	Tap Factory	74	NA
	33.7	TF	Tap Factory	113	NA
	97.2	TF	Tap Factory	251	NA
	/110.0	TF	Tap Factory	289	NA
	//192.7	TF	Tap Factory	466	NA
	/ 195.9	TF	Tap Factory	484	NA
	308.5	TF	Tap Factory	721	NA
	311.4	AMH	Manhole	739	NA




Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-703-004




Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

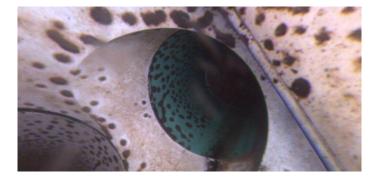


Code: Description:	TF Tap Factory
Distance (ft):	20.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

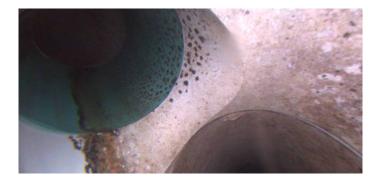

Code:	TF
Description:	Tap Factory
Distance (ft):	22.7
Distance (ft):	33.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code:	TF
Description:	Tap Factory
Distance (ft):	97.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To: 1st Value:	4.000
2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	

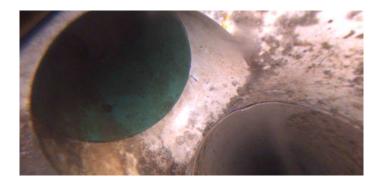

Code:	TF
Description:	Tap Factory
Distance (ft):	110.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	

Remarks:



Code: Description:	TF Tap Factory
Distance (ft): Structural Grade:	192.7 0
O&M Grade:	0
Clock Start/From: Clock To:	10
1st Value:	4.000
2nd Value: Value Percent:	
Continuous Index:	
Within 8" of Joint: Remarks:	
Rellidiks.	



Code:	TF
Description:	Tap Factory
Distance (ft):	195.9
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code: Description:	TF Tap Factory
Distance (ft):	308.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	6
Clock To:	
1st Value:	6.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	DROP CONNECTION



Code: AMH Description: Manhole

Distance (ft):	311.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-703-006