

Profile/Ph	oto Observatio	n Report				RedZone R 0 B 0 T I C S
Date: Pipe Length (ft)	03/26/2018 : 336.2	Weather: Owner:	NA		Coding: Pre Clean:	PACP 6.0 Not Known
P.O.#: Customer:		Surveyor: Clean Date:	Justin Gonza 01/01/1900	es	PSR: Shape:	P-703-033-034 C
Street:	QUAIL DR & HIDD		Flow Control:		Not Controlled	-
City:	Hobart, IN		Year Renewed	:	Not controlled	
Location:	Other		Tape/Media #:			
Purpose:	Not Known		Dia/Height:		10"	
Use:	Sanitary		Material:		PVC	
Drain Area:	NA		Lining:			
Category:	NA					
Comment:						
Location Details	s:		Direction of Su	rvey:	Downstream	
US MH:	M-703-034	DS MH:	M-703-033	Tot	tal Length Surveyed (ft):	331.0
D&M Index:	0.00	O&M Quick:	00	000	O&M Rating:	0.00
Structural Index:	0.00	Structural Q	uick: 00	000	Structural Rating:	0.00
Overall Index:	0.00	Overall Quic	k: 00	000	Overall Rating:	0.00

	Code	Observation	Video (sec)	Grade
1,703-034				
.0	AMH	Manhole	10	NA
.0	MWL	Water Level	21	NA
25.2	TF	Tap Factory	83	NA
36.6	TF	Tap Factory	118	NA
67.1	MWL	Water Level	191	NA
110.4	TFA	Tap Factory Active	290	NA
/ 110.4	MWL	Water Level	301	NA
113.0	TF	Tap Factory	318	NA
228.8	TF	Tap Factory	561	NA
232.0	TF	Tap Factory	580	NA
331.0	AMH	Manhole	790	NA
232.0				

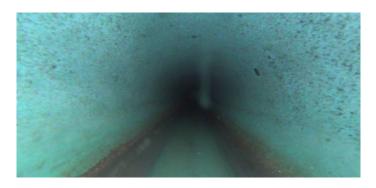


Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-703-034

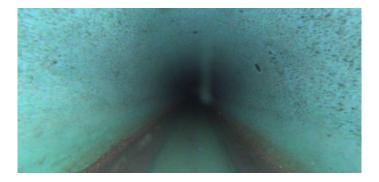


Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

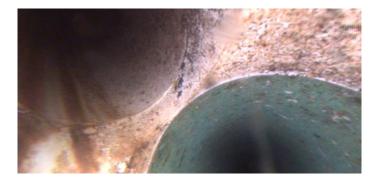


Code: Description:	TF Tap Factory
Distance (ft):	25.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

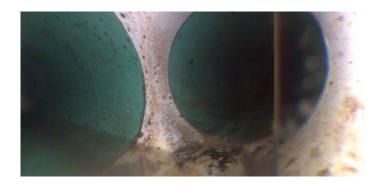

Code:	TF
Description:	Tap Factory

Distance (ft):	36.6
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

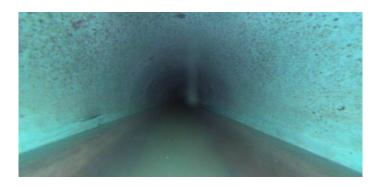

Code:	MWL
Description:	Water Level
Distance (ft):	67.1
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	

40.000

NO

Clock To: 1st Value: 2nd Value:

Remarks:

Value Percent: Continuous Index: Within 8" of Joint:



Code: Description:

TFA Tap Factory Active

Distance (ft):	110.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




MWL Water Level
110.4
0
0
30.000
NO



Code:	TF
Description:	Tap Factory

Distance (ft):	113.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

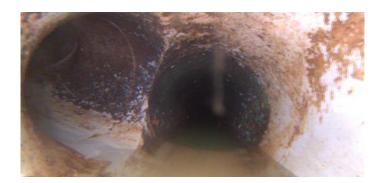

Code: Description:	TF Tap Factory
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:	228.8 0 0 9 4.000
Remarks:	



Code:	TF
Description:	Tap Factory

Distance (ft):	232.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

Code:

Description:



Distance (ft):	331.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-703-033

AMH

Manhole