
Date:	03/09/2024	Weather:		Coding:	<b>PACP 7.0</b>
Pipe Length (ft)	: 329.0	Owner:	City of Hobart	Pre Clean:	Light Cleaning
P.O.#:		Surveyor:	S. Bucklin	PSR:	P-704-072-068
Customer:	City of Hobart	Clean Date:	03/09/2024	Shape:	С
Street:	LAKEWOOD DR		Flow Control:	Not Controlle	d
City:	Hobart, IN		Year Renewed:		
Location:	Easement/Right	of Way	Tape/Media #:		
Purpose:	Sewer System Ev	aluation Survey (S	SS Dia/Height:	8"	
Use:	Sanitary Sewage	Pipe	Material:	PVC	
Drain Area:			Lining:	None	
Category:	NA				
Comment:					
Location Details	5:		Direction of Surv	vey: Downstream	
US MH:	M-704-068	DS MH:	M-704-072	Total Length Surveyed (fi	:): <b>193.4</b>
D&M Index:	0.00	O&M Quick:	000	0 O&M Rating:	0.00
Structural Index:	2.00	Structural Q	uick: 240	0 Structural Rating	8.00
Overall Index:	2.00	Overall Quic			8.00


Position	Code	Observation	Video (sec)	Grade
068				
0. //	AMH	Manhole	0	NA
0.	MWL	Miscellaneous Water Level	87	NA
34.0	TFC	Tap Factory Capped	243	NA
/ 73.4	TF	Tap Factory	458	NA
86.8	TF	Tap Factory	539	NA
102.5	TF	Tap Factory	624	NA
132.0	TF	Tap Factory	762	NA
139.7	MWLS(S01)	Miscellaneous Water Level Sag	813	S 2
143.9	MWLS(F01)	Miscellaneous Water Level Sag	840	S 2
156.6	TFC	Tap Factory Capped	899	NA
158.9	TF	Tap Factory	962	NA
174.3	MWLS(S02)	Miscellaneous Water Level Sag	1044	S 2
190.1	MWLS(F02)	Miscellaneous Water Level Sag	1126	S 2
193.4	MGO	Miscellaneous General Observation	1253	NA
193.4	AMH	Manhole	1275	NA
	.0   .0	<b>D68</b> .0 AMH   .0 MWL   34.0 TFC   73.4 TF   86.8 TF   102.5 TF   132.0 TF   139.7 MWLS(S01)   143.9 MWLS(F01)   156.6 TFC   158.9 TF   174.3 MWLS(S02)   190.1 MWLS(F02)   193.4 MGO	D68.0AMHManhole.0MWLMiscellaneous Water Level34.0TFCTap Factory Capped73.4TFTap Factory86.8TFTap Factory102.5TFTap Factory132.0TFTap Factory139.7MWLS(S01)Miscellaneous Water Level Sag143.9MWLS(F01)Miscellaneous Water Level Sag156.6TFCTap Factory158.9TFTap Factory174.3MWLS(S02)Miscellaneous Water Level Sag190.1MWLS(F02)Miscellaneous Water Level Sag193.4MGOMiscellaneous General Observation	D680.0AMHManhole0.0MWLMiscellaneous Water Level8734.0TFCTap Factory Capped24373.4TFTap Factory Capped24373.4TFTap Factory539102.5TFTap Factory624132.0TFTap Factory624139.7MWLS(S01)Miscellaneous Water Level Sag813143.9MWLS(F01)Miscellaneous Water Level Sag840156.6TFCTap Factory Capped899158.9TFTap Factory962174.3MWLS(S02)Miscellaneous Water Level Sag1044190.1MWLS(F02)Miscellaneous Water Level Sag1126193.4MGOMiscellaneous General Observation1253

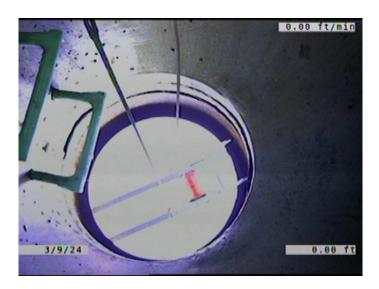

Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-704-068

Friday, April 26, 2024


M(704)072

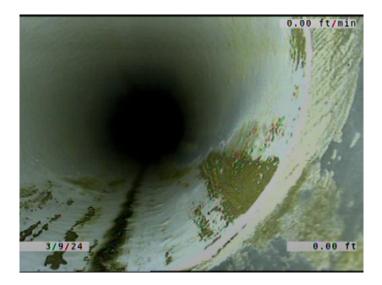


Code:	MWL
Description:	Miscellaneous Water Level
	•
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Code: Description:	TFC Tap Factory Capped
Distance (ft): Structural Grade:	34.0 0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	6.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

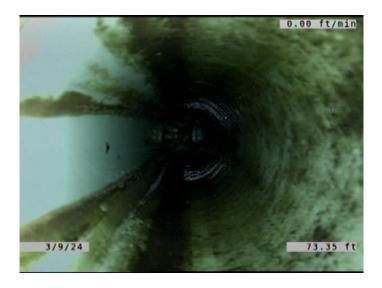


Code: Description:	TF Tap Factory
Distance (ft):	73.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	6.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

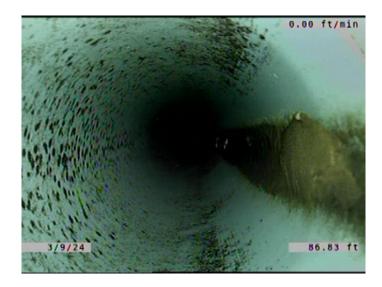

Code: Description:	TF Tap Factory
Distance (ft):	86.8
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	6.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

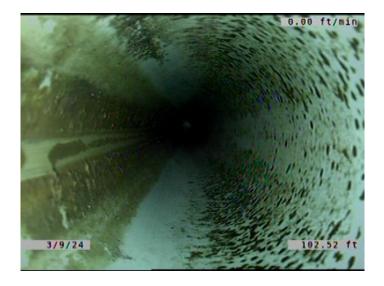

Code:	TF
Description:	Tap Factory
Distance (ft):	102.5
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	6.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

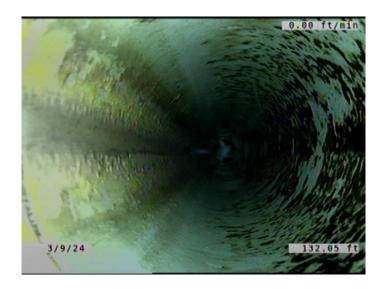


Code: Description:	TF Tap Factory
Distance (ft):	132.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	6.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	139.7
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S01
Within 8" of Joint:	NO
Remarks:	



Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	143.9
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	F01
Within 8" of Joint:	NO
Remarks:	

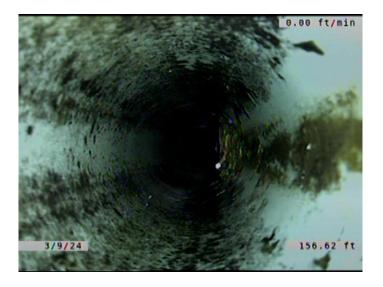


Code: Description:	TFC Tap Factory Capped
Distance (ft):	156.6
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	3
Clock To:	
1st Value:	6.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	TF Tap Factory
Distance (ft):	158.9
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	6.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	174.3
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	15.000
Continuous Index:	S02
Within 8" of Joint:	NO
Remarks:	

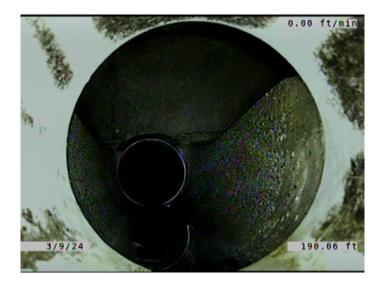

Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	190.1
Structural Grade: O&M Grade:	2
Clock Start/From:	0
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	15.000
Continuous Index:	F02
Within 8" of Joint:	NO
Remarks:	



Code: MGO Description: **Miscellaneous General Observation** Distance (ft): 193.4 Structural Grade: 0 0 O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: NO Remarks: MANHOLE FRAME HAS SHIFTED. SOIL VISIBLE.



Code: Description:	AMH Manhole
Distance (ft):	193.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-704-072