## **Profile/Photo Observation Report**

2.00

Overall Quick:

Overall Index:



2.00

Date: 03/09/2024 Weather: **PACP 7.0** Coding: Pipe Length (ft): 204.0 Owner: **City of Hobart** Pre Clean: **Light Cleaning** P.O.#: S. Bucklin PSR: P-704-075-051 Surveyor: Customer: **City of Hobart** Clean Date: 03/09/2024 Shape: **HARBOR CLUB DR** Flow Control: **Not Controlled** Street: City: Hobart, IN Year Renewed: Easement/Right of Way Tape/Media #: Location: Purpose: Sewer System Evaluation Survey (SS Dia/Height: 8" Use: **Sanitary Sewage Pipe** Material: **PVC** Drain Area: Lining: None Category: NA Comment: **Location Details:** Direction of Survey: **Downstream** US MH: M-704-075 DS MH: M-704-051 Total Length Surveyed (ft): 170.2 0.00 0000 0.00 O&M Index: O&M Quick: O&M Rating: 2.00 2100 2.00 Structural Index: Structural Quick: Structural Rating:

2100

Overall Rating:

	Position	Code	Observation	Video (sec)	Grade
704-0	75				
	.0	AMH	Manhole	0	NA
	0.	MWL	Miscellaneous Water Level	91	NA
ш	\\\ 5.9	MGO	Miscellaneous General Observation	191	NA
ш	77.2	TF	Tap Factory	620	NA
ш	92.0	TFC	Tap Factory Capped	697	NA
ш	121.5	MWLS	Miscellaneous Water Level Sag	849	S 2
ш	170.2	AMH	Manhole	1214	NA



Code:	AMH
Description:	Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-704-075



Code: MWL

Description: Miscellaneous Water Level

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:

5.000

NO



Code: MGO

Description: Miscellaneous General Observation

Distance (ft): 5.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From:
Clock To:

1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: WHERE BOWEN TIED THE EXISTING

**SEWER BACK TOGETHER AFTER THEY** 



Code: **TF** 

Description: Tap Factory

Distance (ft): 77.2
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 3

Clock To:


1st Value: **6.000** 

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

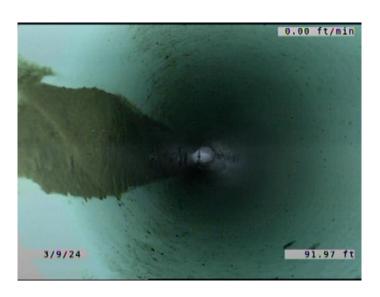

Code: **TFC** 

Description: Tap Factory Capped

Distance (ft): 92.0
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9


Clock To:

1st Value: **6.000** 

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:

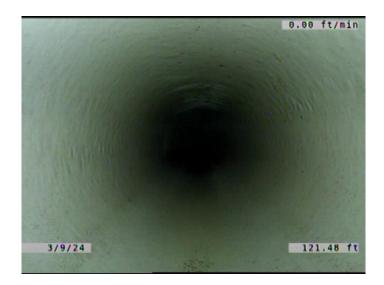

Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 121.5
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: AMH
Description: Manhole

Distance (ft): 170.2
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: M-704-051