| Date: | 09/17/2022 | Weather: | | Coding: | PACP 7.0 |
|-------------------|---------------------|-------------------|--------------------|--------------------------|---------------------|
| Pipe Length (ft): | 224.0 | Owner: | City of Hobart | Pre Clean: | No Pre-Cleaning |
| P.O.#: | YES502259 | Surveyor: | S. Bucklin | PSR: | M-705-030-M-705-029 |
| Customer: | City of Hobart | Clean Date | 2: | Shape: | С |
| Street: | Center Street | | Flow Control: | Not Controlle | d |
| City: | Hobart, IN | | Year Renewed: | | |
| Location: | Local rural streets | with light traffi | c, t Tape/Media #: | | |
| Purpose: | Routine Assessme | ent | Dia/Height: | 8" | |
| Use: | Sanitary Sewage I | Pipe | Material: | PVC | |
| Drain Area: | | | Lining: | None | |
| Category: | NA | | | | |
| Comment: | | | | | |
| Location Details | : | | Direction of Surv | vey: Upstream | |
| US MH: | M-705-030 | DS MH: | M-705-029 | Total Length Surveyed (f | it): 218.3 |
| 0&M Index: | 2.00 | O&M Quick | .: 2GC | 00 O&M Rating: | 86.00 |
| tructural Index: | 0.00 | Structural C | | 0 Structural Rating | g: 0.00 |
| Overall Index: | 2.00 | Overall Qui | | | 86.00 |

| | Position | Code | Observation | Video (sec) | Grade |
|--------------|----------------|----------|-----------------------------------|-------------|-------|
| M(705-) | 029 | | | | |
| ¹ | 0. / | AMH | Manhole | 1 | NA |
| | .0 | MWL | Miscellaneous Water Level | 77 | NA |
| | <u>, .0</u> | DSF(S01) | Deposits Settled Fine | 84 | M 2 |
| | 3.6 | TF | Tap Factory | 109 | NA |
| | 19.9 | MGO | Miscellaneous General Observation | 195 | NA |
| | 22.4 | TF | Tap Factory | 220 | NA |
| | 43.4 | TF | Tap Factory | 323 | NA |
| | 48.3 | TF | Tap Factory | 359 | NA |
| | 72.8 | TF | Tap Factory | 452 | NA |
| | 96.9 | TF | Tap Factory | 541 | NA |
| | 123.7 | TF | Tap Factory | 643 | NA |
| | /125.9 | TF | Tap Factory | 668 | NA |
| | // 168.0 | TF | Tap Factory | 817 | NA |
| 5 💻 | / 182.5 | MGO | Miscellaneous General Observation | 898 | NA |
| | 210.5 | MGO | Miscellaneous General Observation | 1028 | NA |
| | 212.5 | TF | Tap Factory | 1059 | NA |
| | 216.8 | DSF(F01) | Deposits Settled Fine | 1092 | M 2 |
| | // 218.3 | AMH | Manhole | 1177 | NA |



| Code: Description: | AMH Manhole |
|-----------------------|----------------|
| Distance (ft): | .0 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | |
| Clock To: | |
| 1st Value: | |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | NO |
| Remarks: | M-705-029 |


Tuesday, April 25, 2023




| Code: | MWL |
|---------------------|---------------------------|
| Description: | Miscellaneous Water Level |
| | |
| Distance (ft): | 0 |
| Distance (ft): | .0 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | |
| Clock To: | |
| 1st Value: | |
| 2nd Value: | |
| Value Percent: | 10.000 |
| Continuous Index: | |
| Within 8" of Joint: | NO |
| Remarks: | |
| | |



| Code: Description: | DSF Deposits Settled Fine |
|-----------------------|------------------------------|
| Distance (ft): | .0 |
| Structural Grade: | 0 |
| O&M Grade: | 2 |
| Clock Start/From: | 5 |
| Clock To: | 7 |
| 1st Value: | |
| 2nd Value: | |
| Value Percent: | 5.000 |
| Continuous Index: | S01 |
| Within 8" of Joint: | YES |
| Remarks: | |

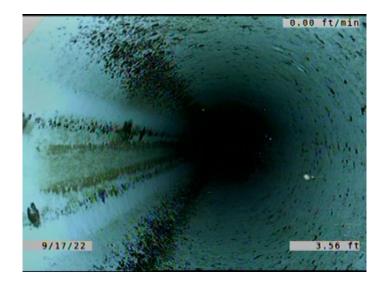

| Code: | TF |
|---------------------|-------------|
| Description: | Tap Factory |
| | |
| Distance (ft): | 3.6 |
| Distance (ft): | 5.0 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | 9 |
| Clock To: | |
| 1st Value: | 6.000 |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | YES |
| Remarks: | |
| | |

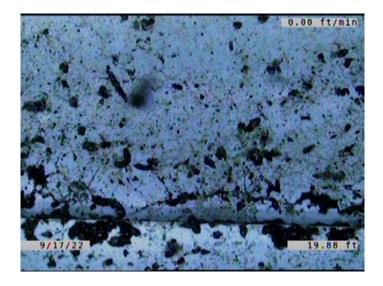

| Code: Description: | MGO Miscellaneous General Observation |
|--|---|
| Distance (ft): Structural Grade: | 19.9 0 |
| O&M Grade: | 0 |
| Clock Start/From: Clock To: | |
| 1st Value: 2nd Value: | |
| Value Percent: | |
| Continuous Index: Within 8" of Joint: | NO |
| Remarks: | JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED |




| Code: | TF |
|---------------------|-------------|
| Description: | Tap Factory |
| | |
| Distance (ft): | 22.4 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | 9 |
| Clock To: | |
| 1st Value: | 6.000 |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | YES |
| Remarks: | |




| Code: Description: | TF Tap Factory |
|-----------------------|-------------------|
| Distance (ft): | 43.4 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | 3 |
| Clock To: | |
| 1st Value: | 6.000 |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | YES |
| Remarks: | |
| | |




| TF |
|-------------|
| Tap Factory |
| |
| 48.3 |
| 40.5 |
| 0 |
| 0 |
| 9 |
| |
| 6.000 |
| |
| |
| |
| YES |
| |
| |

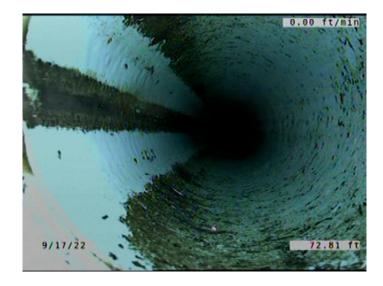


| Description: Tap Factory | |
|----------------------------|--|
| Distance (ft): 72.8 | |
| Structural Grade: 0 | |
| O&M Grade: 0 | |
| Clock Start/From: 9 | |
| Clock To: | |
| 1st Value: 6.000 | |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: YES | |
| Remarks: | |

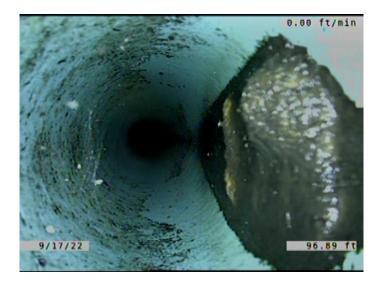

| Code: | TF |
|---------------------|-------------|
| Description: | Tap Factory |
| | |
| | |
| Distance (ft): | 96.9 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | 3 |
| Clock To: | |
| 1st Value: | 6.000 |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | YES |
| Remarks: | |

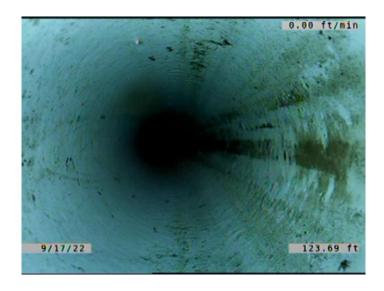

| Code: Description: | TF Tap Factory |
|-----------------------|-------------------|
| Distance (ft): | 123.7 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | 3 |
| Clock To: | |
| 1st Value: | 6.000 |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | YES |
| Remarks: | |
| | |

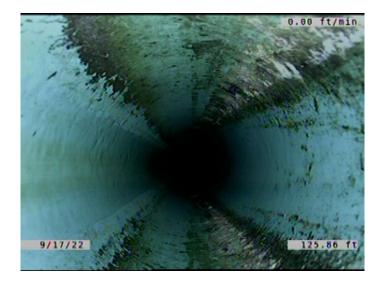

| Code: | TF |
|---------------------|-------------|
| Description: | Tap Factory |
| | |
| Distance (ft): | 125.9 |
| | 0 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | 9 |
| Clock To: | |
| 1st Value: | 6.000 |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | YES |
| Remarks: | |




| TF Tap Factory |
|-------------------|
| 168.0 |
| 0 |
| 0 |
| 9 |
| |
| 6.000 |
| |
| |
| |
| YES |
| |
| |




Code: MGO Description: **Miscellaneous General Observation** Distance (ft): 182.5 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: NO JOINT/ PIPES NOT PUSHED ALL THE Remarks: WAY TOGETHER WHEN INSTALLED




| Code: Description: | MGO Miscellaneous General Observation |
|-----------------------|---|
| Distance (ft): | 210.5 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | |
| Clock To: | |
| 1st Value: | |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | NO |
| Remarks: | JOINT/ PIPES NOT PUSHED ALL THE WAY TOGETHER WHEN INSTALLED |

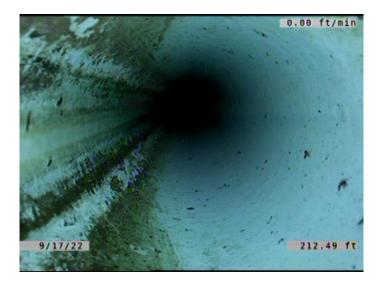

| Code: | TF |
|---------------------|-------------|
| Description: | Tap Factory |
| | |
| Distance (ft): | 212.5 |
| Structural Grade: | 0 |
| O&M Grade: | 0 |
| Clock Start/From: | 9 |
| Clock To: | |
| 1st Value: | 6.000 |
| 2nd Value: | |
| Value Percent: | |
| Continuous Index: | |
| Within 8" of Joint: | YES |
| Remarks: | |

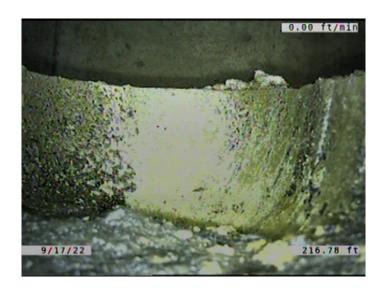

| Code: Description: | DSF Deposits Settled Fine |
|--|---|
| Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: | 216.8 0 2 5 7 5.000 F01 |
| Within 8" of Joint: Remarks: | YES |

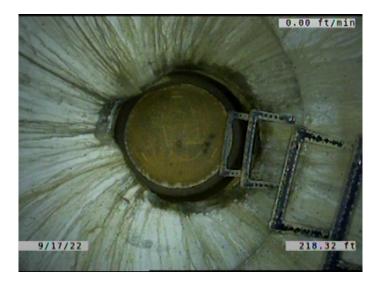

| Code: Description: | AMH Manhole |
|---|-----------------|
| Distance (ft): Structural Grade: O&M Grade: Clock Start/From: | 218.3 0 0 |
| Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks: | NO M-705-030 |