Profile/Photo Observation Report



Date: 04/16/2018 Weather: Coding: PACP 6.0

Pipe Length (ft): 181.0 Owner: NA Pre Clean: Not Known

P.O.#: Surveyor: Selasie Honu PSR: P-706-010.6-010.5

Customer: Clean Date: 01/01/1900 Shape: C

Street: Capitol Flow Control: Not Controlled

City: Hobart, IN Year Renewed: Location: Ditch Tape/Media #:

Purpose: Maintenance Related Dia/Height: 12"
Use: Sanitary Material: PVC

Drain Area: NA Lining: Cured in Place

Category: NA

Comment: flow incorrect.

Location Details: Direction of Survey: **Downstream**

US MH: M-706-010.5 DS MH: M-706-010.6 Total Length Surveyed (ft): 179.1

0.00 0000 0.00 O&M Index: O&M Quick: O&M Rating: 1.00 1100 1.00 Structural Quick: Structural Rating: Structural Index: 1.00 1100 1.00 Overall Index: Overall Quick: Overall Rating:

.0 .0 .0 .24.7	AMH MWL	Manhole	10	
.0		Manhole	10	
	MWI		10	NA
24.7		Water Level	21	NA
	TF	Tap Factory	82	NA
29.1	TF	Tap Factory	103	NA
66.2	TF	Tap Factory	190	NA
68.6	TF	Tap Factory	206	NA
//109.7	TF	Tap Factory	300	NA
156.7	TF	Tap Factory	406	NA
160.8	TF	Tap Factory	426	NA
173.8	JSM	Joint Separated Medium	463	S 1
179.1	AMH	Manhole	486	NA

Code:


Description:



Distance (ft).	0
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-706-010.5

AMH

Manhole

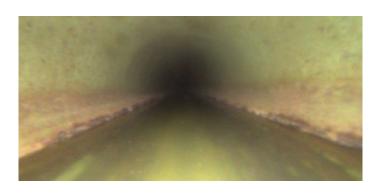

Code: MWL

Description: **Water Level**

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:


Within 8" of Joint:

Remarks:

30.000

NO

4.000

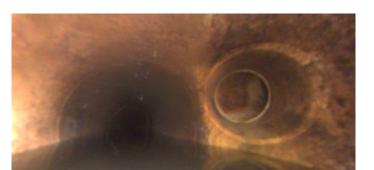

Code: TF


Description: **Tap Factory**

Distance (ft): 24.7 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 3

Clock To:

1st Value:

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

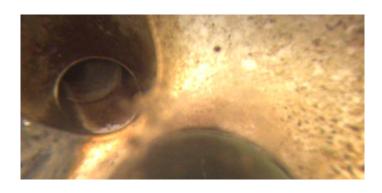

Code: **TF**

Description: Tap Factory

Distance (ft): 29.1
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: **TF**

Description: Tap Factory

Distance (ft): 66.2
Structural Grade: 0


O&M Grade: 0

Clock Start/From: 2

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

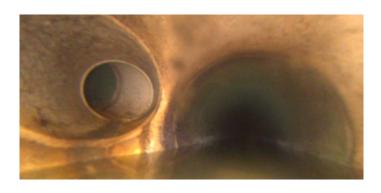

Code: **TF**

Description: Tap Factory

Distance (ft): 68.6
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: **TF**


Description: Tap Factory

Distance (ft): 109.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

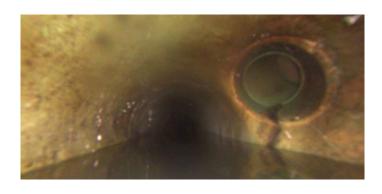

Code: TF

Description: **Tap Factory**


Distance (ft): 156.7 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 2

Clock To:

1st Value: 4.000

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

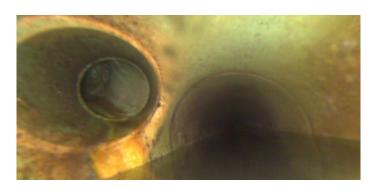

Code: TF


Description: **Tap Factory**

Distance (ft): 160.8 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 10

Clock To:

4.000 1st Value:

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

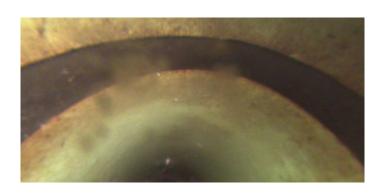

Code: JSM

Description: Joint Separated Medium

Distance (ft): 173.8
Structural Grade: 1
O&M Grade: 0


Clock Start/From: Clock To: 1st Value:

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

NO

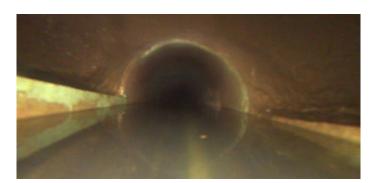

Code: AMH
Description: Manhole

Distance (ft): 179.1
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: M-706-010.6