
Date: Pipe Length (fi	10/21/2021	Weather: Owner:	Hobart, IN	Coding: Pre Clean:	PACP 6.0 Not Known
P.O.#:	930_1	Surveyor:	M. Pielacha	PSR:	P-706-064-065
Customer:	– Hobart, IN	, Clean Date:		Shape:	С
Street:	Middle School Lot		Flow Control:		
City:	Hobart, IN		Year Renewed:		
Location:	Parking Lot		Tape/Media #:	930	
Purpose:	Routine Assessmen	t	Dia/Height:	8"	
Use:	Sanitary		Material:	VCP	
Drain Area:			Lining:		
Category:	NA				
Comment:					
Location Detai	ils:		Direction of Surv	vey: Upstream	
US MH:	M-706-65	DS MH:	M-706-64	Total Length Surveyed (1	ft): 6.4
D&M Index:	3.00	O&M Quick:	310	0 O&M Rating:	3.00
tructural Index: 0.00		 Structural Qu	ick: 000		g: 0.00
Overall Index:	3.00	Overall Quick			3.00





Code:	АМН
Description:	Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-706-64

Thursday, May 4, 2023

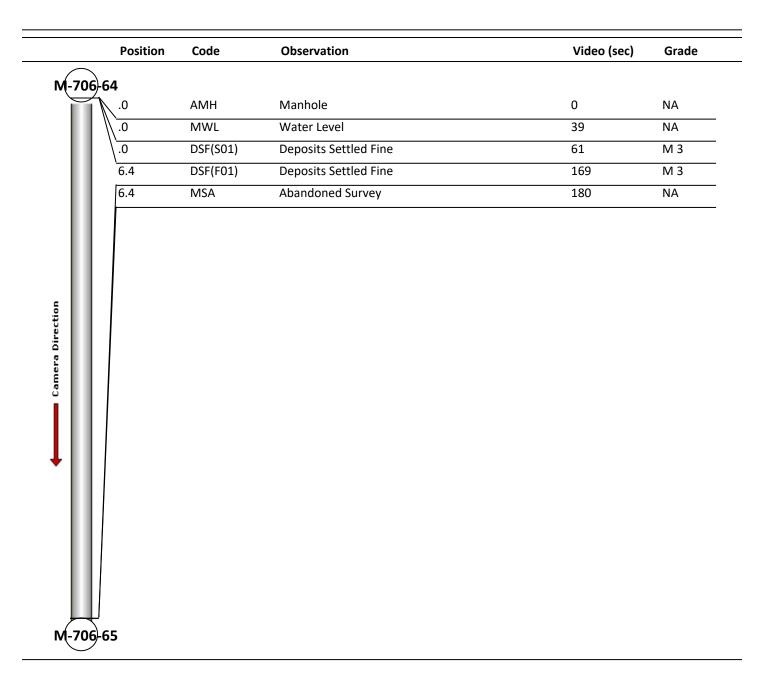

Code:	MWL
Description:	Water Level
	•
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	15.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Code: Description:	DSF Deposits Settled Fine
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	.0 0 3 4 8 15.000 S01 YES



Code: Description:	DSF Deposits Settled
Distance (ft):	6.4
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	4
Clock To:	8
1st Value:	
2nd Value:	
Value Percent:	20.000
Continuous Index:	F01
Within 8" of Joint:	NO
Remarks:	

Fine

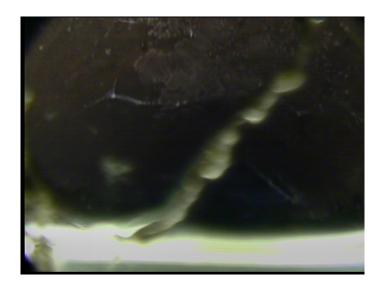

Code: Description:	MSA Abandoned Survey
Distance (ft):	6.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	deep sediment