## **Profile/Photo Observation Report**



Date: 03/29/2018 Weather: **PACP 6.0** Coding: Pipe Length (ft): 315.0 Owner: NA Pre Clean: **Not Known** P.O.#: **Mark Ruby** PSR: P-708-004-003 Surveyor:

Customer: Clean Date: 01/01/1900 Shape: C

Street: LINCOLN ST Flow Control: Not Controlled

City: Hobart, IN Year Renewed:
Location: Light Highway Tape/Media #:

Purpose: Maintenance Related Dia/Height: 8"
Use: Sanitary Material: PVC

Drain Area: **NA** Lining:

Category: NA


Comment:
Location Details: Direction of Survey:

US MH: M-707-003 DS MH: M-708-004 Total Length Surveyed (ft): 338.5

3125 2.17 13.00 O&M Index: O&M Quick: O&M Rating: 0.00 0000 0.00 Structural Quick: Structural Rating: Structural Index: 3125 2.17 13.00 Overall Quick: Overall Rating: Overall Index:

Upstream


Position	Code	Observation	Video (sec)	Grade
708-004				
0.	AMH	Manhole	10	NA
.0	MWL	Water Level	21	NA
\9.1	TF	Tap Factory	51	NA
79.9	TF	Tap Factory	205	NA
/113.3	TF	Tap Factory	284	NA
///	DAGS	Deposits Attached Grease	297	M 2
// 119.6	TF	Tap Factory	320	NA
147.4	TF	Tap Factory	388	NA
173.8	DAE	Deposits Attached Encrustation	453	M 3
//214.3	DAE	Deposits Attached Encrustation	545	M 2
241.3	DAE	Deposits Attached Encrustation	611	M 2
244.7	TF	Tap Factory	629	NA
282.3	IW	Infil Weeper	716	M 2
295.7	IW	Infil Weeper	754	M 2
338.5	AMH	Manhole	851	NA
	/	- Wallington	051	

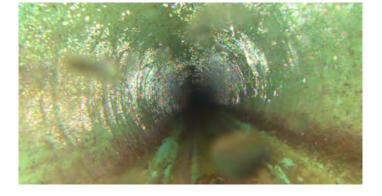

Code: AMH
Description: Manhole

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0
Clock Start/From:
Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint: NO

Remarks: M-708-004

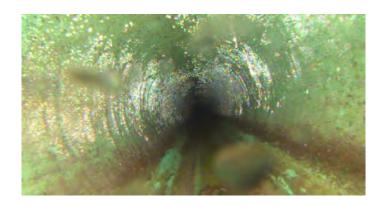

Code: MWL Description: **Water Level** 

Distance (ft): .0 Structural Grade: 0 0 O&M Grade:

Clock Start/From:

Clock To: 1st Value: 2nd Value:


Value Percent: 10.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO

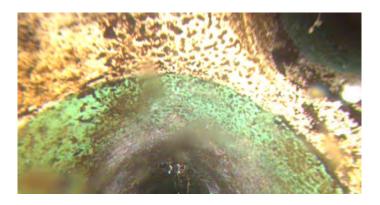

Code: TF

Description: **Tap Factory** 


Distance (ft): 9.1 Structural Grade: 0 O&M Grade: 0 Clock Start/From: 2

Clock To:

2nd Value:

1st Value: 4.000

Value Percent: Continuous Index: Within 8" of Joint:

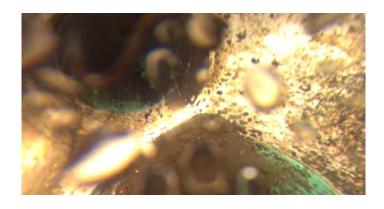

Code: **TF** 

Description: Tap Factory


Distance (ft): 79.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

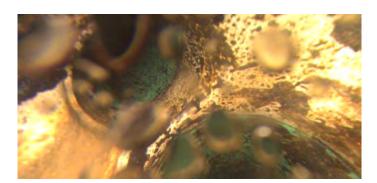

Code: **TF** 


Description: Tap Factory

Distance (ft): 113.3
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

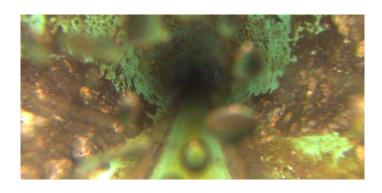

Code: DAGS

Description: Deposits Attached Grease

Distance (ft): 113.8
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4
1st Value:

2nd Value:


Value Percent: 5.000

Continuous Index:

Within 8" of Joint:

Remarks:

NO

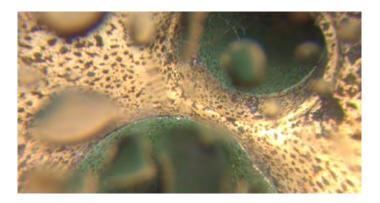

Code: **TF** 

Description: Tap Factory

Distance (ft): 119.6
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: **TF** 

Description: Tap Factory


Distance (ft): 147.4
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 2

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:

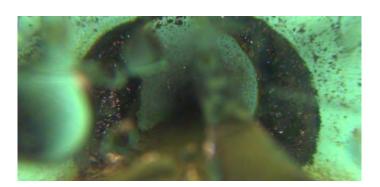

Code: DAE


Description: Deposits Attached Encrustation

Distance (ft): 173.8
Structural Grade: 0
O&M Grade: 3
Clock Start/From: 8
Clock To: 4
1st Value:
2nd Value:

Value Percent: 20.000

Continuous Index:

Within 8" of Joint: NO

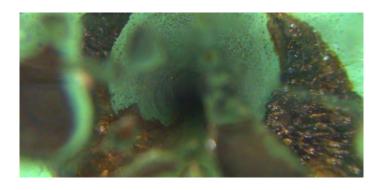

Code: DAE

Description: Deposits Attached Encrustation

Distance (ft): 214.3
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4
1st Value:

2nd Value:


Value Percent: 10.000

Continuous Index:

Within 8" of Joint:

Remarks:

YES

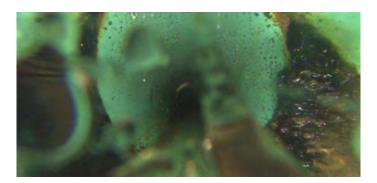

Code: DAE


Description: Deposits Attached Encrustation

Distance (ft): 241.3
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4
1st Value:
2nd Value:

Value Percent: 10.000

Continuous Index:

Within 8" of Joint: YES

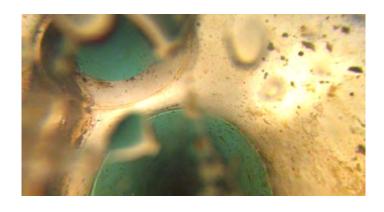

Code: **TF** 

Description: Tap Factory


Distance (ft): 244.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000** 

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:


Remarks:

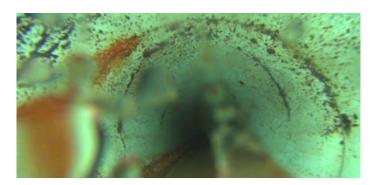

Code: IW

Description: Infil Weeper

Distance (ft): 282.3 Structural Grade: 0 O&M Grade: 2 Clock Start/From: 8 12 Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: YES

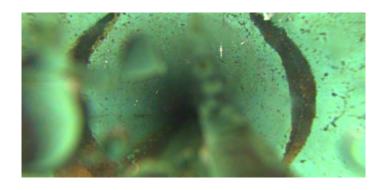

Code: IW

Description: Infil Weeper

Distance (ft): 295.7
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4

1st Value:
2nd Value:
Value Percent:
Continuous Index:
Within 8" of Joint:

Remarks:



Code: AMH
Description: Manhole

Distance (ft): 338.5
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: M-707-003