
Data	04/02/2018	\M/aatham		Coding:	
Date:	04/03/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft	:): 126.4	Owner:	NA	Pre Clean:	Not Known
P.O.#:		Surveyor:	Jen Costello	PSR:	P-708-111-110
Customer:		Clean Date:	01/01/1900	Shape:	С
Street:	Bracken		Flow Control:	Not Controlled	d
City:	Hobart, IN		Year Renewed:		
Location:	Sidewalk		Tape/Media #:		
Purpose:	Maintenance Rela	ated	Dia/Height:	8"	
Use:	Sanitary		Material:	PVC	
Drain Area:	NA		Lining:	Cured in Place	!
Category:	NA				
Comment:					
Location Detai	ls:		Direction of Surv	ey: Upstream	
US MH:	M-708-111	DS MH:	M-708-110	Total Length Surveyed (ft	:): 25.2
D&M Index:	2.00	O&M Quick:	220	0 O&M Rating:	4.00
Structural Index	0.00	 Structural Q	uick: 000		0.00
Overall Index:	2.00	Overall Quic		0 Overall Rating:	4.00





Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-708-110

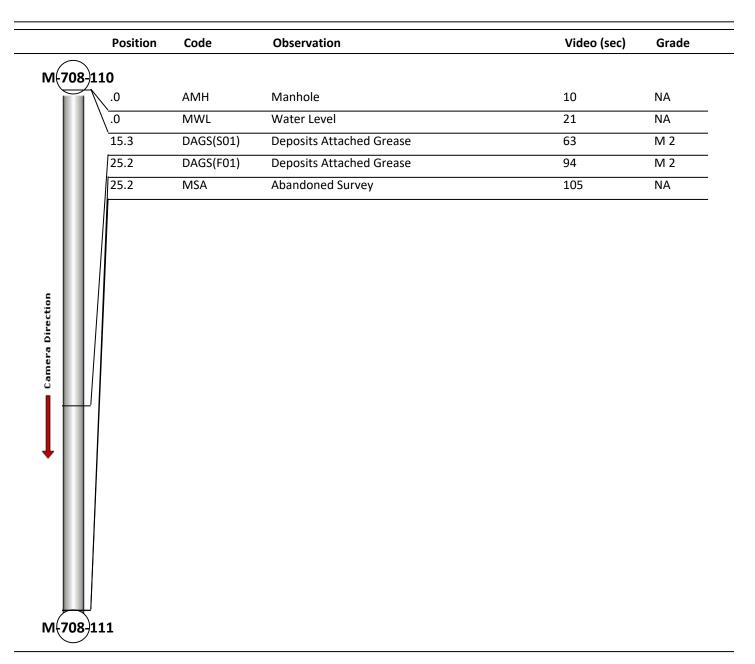

Code: Description:

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0 Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: 30.000 Continuous Index: Within 8" of Joint: NO Remarks:




Code:	DAGS
Description:	Deposits Attached Grease

MWL

Water Level

Distance (ft):	15.3
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S01
Within 8" of Joint:	NO
Remarks:	

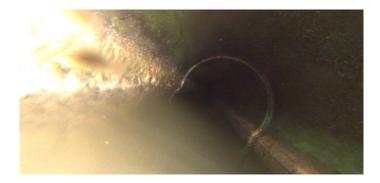

Code:DAGSDescription:Deposits Attached Grease

Distance (ft):	25.2
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	F01
Within 8" of Joint:	NO
Remarks:	

Code:	
Description:	

MSA Abandoned Survey

Distance (ft):	25.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	overturned