Profile/Photo Observation Report



Date: 03/27/2018 Weather: Coding: **PACP 6.0** Pipe Length (ft): 297.7 Owner: NA Pre Clean: **Not Known** P.O.#: Jen Costello PSR: P-803-027-028 Surveyor:

Customer: Clean Date: 01/01/1900 Shape: C

Street: E RAND ST & N LIBERTY ST Flow Control: Not Controlled

City: Hobart, IN Year Renewed:
Location: Other Tape/Media #:

Purpose: Not Known Dia/Height: 10"
Use: Sanitary Material: PVC

Drain Area: **NA** Lining:

Category: NA

Comment:

Location Details: Direction of Survey: Upstream

US MH: M-803-028 DS MH: M-803-027 Total Length Surveyed (ft): 239.2

2.00 2G00 84.00 O&M Index: O&M Quick: O&M Rating: 2.00 2100 2.00 Structural Index: Structural Quick: Structural Rating: 2.00 2G00 86.00 Overall Index: Overall Rating: Overall Quick:


.0 .0 .0 .0 4.7 13.9	AMH MWL DSF	Manhole Water Level Deposits Settled Fine	10	NA
.0 .0 .0 .0 .4.7	MWL DSF	Water Level		
.0	DSF		21	
4.7		Danasits Sattled Fine	— -	NA
11		Deposits Settled Fille	33	M 2
13.9	TF	Tap Factory	55	NA
	DAZ(S01)	Deposits Attached Other	87	M 2
88.5	TF	Tap Factory	250	NA
91.8	CL	Crack Longitudinal	270	S 2
//109.8	DSZ	Deposits Settled Other	319	M 2
// 131.6	TF	Tap Factory	378	NA
//145.3	TF	Tap Factory	421	NA
///185.5	TF	Tap Factory	517	NA
211.9	DAZ(F01)	Deposits Attached Other	583	M 2
239.2	MSA	Abandoned Survey	649	NA
803-028				

Code:



Description:	Manhole
Distance (ft):	.0
Structural Grade: O&M Grade:	0
Clock Start/From: Clock To:	
1st Value: 2nd Value:	
Value Percent: Continuous Index:	
Within 8" of Joint: Remarks:	NO M-803-027

AMH

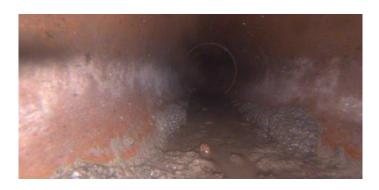

Code: MWL

Description: **Water Level**

Distance (ft): .0 Structural Grade: 0 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:

Within 8" of Joint:

Remarks:

5.000

NO

Code: **DSF**

Description: **Deposits Settled Fine**



Distance (ft): .0


Structural Grade: 0 O&M Grade: 2 Clock Start/From: 5 Clock To: 7

1st Value: 2nd Value:

Value Percent: 5.000

Continuous Index:

Within 8" of Joint: NO

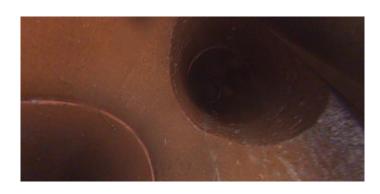

Code: **TF**

Description: Tap Factory

Distance (ft): 4.7
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value:

4.000

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: DAZ

Description: Deposits Attached Other

Distance (ft): 13.9
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4
1st Value:
2nd Value:

Value Percent: 5.000
Continuous Index: S01
Within 8" of Joint: YES



Code: **TF**

Description: Tap Factory

Distance (ft): 88.5
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 1

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:




Code: CL

Description: Crack Longitudinal

Distance (ft): 91.8
Structural Grade: 2
O&M Grade: 0
Clock Start/From: 10
Clock To:
1st Value:

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

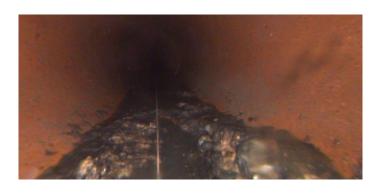

Code: DSZ

Description: Deposits Settled Other

Distance (ft): 109.8
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 5
Clock To: 7
1st Value:

2nd Value:

Value Percent: 10.000

Continuous Index:

Within 8" of Joint: NO Remarks: misc



Code: **TF**

Description: Tap Factory

Distance (ft): 131.6
Structural Grade: 0


O&M Grade: 0

Clock Start/From: 2

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

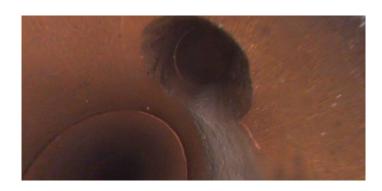

Code: **TF**

Description: Tap Factory

Distance (ft): 145.3
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:

Remarks:



Code: **TF**

Description: Tap Factory

Distance (ft): 185.5
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 10

Clock To:

1st Value: **4.000**

2nd Value: Value Percent: Continuous Index: Within 8" of Joint:



Code: DAZ

Description: Deposits Attached Other

Distance (ft): 211.9
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 8
Clock To: 4

1st Value: 2nd Value:

Value Percent: 5.000
Continuous Index: F01
Within 8" of Joint: YES

Remarks:

Code: MSA

Description: Abandoned Survey



Distance (ft): 239.2
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: unknown