Profile/Photo Observation Report

2.58

Overall Quick:

Overall Index:




31.00

Prome/Prioto Observation Report								
Date:	02/26/2022	Weather:		Coding:	PACP 7.0			
Pipe Length (ft)	: 301.9	Owner:	City of Hobart	Pre Clean:	Heavy Cleaning			
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-706-007-024			
Customer:	City of Hobart, IN	(Red Clean Date:	02/22/2022	Shape:	С			
Street:	South Linda Stre	et	Flow Control:	Not Controlle	d			
City:	Hobart, IN		Year Renewed:					
Location:	Local rural street	ts with light traffic	, t Tape/Media #:					
Purpose:	Routine Assessm	ent	Dia/Height:	12"				
Use:	Sanitary Sewage	Pipe	Material:	VCP				
Drain Area:			Lining:	None				
Category:	NA							
Comment:								
Location Details	s:		Direction of Sur	vey: Upstream				
US MH:	M-806-024	DS MH:	M-706-007	Total Length Surveyed (f	t): 31.8			
O&M Index:	2.00	O&M Quick:	280	O&M Rating:	16.00			
Structural Index:	3.75	Structural Qu	uick: 51 4	Structural Rating	15.00			

5141


Overall Rating:

	Position	Code	Observation	Video (sec)	Grade
1(706-)0	007				
	0. //	AMH	Manhole	1	NA
	0.	MWL	Miscellaneous Water Level	90	NA
ш	.2	DSF(S01)	Deposits Settled Fine	109	M 2
ш	.2	В	Broken	139	S 4
ш	1.6	JOMD	Joint Offset Medium Defective	204	S 3
ш	20.9	JOM	Joint Offset Medium	289	S 3
ш	24.9	TFC	Tap Factory Capped	322	NA
ш	31.0	BVV	Broken Void Visible	411	S 5
ш	31.0	RFB	Roots Fine Barrel	425	M 2
ш	31.6	ТВІ	Tap Break-in Intruding	448	M 2
ш	31.8	DSF(F01)	Deposits Settled Fine	478	M 2
ш	31.8	MSA	Miscellaneous Survey Abandoned	486	NA
Ш					
ш					

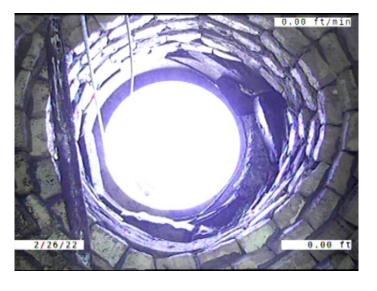

M(806)024

Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-706-007

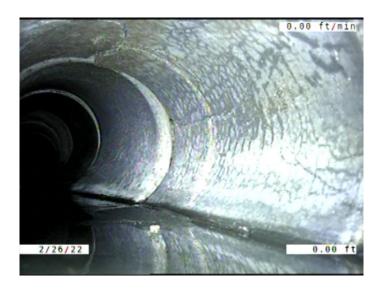

Code: MWL

Description: Miscellaneous Water Level

Distance (ft): .0
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent:

Continuous Index:

Within 8" of Joint: N

Remarks:

5.000

NO



Code: **DSF**

Description: Deposits Settled Fine

Distance (ft): .2
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 5
Clock To: 7
1st Value:

2nd Value:

Value Percent: 5.000
Continuous Index: S01
Within 8" of Joint: YES

Remarks:

ioint:



Code: B
Description: Broken

Distance (ft): .2
Structural Grade: 4

O&M Grade: 0

Clock Start/From: 8

Clock To: 4

1st Value:

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:

Code: JOMD

Description: Joint Offset Medium Defective

Distance (ft): 1.6
Structural Grade: 3
O&M Grade: 0


Clock Start/From:

Clock To:
1st Value:
2nd Value:
Value Percent:
Continuous Index:

Within 8" of Joint: NO

Remarks: VOID VISIBLE



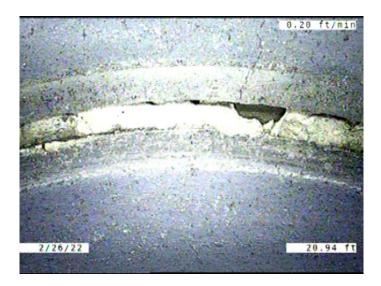

Code: **JOM**

Description: Joint Offset Medium

Distance (ft): 20.9
Structural Grade: 3
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

NO



Code: **TFC**

Description: Tap Factory Capped

Distance (ft): 24.9
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 11

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: BVV

Description: Broken Void Visible

Distance (ft): 31.0
Structural Grade: 5
O&M Grade: 0
Clock Start/From: 8
Clock To: 4


1st Value: 2nd Value: Value Percent: Continuous Index:

Maril: Oll Cl.:

Within 8" of Joint:

Remarks:

NO

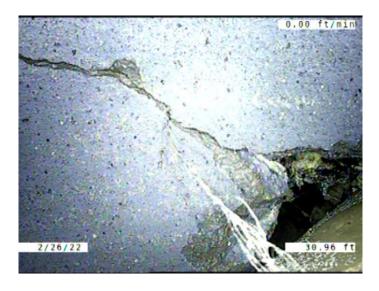

Code: RFB


Description: Roots Fine Barrel

Distance (ft): 31.0
Structural Grade: 0
O&M Grade: 2
Clock Start/From: 1

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks:

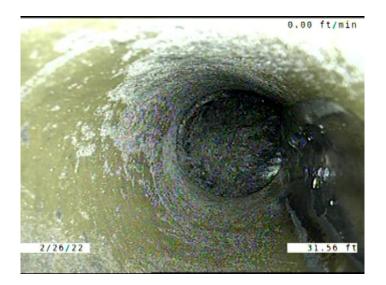

Code: **TBI**

Description: Tap Break-in Intruding

Distance (ft): 31.6
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 3

Clock To:

 1st Value:
 6.000

 2nd Value:
 3.000

Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: 95% PLUGGED WITH ROOTS.
CONSTANTLY RUNNING WATER.



Code: **DSF**

Description: Deposits Settled Fine

Distance (ft): 31.8
Structural Grade: 0

O&M Grade: 2

Clock Start/From: 5

Clock To: 7

1st Value:

Value Percent: 5.000
Continuous Index: F01
Within 8" of Joint: YES

Remarks:

2nd Value:



Code: MSA

Description: Miscellaneous Survey Abandoned

Distance (ft): 31.8
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: CAMERA CANT MAKE IT PAST

PROTRUDING TAP.