Profile/Photo Observation Report

2.00

Overall Quick:

Overall Index:




8.00

Date: 03/11/2024 **PACP 7.0** Weather: Coding: Pipe Length (ft): 159.0 Owner: **City of Hobart** Pre Clean: **Heavy Cleaning** P.O.#: S. Bucklin PSR: P-806-054-055 Surveyor: Customer: **City of Hobart** Clean Date: 03/09/2024 Shape: **DEER CROSS TRAIL** Flow Control: **Not Controlled** Street: City: Hobart, IN Year Renewed: Easement/Right of Way Tape/Media #: Location: Purpose: **Sewer System Evaluation Survey (SS** Dia/Height: 8" Use: **Sanitary Sewage Pipe** Material: **PVC** Drain Area: Lining: None Category: NA Comment: **Location Details:** Upstream Direction of Survey: US MH: M-806-055 DS MH: M-806-054 Total Length Surveyed (ft): 154.9 0.00 0000 0.00 O&M Index: O&M Quick: O&M Rating: 2.00 2400 8.00 Structural Index: Structural Quick: Structural Rating:

2400

Overall Rating:

	Position	Code	Observation	Video (sec)	Grade
806-054	1				
\searrow	.0	АМН	Manhole	0	NA
	.0	MWL	Miscellaneous Water Level	71	NA
	.0	MWLS(S01)	Miscellaneous Water Level Sag	78	S 2
H-\\	12.5	MWLS(F01)	Miscellaneous Water Level Sag	150	S 2
= 1/	21.7	MWLS(S02)	Miscellaneous Water Level Sag	201	S 2
	26.2	TF	Tap Factory	240	NA
	28.6	MWLS(F02)	Miscellaneous Water Level Sag	267	S 2
'	76.1	TF	Tap Factory	461	NA
	79.1	RPR(S03)	Point Repair Replacement	520	NA
	79.2	MWLS(S04)	Miscellaneous Water Level Sag	537	S 2
	82.5	RPR(F03)	Point Repair Replacement	596	NA
	83.9	MWLS(F04)	Miscellaneous Water Level Sag	623	S 2
	122.1	TF	Tap Factory	807	NA
	135.3	TF	Tap Factory	892	NA
	142.1	TF	Tap Factory	945	NA
	154.9	AMH	Manhole	1075	NA
806-05!	5				

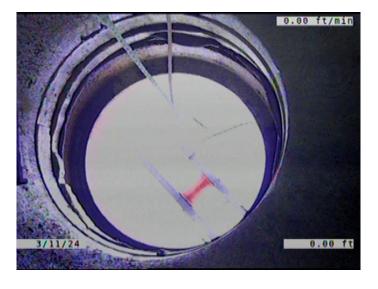

Code: Description:	AMH Manhole
Description.	Maillole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-806-054



Code: MWL

Description: **Miscellaneous Water Level**

Distance (ft): .0 Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value:

2nd Value:

Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

5.000

NO



Code: **MWLS**

Description: **Miscellaneous Water Level Sag**

Distance (ft): .0 Structural Grade: 2 O&M Grade: 0


Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000 Continuous Index: **S01** Within 8" of Joint: NO

Remarks:

3 Friday, April 26, 2024

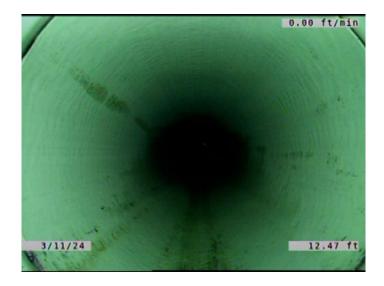

Code: **MWLS**

Description: **Miscellaneous Water Level Sag**

12.5 Distance (ft): Structural Grade: 2 0 O&M Grade:

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 15.000 F01 Continuous Index: Within 8" of Joint: NO

Remarks:



Code: **MWLS**

Description: **Miscellaneous Water Level Sag**

Distance (ft): 21.7 Structural Grade: 2 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 5.000 Continuous Index: **S02** Within 8" of Joint: NO

Remarks:

Friday, April 26, 2024 4



Code: TF

Description: **Tap Factory**

Distance (ft): 26.2 Structural Grade: 0 0 O&M Grade: Clock Start/From: 3

Clock To:

1st Value: 6.000

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: **MWLS**

Description: **Miscellaneous Water Level Sag**

Distance (ft): 28.6 Structural Grade: 2 O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

5.000 Value Percent: Continuous Index: F02 Within 8" of Joint: NO

Remarks:

5 Friday, April 26, 2024



Code: **TF**

Description: Tap Factory

Distance (ft): 76.1
Structural Grade: 0

O&M Grade: 0

Clock Start/From: 9

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES



Code: RPR

Description: Point Repair Replacement

Distance (ft): 79.1
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent:

Continuous Index: **S03**Within 8" of Joint: **YES**

Remarks: REPAIR MADE BY H&G ON 2-17-24.

WATER COMPANY BORED TRHOUGH



Code: MWLS

Description: Miscellaneous Water Level Sag

Distance (ft): 79.2
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000
Continuous Index: S04
Within 8" of Joint: NO

Remarks:

9.00 ft/min

3/11/24

Code: RPR

Description: Point Repair Replacement

Distance (ft): 82.5
Structural Grade: 0

O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent:

Continuous Index: F03
Within 8" of Joint: YES

Remarks: REPAIR MADE BY H&G ON 2-17-24.
WATER COMPANY BORED TRHOUGH

Friday, April 26, 2024 7

82.47 ft



Code: MWLS

Description: Miscellaneous Water Level Sag


Distance (ft): 83.9
Structural Grade: 2
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value:

Value Percent: 10.000
Continuous Index: F04
Within 8" of Joint: NO

Remarks:

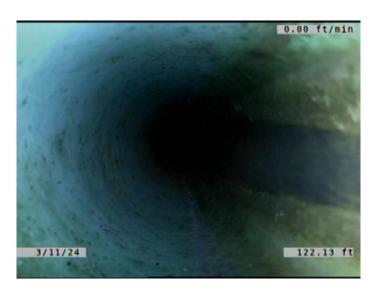

Code: **TF**

Description: **Tap Factory**

Distance (ft): 122.1
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 3

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:

irks:



Code: **TF**

Description: Tap Factory

Distance (ft): 135.3
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 9

Clock To:


1st Value: **6.000**

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint:

Remarks:

YES

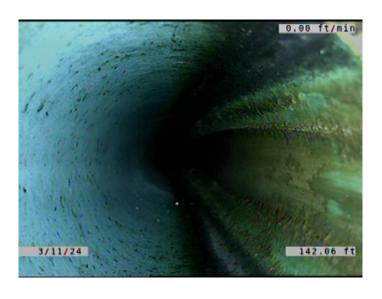

Code: **TF**

Description: Tap Factory

Distance (ft): 142.1
Structural Grade: 0
O&M Grade: 0
Clock Start/From: 3

Clock To:

1st Value: **6.000**

2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: YES

Remarks:



Code: AMH
Description: Manhole

Distance (ft): 154.9
Structural Grade: 0
O&M Grade: 0

Clock Start/From:

Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:

Within 8" of Joint: NO

Remarks: M-806-055