Profile/Ph	noto Observation	Report				RedZo
Date:	03/22/2018	Weather:			Coding:	PACP 6.0
Pipe Length (f	t): 376.5	Owner:	NA		Pre Clean:	Not Known
P.O.#:		Surveyor:	JUSTIN GON	ALES	PSR:	P-902-081-080
Customer:		Clean Date:	01/01/1900		Shape:	с
Street:	SAINT JOSEPH PL		Flow Control:		Not Controlled	
City:	Hobart, IN		Year Renewed	:		
Location:	Other		Tape/Media #:			
Purpose:	Not Known		Dia/Height:		10"	
Use:	Sanitary		Material:		PVC	
Drain Area:	NA		Lining:			
Category:	NA					
Comment:						
Location Detai	ils:		Direction of Su	rvey:	Downstream	
US MH:	M-902-081	DS MH:	M-902-080	Total L	ength Surveyed (ft):	382.0
D&M Index:	2.00	O&M Quick:	23	800	O&M Rating:	6.00
structural Index	0.00	Structural Q	uick: 00	000	Structural Rating:	0.00
Overall Index:	2.00	Overall Quic		800	Overall Rating:	6.00

	Code	Observation	Video (sec)	Grade
81				
.0	AMH	Manhole	10	NA
.0	MWL	Water Level	21	NA
2.3	DAZ	Deposits Attached Other	37	M 2
3.2	TFA	Tap Factory Active	50	NA
57.9	DAZ	Deposits Attached Other	171	M 2
60.3	TF	Tap Factory	187	NA
124.6	TFA	Tap Factory Active	328	NA
127.2	TF	Tap Factory	345	NA
186.6	TF	Tap Factory	477	NA
/189.0	TF	Tap Factory	495	NA
// 243.3	TF	Tap Factory	616	NA
/ 246.0	TF	Tap Factory	634	NA
303.5	TF	Tap Factory	762	NA
306.6	TF	Tap Factory	780	NA
306.6	DAZ	Deposits Attached Other	792	M 2
314.6	TF	Tap Factory	820	NA
327.5	TF	Tap Factory	859	NA
//382.0	AMH	Manhole	980	NA
	.0 2.3 3.2 57.9 60.3 124.6 127.2 186.6 189.0 243.3 246.0 303.5 306.6 306.6 314.6 327.5	.0 AMH .0 MWL 2.3 DAZ 3.2 TFA 57.9 DAZ 60.3 TF 124.6 TFA 127.2 TF 186.6 TF 243.3 TF 246.0 TF 303.5 TF 306.6 DAZ 314.6 TF 327.5 TF	.0AMHManhole.0MWLWater Level2.3DAZDeposits Attached Other3.2TFATap Factory Active57.9DAZDeposits Attached Other60.3TFTap Factory124.6TFATap Factory Active127.2TFTap Factory186.6TFTap Factory189.0TFTap Factory243.3TFTap Factory246.0TFTap Factory303.5TFTap Factory306.6TFTap Factory306.6TFTap Factory306.6TFTap Factory304.6TFTap Factory305.7TFTap Factory305.6TFTap Factory305.7TFTap Factory305.6TFTap Factory305.7TFTap Factory305.7TFTap Factory305.7TFTap Factory305.7TFTap Factory305.7TFTap Factory305.7TFTap Factory305.7TFTap Factory305.7TFTap Factory	.0AMHManhole10.0MWLWater Level212.3DAZDeposits Attached Other373.2TFATap Factory Active5057.9DAZDeposits Attached Other17160.3TFTap Factory187124.6TFATap Factory Active328127.2TFTap Factory Active345186.6TFTap Factory477189.0TFTap Factory495243.3TFTap Factory616246.0TFTap Factory634303.5TFTap Factory762306.6DAZDeposits Attached Other792314.6TFTap Factory820327.5TFTap Factory859



Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-902-081

M 902-080



Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code:	DAZ
Description:	Deposits Attached Other

Distance (ft):	2.3
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	5
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code:	TFA
Description:	Tap Factory Active

Distance (ft):	3.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	


Remarks:	
Code:	DAZ
Description:	Deposits Attached Other



Distance (ft):	57.9
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	5
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code:	TF
Description:	Tap Factory
	60 0
Distance (ft):	60.3
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

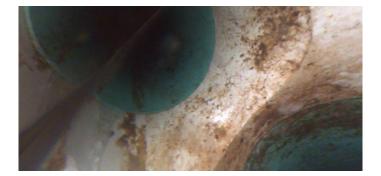

Code: Description:	TFA Tap Factory Active
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To:	124.6 0 0 11
1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	4.000



Code:	TF
Description:	Tap Factory
	497.9
Distance (ft):	127.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	1
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	

Continuous Index: Within 8" of Joint: Remarks:



Code:	TF
Description:	Tap Factory
Distance (ft):	186.6
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code:	TF
Description:	Tap Factory

Distance (ft):	189.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	11
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code: Description:	TF Tap Factory
Distance (ft):	243.3
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	10
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	




Code:	TF
Description:	Tap Factory

246.0
0
0
2
4.000




Code: Description:	TF Tap Factory
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	303.5 0 0 10 4.000

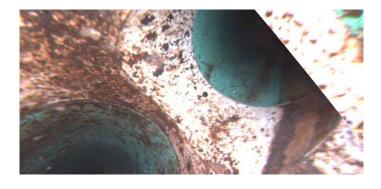

Code:	TF
Description:	Tap Factory

Distance (ft):	306.6
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

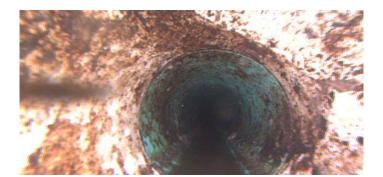


Code:	DAZ
Description:	Deposits Attached Other
Distance (ft):	306.6
Structural Grade:	0
OPN Crada	2

Structural Grade:	0
O&M Grade:	2
Clock Start/From:	7
Clock To:	5
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code:	TF
Description:	Tap Factory

Distance (ft):	314.6
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	2
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

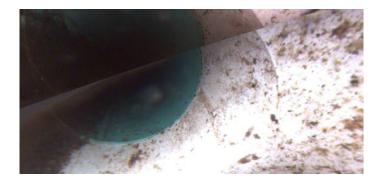

Code: Description:	TF Tap Factory
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint:	327.5 0 0 11 4.000
Remarks:	



Code: AMH Description: Manhole

Distance (ft):	382.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-902-080