Date:	03/23/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft):	189.9	Owner:	NA	Pre Clean:	Not Known
P.O.#:		Surveyor:	Jen Costello	PSR:	P-903-003-004
Customer:		Clean Date:	01/01/1900	Shape:	С
Street:	N SHELBY PL		Flow Control:	Not Controlled	
City:	Hobart, IN		Year Renewed:		
Location:	Other		Tape/Media #:		
Purpose:	Not Known		Dia/Height:	10"	
Use:	Sanitary		Material:	PVC	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:					
Location Details:			Direction of Survey	: Upstream	
US MH: N	1-903-003	DS MH:	M-903-004	Total Length Surveyed (ft)	: <b>192.2</b>
D&M Index:	2.11	O&M Quick:	512D	O&M Rating:	57.00
Structural Index:	0.00	Structural Qu	uick: 0000	Structural Rating:	0.00
Overall Index:	2.11	Overall Quic	5400	Overall Rating:	57.00

		Position	Code	Observation	Video (sec)	Grade
M	903-004	4				
		.0	AMH	Manhole	10	NA
		.0	MWL	Water Level	21	NA
		.0	DAGS(S01)	Deposits Attached Grease	32	M 2
-	· / ·	25.4	TFA	Tap Factory Active	95	NA
		91.4	TFD	Tap Factory Defective	240	M 2
		119.2	DAGS(F01)	Deposits Attached Grease	308	M 2
		143.2	TFA	Tap Factory Active	368	NA
		149.8	TFD	Tap Factory Defective	394	M 2
		149.8	DAE	Deposits Attached Encrustation	405	M 5
5		182.7	TFA	Tap Factory Active	485	NA
ecti		192.2	AMH	Manhole	515	NA
Camera Direction						
M(S	903-003	3				



Code:	АМН
Description:	Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-903-004




Code: MWL Description: Water Level

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code:	DAGS
Description:	Deposits Attached Grease

Distance (ft):	.0
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	S01
Within 8" of Joint:	NO
Remarks:	

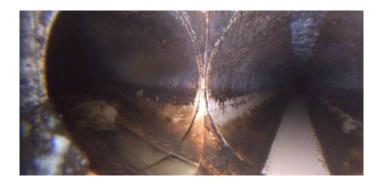

Code:TFADescription:Tap Factory Active

D: ((1))	
Distance (ft):	25.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code: Description:	TFD Tap Factory Defective
Distance (ft):	91.4
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	debris




Code:DAGSDescription:Deposits Attached Grease

Distance (ft):	119.2
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	F01
Within 8" of Joint:	NO
Remarks:	



Code:	TFA
Description:	Tap Factory Active
Distance (ft):	143.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	

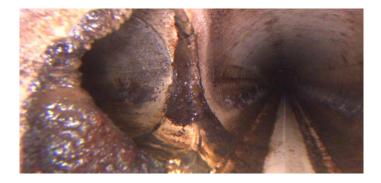

Code: TFD Description: Tap Factory Defective Distance (ft): 149.8 Structural Grade: 0


Structural Grade:	0
O&M Grade:	2
Clock Start/From:	3
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	dae

Code: Description:

DAE Deposits Attached Encrustation



Distance (ft):	149.8
Structural Grade:	0
O&M Grade:	5
Clock Start/From:	1
Clock To:	3
1st Value:	
2nd Value:	
Value Percent:	40.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	

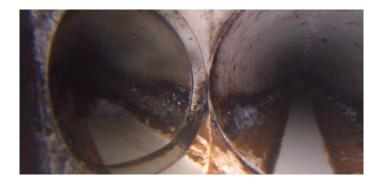

Code: Description: TFA Tap Factory Active

Distance (ft):	182.7
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	9
Clock To:	
1st Value:	4.000
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	
Remarks:	



Code:	AMH
Description:	Manhole

Distance (ft):	192.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-903-003