
-						ROBOTICS
Date:	08/03/2023	Weather:			Coding:	PACP 7.0
Pipe Length (ft):	: 182.9	Owner:	City of Hobar	t	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin		PSR:	M-903-008-M-903-063
Customer:	City of Hobart	Clean Date:	06/12/2023		Shape:	С
Street:	East Ridge Road		Flow Control:		Not Controlled	
City:	Hobart, IN		Year Renewed:			
Location:	Easement/Right o	of Way	Tape/Media #:			
Purpose:	Routine Assessme	ent	Dia/Height:		12"	
Use:	Sanitary Sewage I	Pipe	Material:		PVC	
Drain Area:			Lining:		None	
Category:	NA					
Comment:						
Location Details	:		Direction of Su	rvey:	Downstream	
US MH:	M-903-008	DS MH:	M-903-063	Tota	Length Surveyed (ft)	182.9
0&M Index:	0.00	O&M Quick:	00	00	O&M Rating:	0.00
tructural Index:	2.00	Structural Q	uick: 21	00	Structural Rating:	2.00
Overall Index:	2.00	Overall Quic		00	Overall Rating:	2.00





Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-903-008

Monday, February 19, 2024

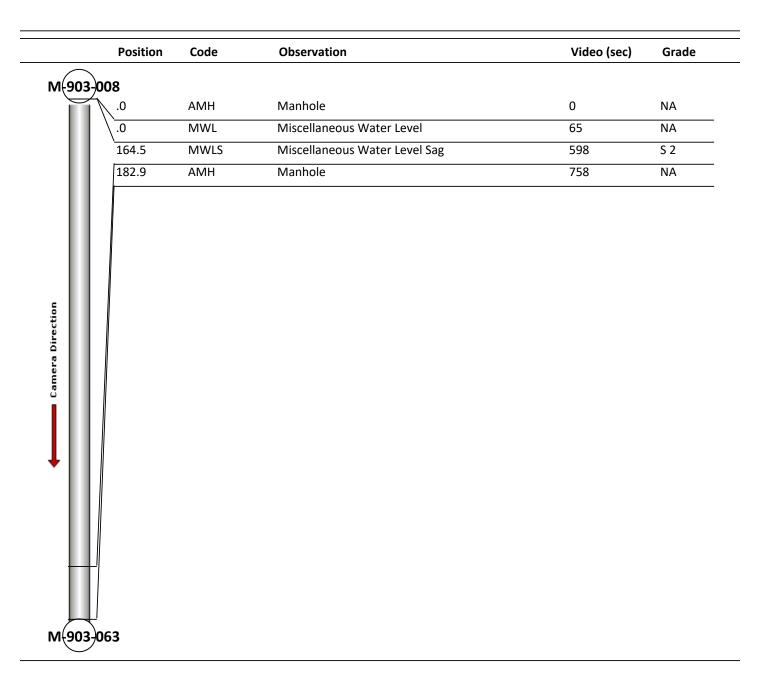

Code:	MWL
Description:	Miscellaneous Water Level
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	10.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	MWLS Miscellaneous Water Level Sag
Distance (ft):	164.5
Structural Grade:	2
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	20.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



AMH Manhole
182.9 0 0
NO M-903-063