
Date:	01/28/2025	Weather:		Coding:	PACP 7.0
Pipe Length (ft):		Owner:	City of Hobart	Pre Clean:	Heavy Cleaning
P.O.#:	YES502259	Surveyor:	S. Bucklin	PSR:	P-904-009-010
Customer:	City of Hobart	Clean Date:	12/04/2024	Shape:	С
Street:	Fraser Lane		Flow Control:	Not Controlle	d
City:	Hobart, IN		Year Renewed:		
Location:	Other		Tape/Media #:		
Purpose:	Sewer System Eva	aluation Survey (S	<b>S</b> Dia/Height:	18"	
Use:	Sanitary Sewage I	Pipe	Material:	VCP	
Drain Area:			Lining:	None	
Category:	NA				
Comment:					
Location Details	BIKE TRAIL		Direction of Surve	ey: Upstream	
US MH:	M-904-009	DS MH:	M-904-010	Total Length Surveyed (ft	t): <b>142.2</b>
D&M Index:	1.29	O&M Quick:	2215	O&M Rating:	9.00
Structural Index:	2.00	Structural Qu	lick: 2100		2.00
Overall Index:	1.38	Overall Quick			11.00

	Position	Code	Observation	Video (sec)	Grade
M-90	04-010				
	.0	AMH	Manhole	0	NA
- 1	.0	MWL	Miscellaneous Water Level	87	NA
- 1	123.3	ISB	Infiltration Stain Barrel	542	M 1
- 1	125.4	ISB	Infiltration Stain Barrel	572	M 1
- 1	128.1	ISB	Infiltration Stain Barrel	610	M 1
- 1	128.2	ISB	Infiltration Stain Barrel	633	M 1
- 1	133.8	DAE	Deposits Attached Encrustation	706	M 2
- 1	133.8	IWJ	Infiltration Weeper Joint	723	M 2
- 1	139.5	CL	Crack Longitudinal	766	S 2
5	139.5	ISB	Infiltration Stain Barrel	778	M 1
ecti	142.2	AMH	Manhole	897	NA
Camera Direction					



Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-904-010

Friday, March 21, 2025

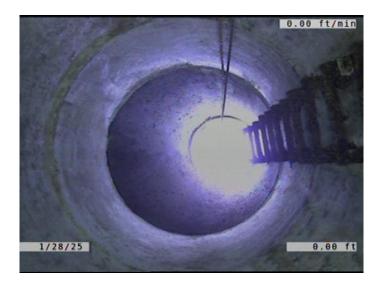

Code:	MWL
Description:	Miscellaneous Water Level
Distance (ft):	•
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	30.000
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	




Code: Description:	ISB Infiltration Stain Barrel
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	123.3 0 1 9 10 NO
Remarks:	




Code: Description:	ISB Infiltration Stain Barrel
Distance (ft):	125.4
Structural Grade:	0
O&M Grade:	1
Clock Start/From:	11
Clock To:	1
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	



Code: Description:	ISB Infiltration Stain Barrel
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index: Within 8" of Joint: Remarks:	128.1 0 1 9 11 YES

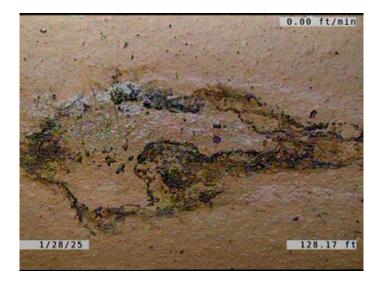

Code: Description:	ISB Infiltration Stain Barrel
Distance (ft):	128.2
Structural Grade:	0
O&M Grade:	1
Clock Start/From:	1
Clock To:	3
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

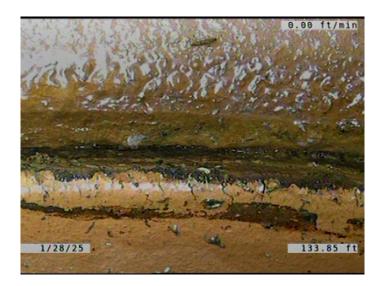

Code: Description:	DAE Deposits Attached Encrustation
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent:	133.8 0 2 8 4 5.000
Continuous Index: Within 8" of Joint: Remarks:	YES



Code: Description:	IWJ Infiltration Weeper Joint
Distance (ft):	133.8
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	12
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	CL Crack Longitudinal
Distance (ft): Structural Grade: O&M Grade: Clock Start/From: Clock To: 1st Value: 2nd Value: Value Percent: Continuous Index:	139.5 2 0 2
Within 8" of Joint: Remarks:	YES



Code:	ISB
Description:	Infiltration Stain Barrel
Distance (ft):	139.5
Structural Grade:	0
O&M Grade:	1
Clock Start/From:	2
Clock To:	3
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code: Description:	AMH Manhole
Distance (ft):	142.2
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-904-009