Date:	04/16/2018	Weather:		Coding:	PACP 6.0
Pipe Length (ft):	172.9	Owner:	NA	Pre Clean:	Not Known
P.O.#:		Surveyor:	Selasie Honu	PSR:	P-904-012-009
Customer:		Clean Date:	01/01/1900	Shape:	С
Street:	FRASER LN		Flow Control:	Not Controlled	1
City:	Hobart, IN		Year Renewed:		
Location:	Other		Tape/Media #:		
Purpose:	Not Known		Dia/Height:	10"	
Use:	Sanitary		Material:	VCP	
Drain Area:	NA		Lining:		
Category:	NA				
Comment:					
Location Details:			Direction of Surv	ey: Downstream	
US MH:	v1-904-009	DS MH:	M-904-012	Total Length Surveyed (ft	): <b>125.1</b>
0&M Index:	2.25	O&M Quick:	312	3 O&M Rating:	9.00
structural Index:	0.00	Structural Qu	uick: 000		0.00
Overall Index:	2.25	Overall Quicl	242		9.00

	Code	Observation	Video (sec)	Grad
904-009				
.0	AMH	Manhole	10	NA
.0	MWL	Water Level	21	NA
46.4	MGO	General Observation	128	NA
54.8	DAE	Deposits Attached Encrustation	156	M 2
54.8	IW	Infil Weeper	167	M 2
90.8	ID	Infil Dripper	251	M 3
90.8	DAE	Deposits Attached Encrustation	262	M 2
125.1	MSA	Abandoned Survey	344	NA




Code: Description:	AMH Manhole
Distance (ft):	.0
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	M-904-009

\_




Code: MWL Description: Water Level

.0
0
0
5.000
NO

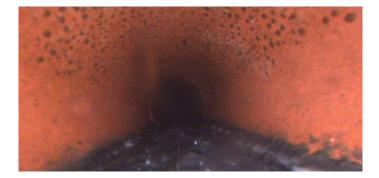


Code:	MGO
Description:	General Observation

Distance (ft):	46.4
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	rear camera

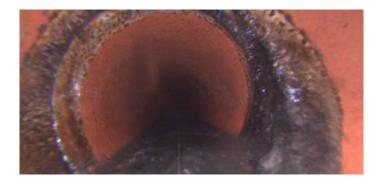

Code:DAEDescription:Deposits Attached Encrustation

Distance (ft):	54.8
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	5.000
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

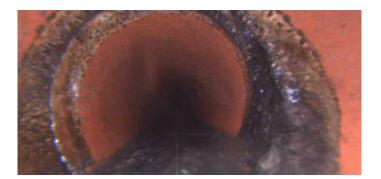


Code: Description:	IW Infil Weeper
Distance (ft):	54.8
Structural Grade:	0
O&M Grade:	2
Clock Start/From:	8
Clock To:	4
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	



Code:	ID
Description:	Infil Dripper

Distance (ft):	90.8
Structural Grade:	0
O&M Grade:	3
Clock Start/From:	12
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	YES
Remarks:	

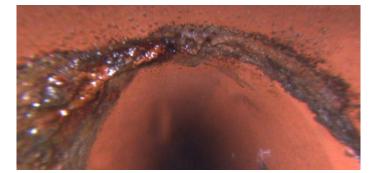

Code:	DAE
Description:	Deposits Attached Encrustation

90.8
0
2
8
4
10.000
YES



Code: Description: MSA Abandoned Survey

Distance (ft):	125.1
Structural Grade:	0
O&M Grade:	0
Clock Start/From:	
Clock To:	
1st Value:	
2nd Value:	
Value Percent:	
Continuous Index:	
Within 8" of Joint:	NO
Remarks:	camera stopped